


⚠ DANGER

*ELECTRICAL SHOCK HAZARD
*DISCONNECT POWER BEFORE
SERVICING.

⚠ WARNING


USE COPPER CONDUCTORS
ONLY SUITABLE FOR AT LEAST
75° C.

Note: See Control Wiring Section of Installation Inst. for Wiring Energy Recovery to Unit

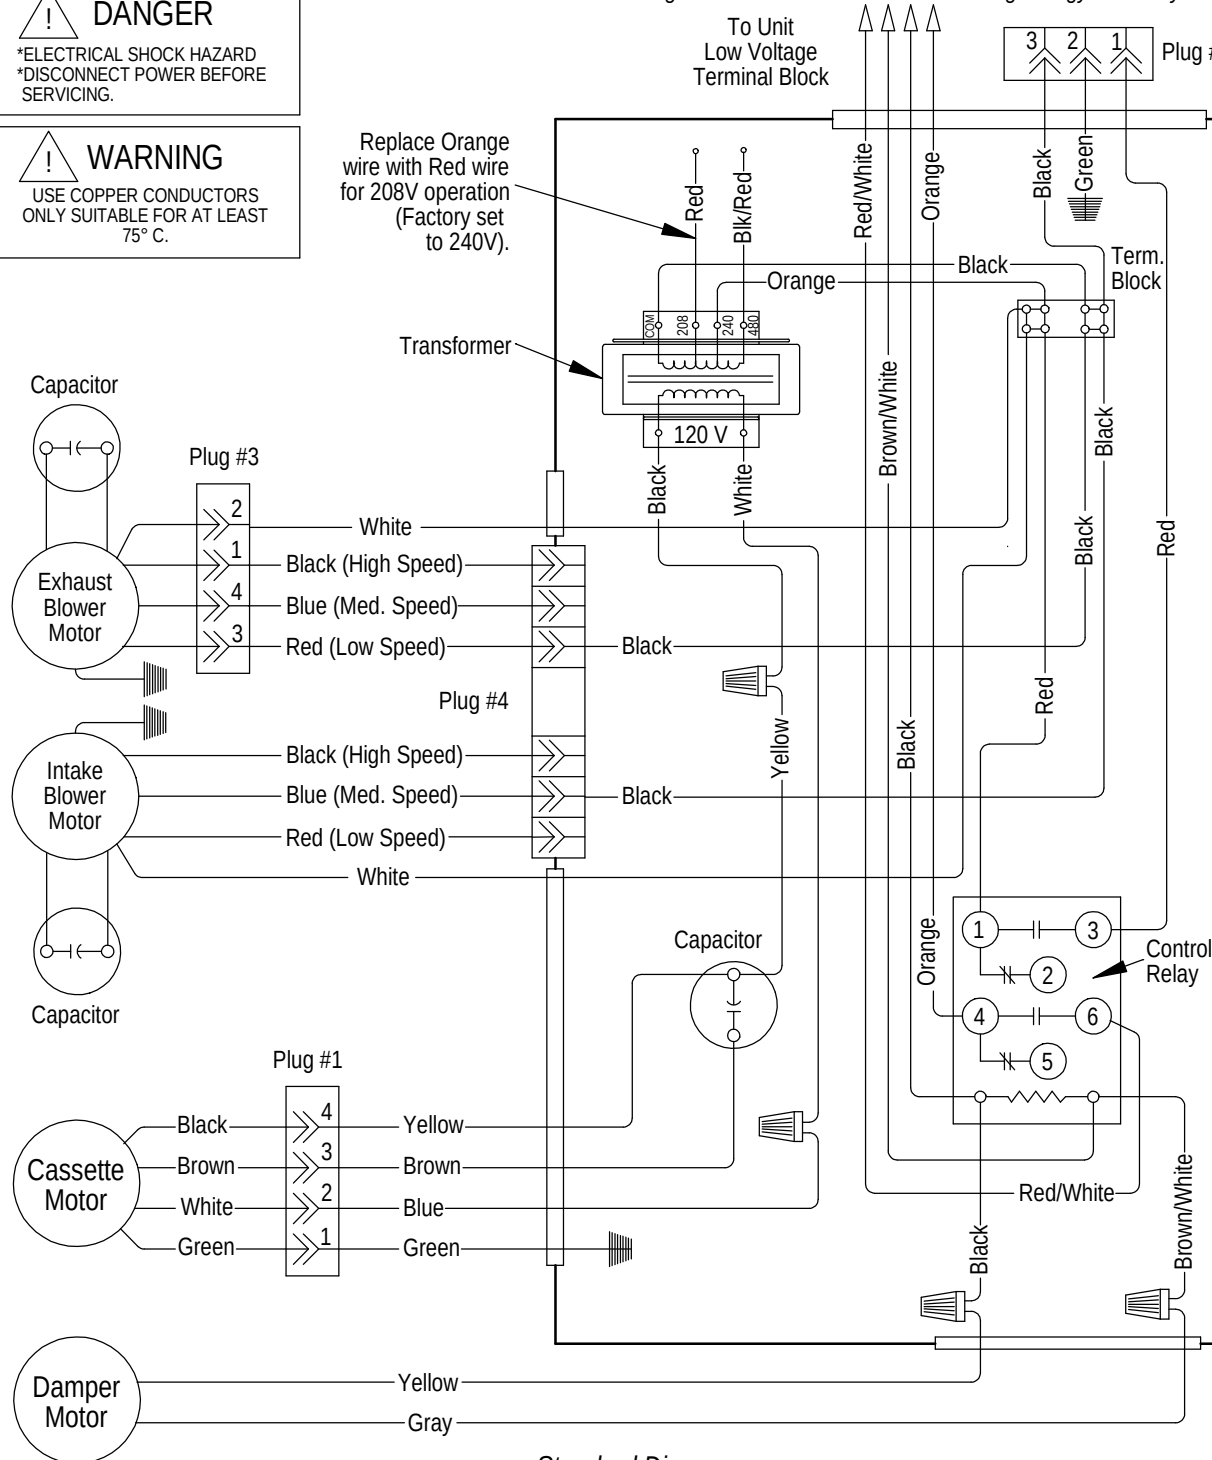

Standard Diagram

To Unit High Voltage 240/208-60-1

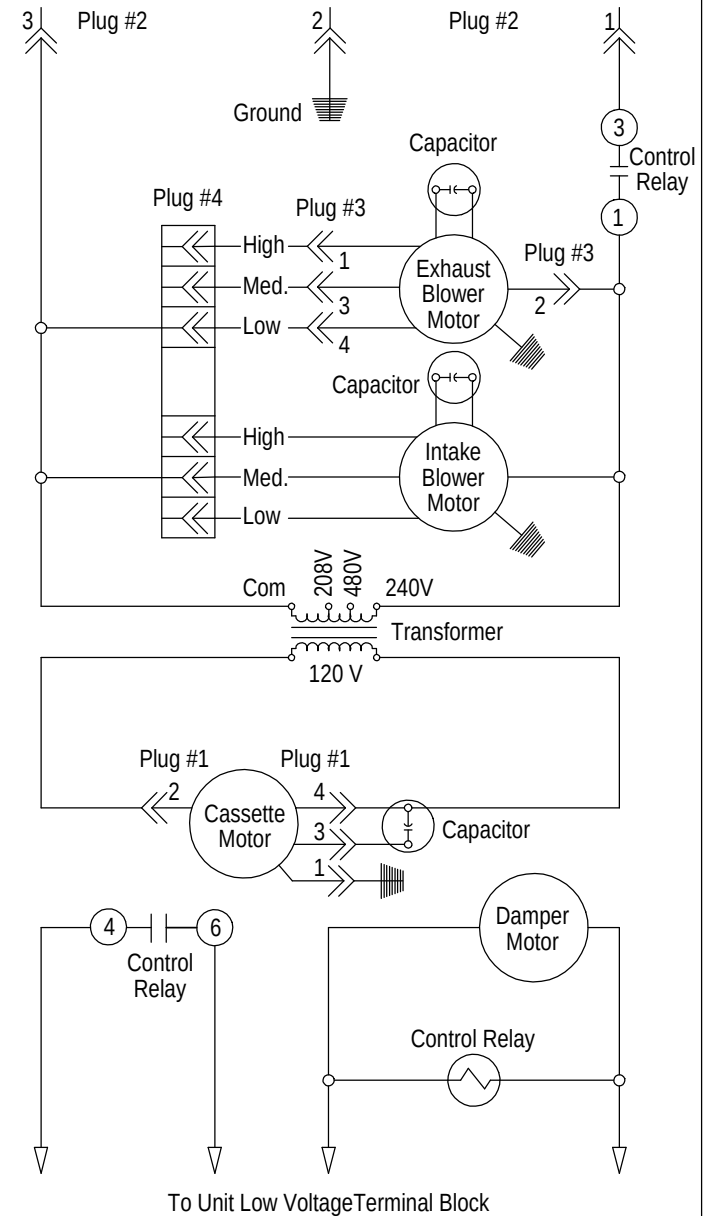

Note: See Control Wiring Section of Installation Inst. for Wiring Energy Recovery to Unit

Ladder Diagram

4056-192 A