


*ELECTRICAL SHOCK HAZARD
*DISCONNECT POWER BEFORE
SERVICING.

USE COPPER CONDUCTORS
ONLY SUITABLE FOR AT LEAST
75° C.

*480VAC units, connect to terminal block (balloon #41) on the 230V side of power transformer

Note: See HIGH VOLTAGE CONNECTION notes for connecting wire #'s 11 & 12

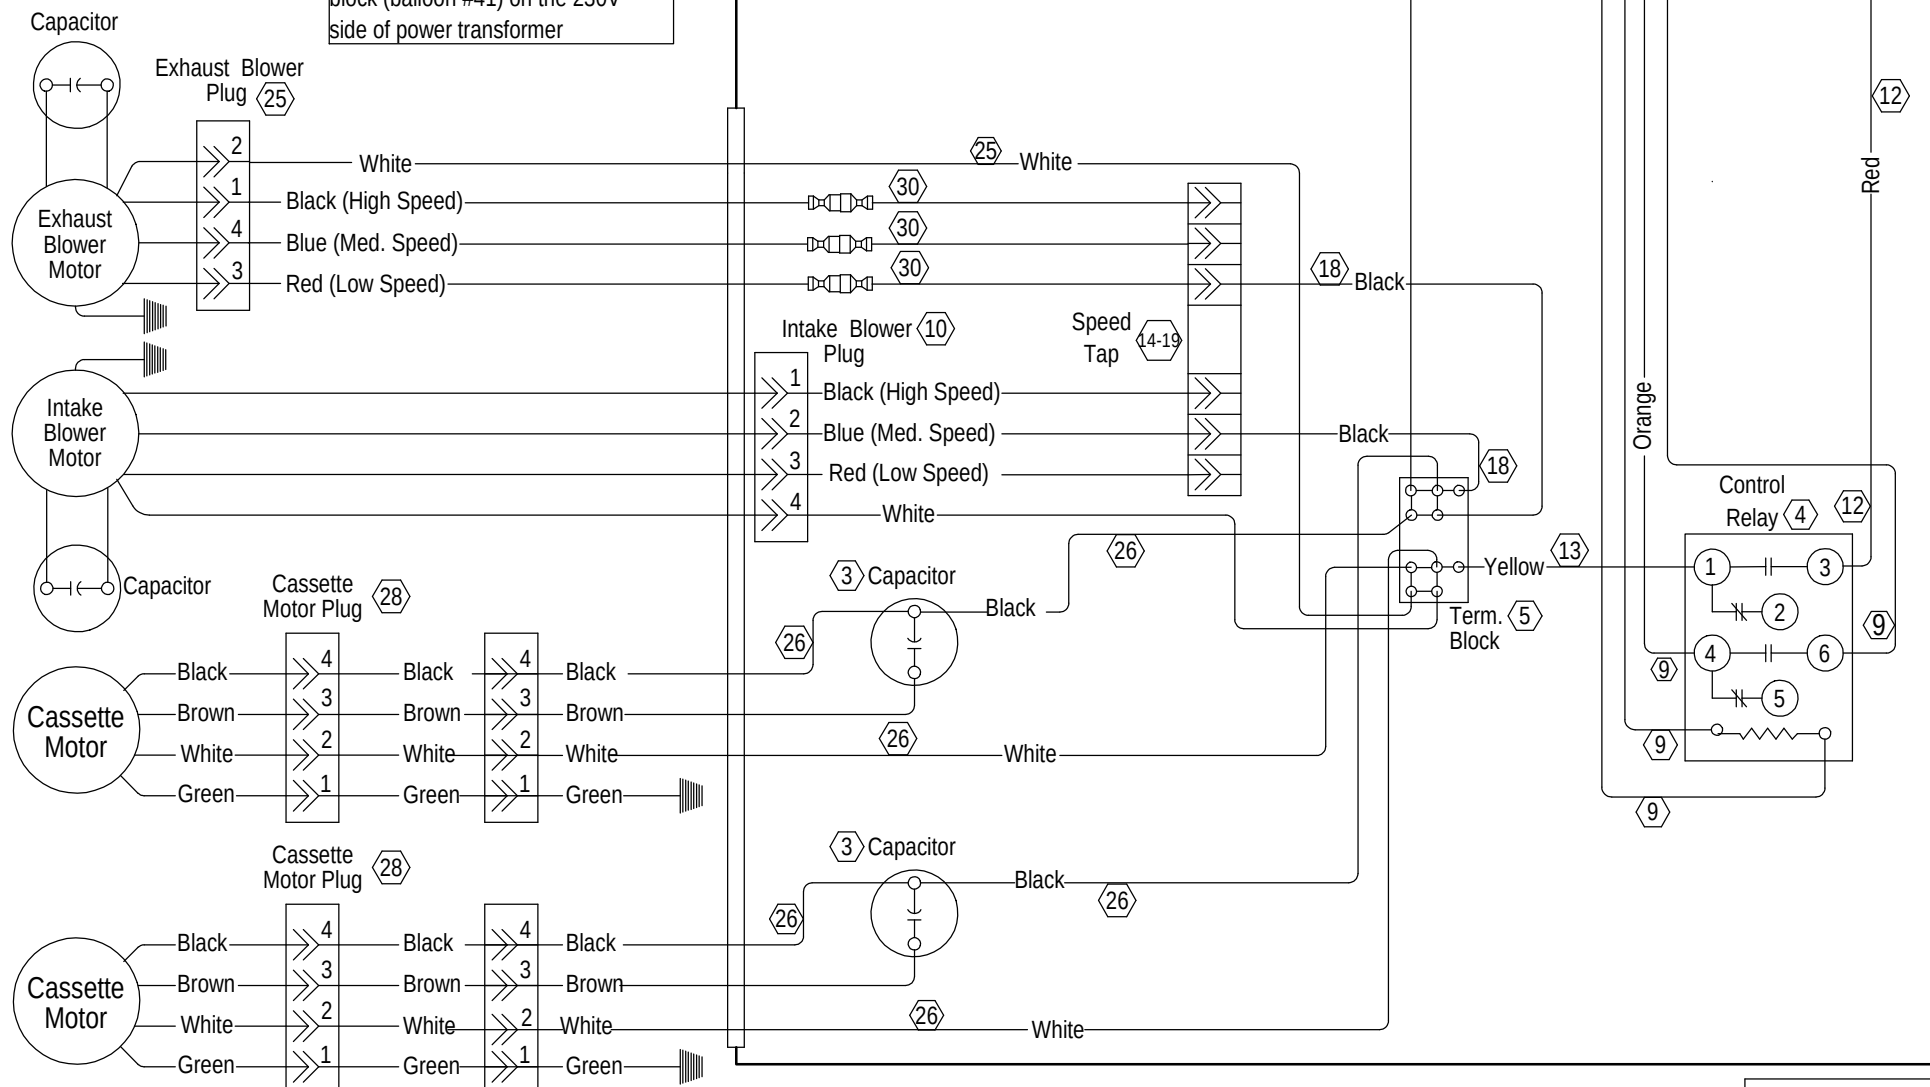

Standard Diagram

4056-272