


① THERMOSTAT T841A1761

UNIT 24V
TERMINAL BLOCK

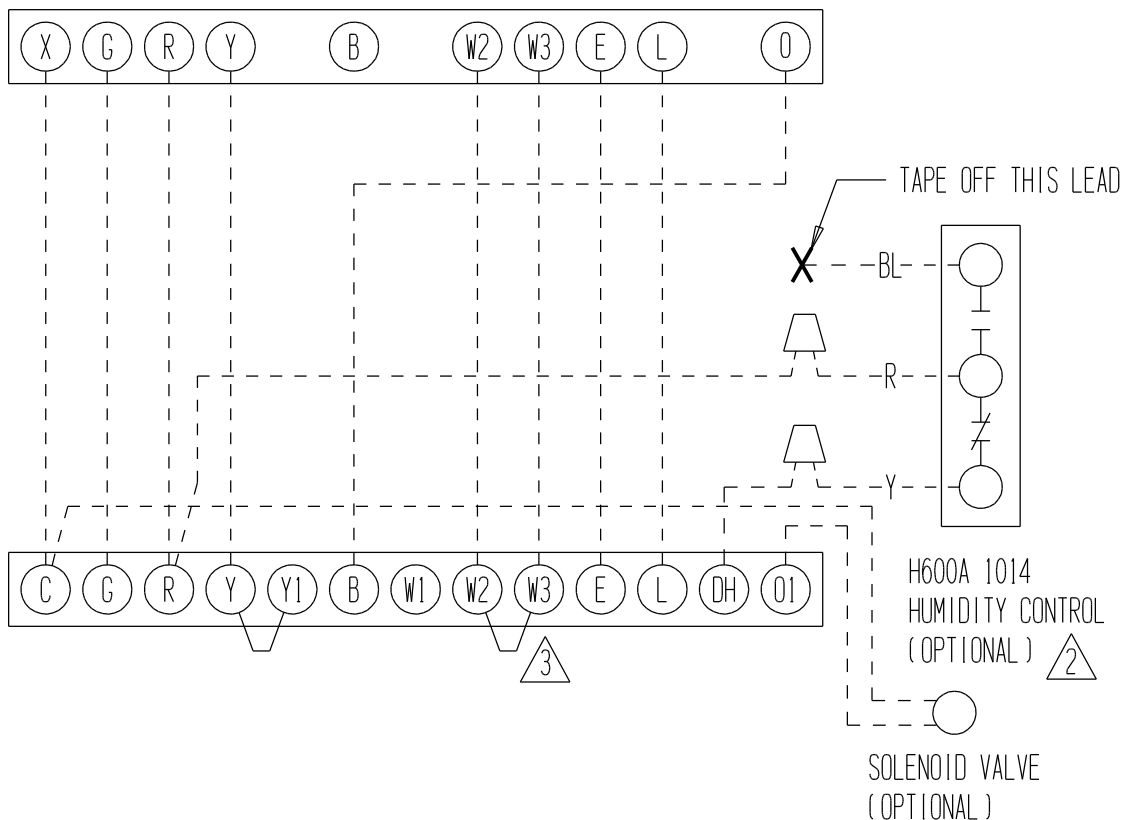

- ① SET ADJUST HEAT ANTICIPATOR AT .45A
- ② REFER TO SECTION "HUMIDITY CONTROL" FOR SET UP
- ③ REMOVE JUMPER "W2" & "W3"

	FACTORY WIRING	FIELD WIRING
LOW VOLTAGE	_____	-----
HIGH VOLTAGE	—————	-----