


QA SERIES AIR CONDITIONER CONNECTION DIAGRAM

FOR USE WITH "X" CLIMATE CONTROL OPTION

NOTE: MUST BE CONFIGURED FOR HEAT/COOL THERMOSTAT TH5220D1151 BARD P/N 8403-058

IF OPTIONAL VENT PACKAGE IS INSTALLED, THE "G" WIRE MUST BE CONNECTED TO ASSURE CONTINUOUS BLOWER DURING OCCUPIED PERIODS WHEN VENT SYSTEM IS "ON". THE "G" WIRE MUST ALSO BE CONNECTED FOR PRE-PURGE OPERATION (SEE STEP 2, FUNCTION SWITCH SETTINGS).

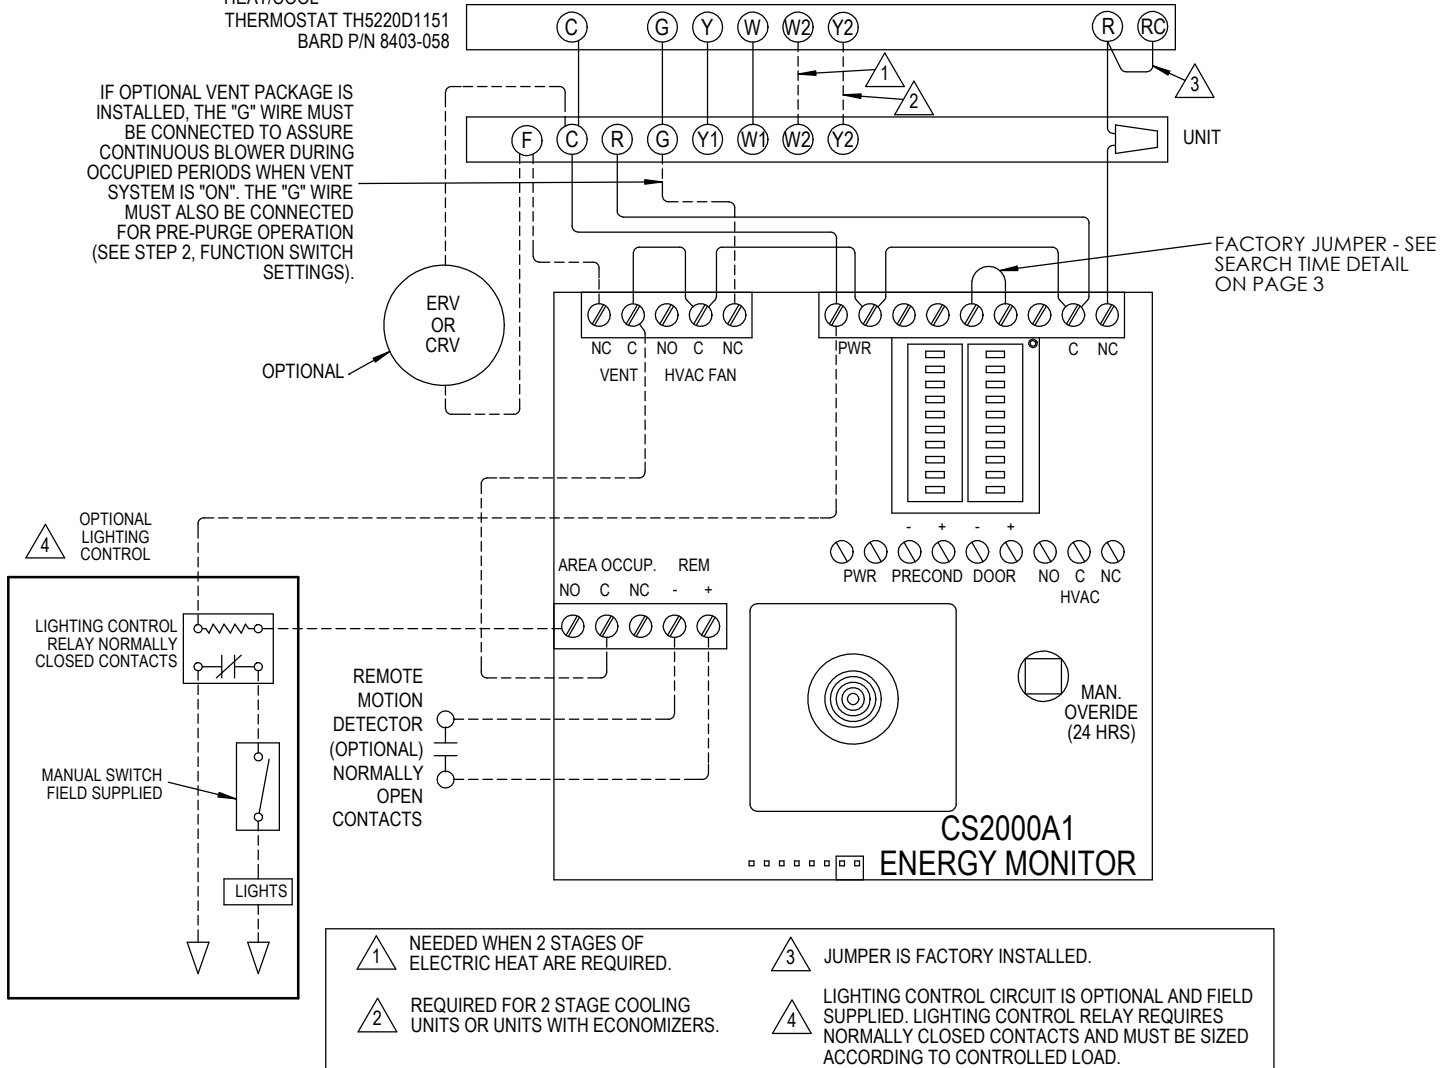

RECOMMENDED SWITCH SETTINGS SHOWN BELOW

FUNCTION SWITCHES

LEARN	
PRE P	
MODE	
RATE	
SEARCH-TIME	
N/C	
STAGE	
AUX	
DEMAND 2	
DEMAND 1	

TEMPERATURE SWITCHES

	90
	84
	81
	78
	68
	65
	62
	58
	54
	48