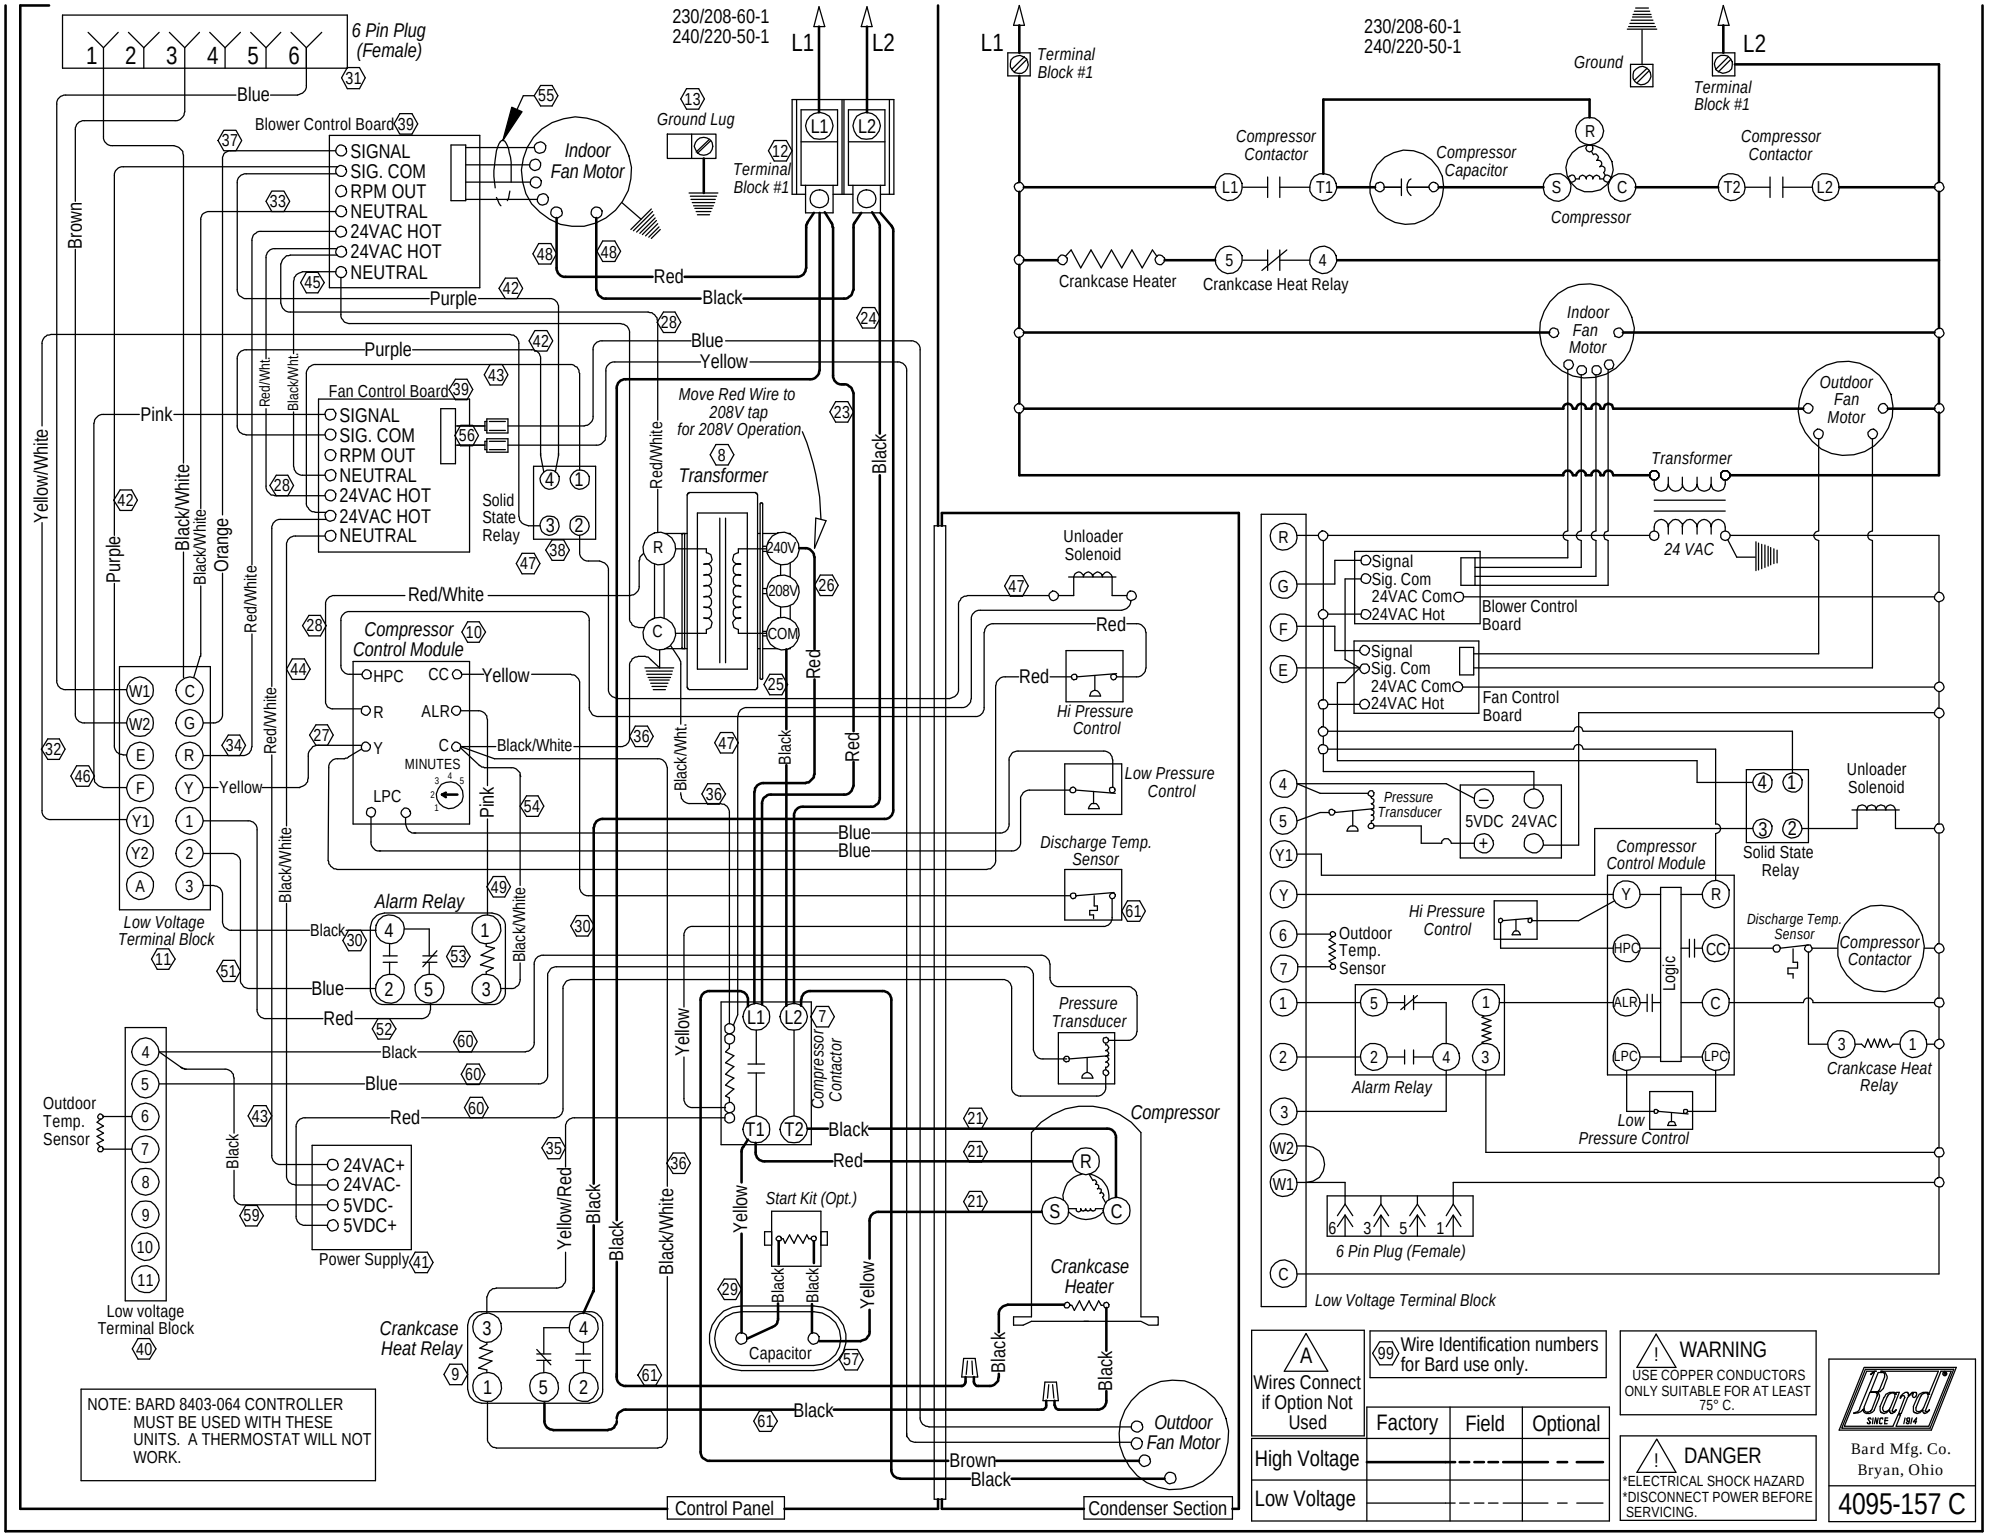

NOTE: BARD 8403-064 CONTROLLER MUST BE USED WITH THESE UNITS. A THERMOSTAT WILL NOT WORK.

	Factory	Field	Optional
High Voltage			
Low Voltage			

A Wires Connect if Option Not Used

99 Wire Identification numbers for Bard use only.

WARNING
USE COPPER CONDUCTORS ONLY SUITABLE FOR AT LEAST 75° C.

DANGER
*ELECTRICAL SHOCK HAZARD
*DISCONNECT POWER BEFORE SERVICING.

Bard SINCE 1914
Bard Mfg. Co.
Bryan, Ohio

4095-157 C