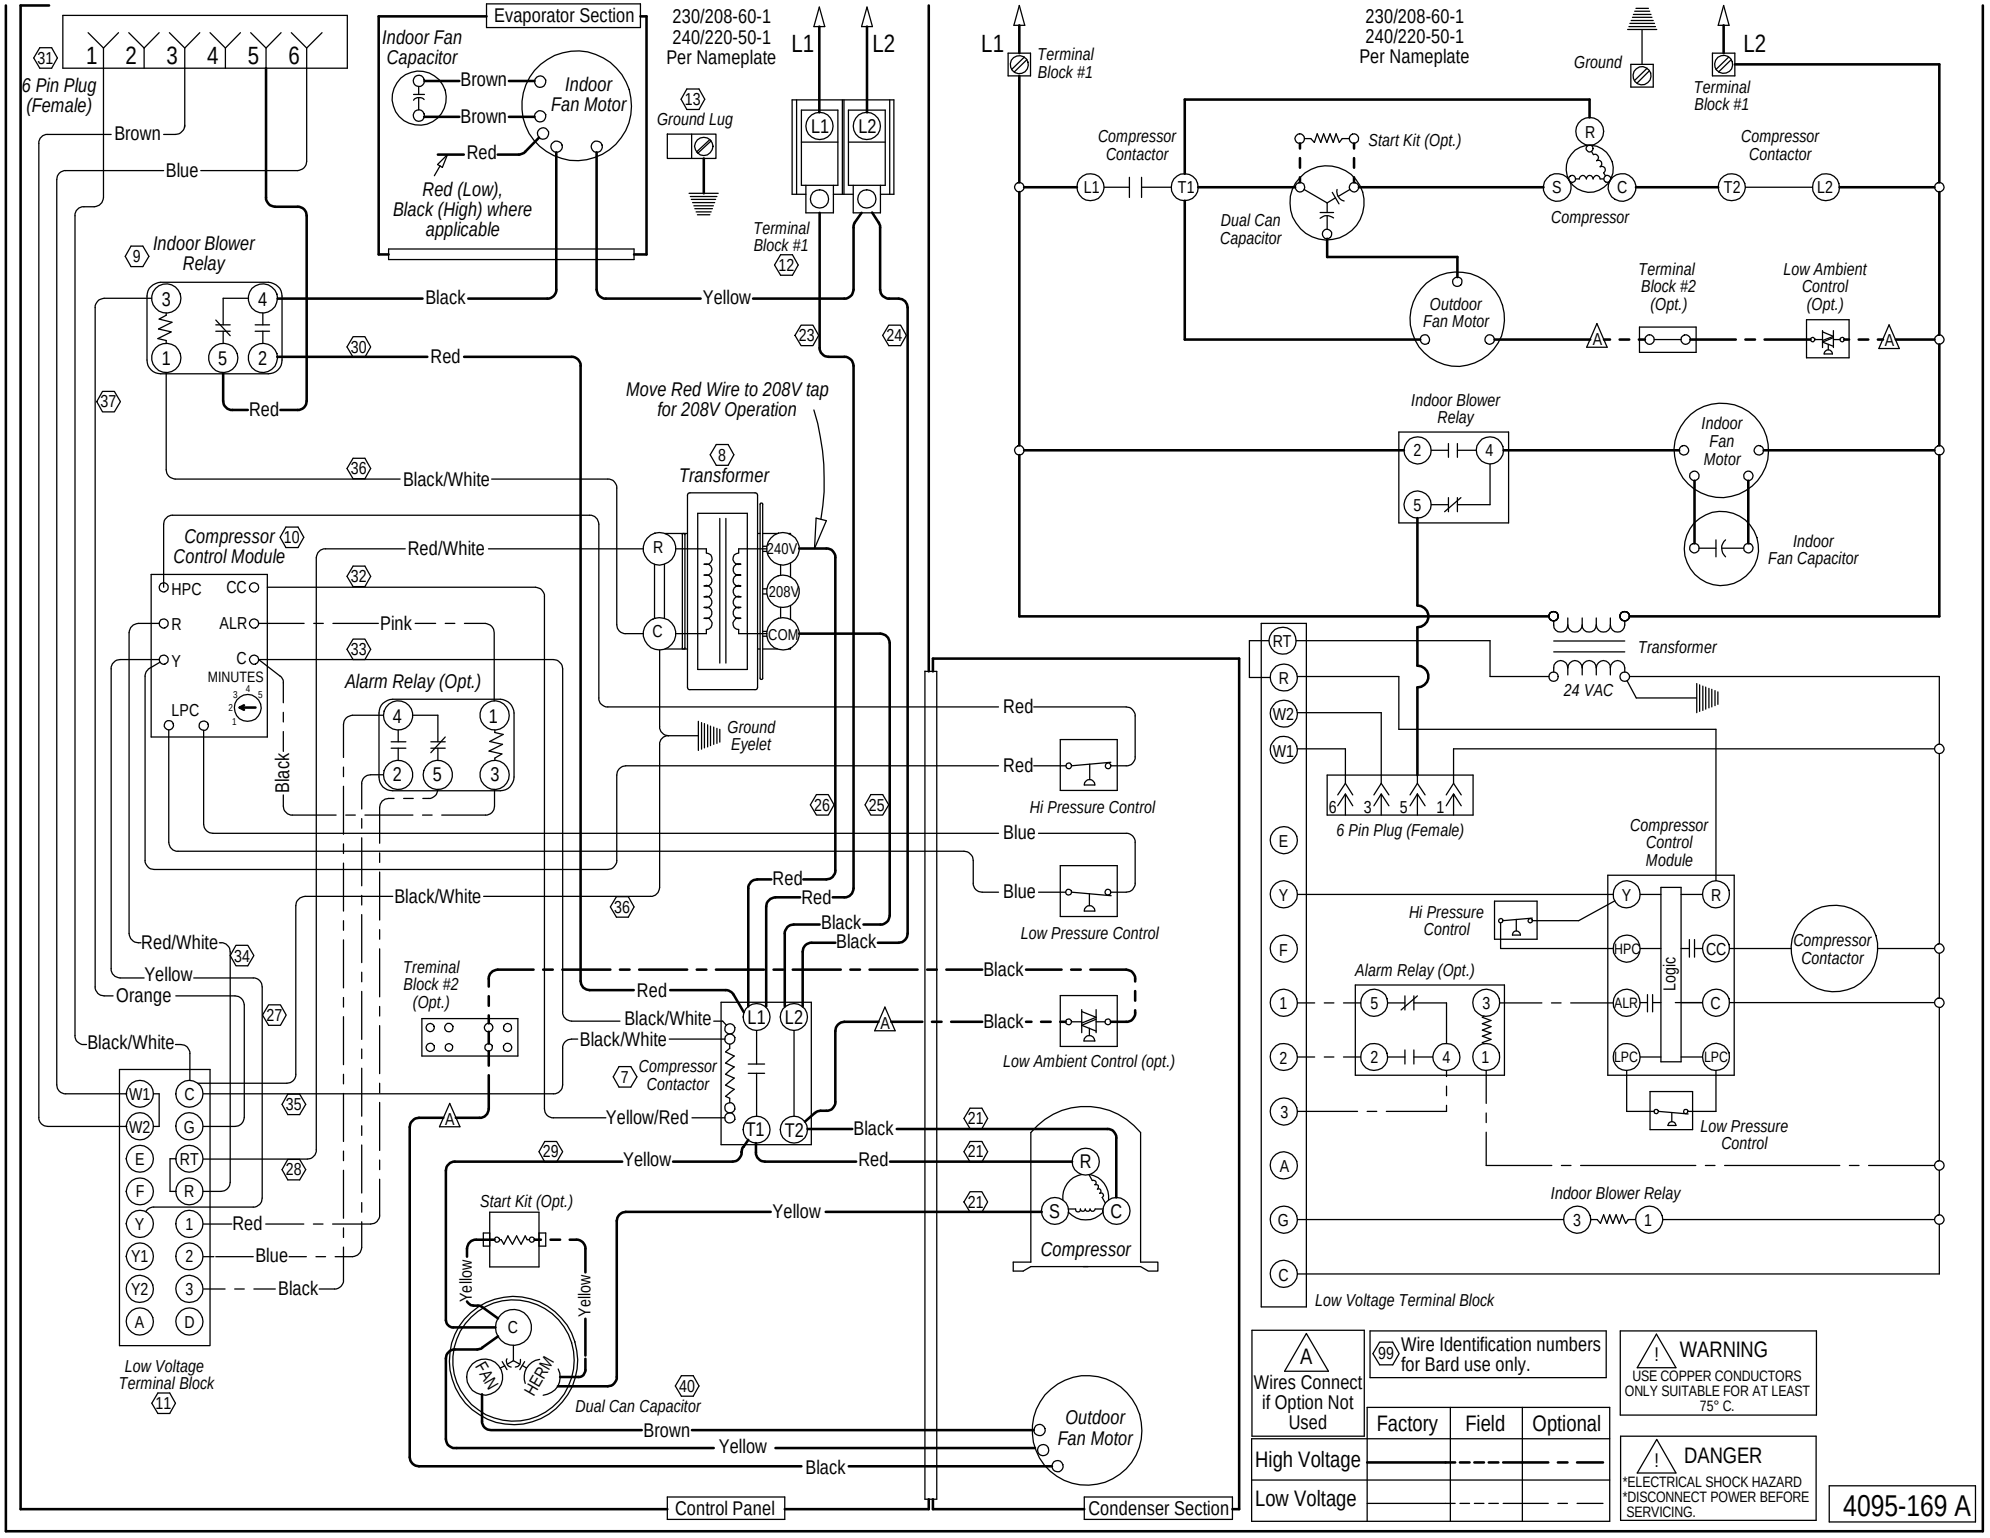
Evaporator Section
Control Panel
Condenser Section
230/208-60-1
240/220-50-1
Per Nameplate
L1
L2
Ground
Ground Lug
Terminal Block #1
Terminal Block #2 (Opt.)
6 Pin Plug (Female)
Indoor Fan Capacitor
Indoor Fan Motor
Red (Low), Black (High) where applicable
Indoor Blower Relay
Move Red Wire to 208V tap for 208V Operation
Transformer
240V
208V
COM
24 VAC
Compressor Control Module
HPC
CC
R
ALR
Y
C
MINUTES
LPC
Alarm Relay (Opt.)
Ground Eyelet
Hi Pressure Control
Low Pressure Control
Low Ambient Control (opt.)
Treminal Block #2 (Opt.)
Compressor Contactor
Start Kit (Opt.)
Dual Can Capacitor
Compressor
Outdoor Fan Motor
Low Voltage Terminal Block
Low Ambient Control (Opt.)
Indoor Fan Capacitor
Logic
Wires Connect if Option Not Used
Wire Identification numbers for Bard use only.
Factory
Field
Optional
High Voltage
Low Voltage
WARNING
USE COPPER CONDUCTORS ONLY SUITABLE FOR AT LEAST 75° C.
DANGER
*ELECTRICAL SHOCK HAZARD
*DISCONNECT POWER BEFORE SERVICING.
4095-169 A