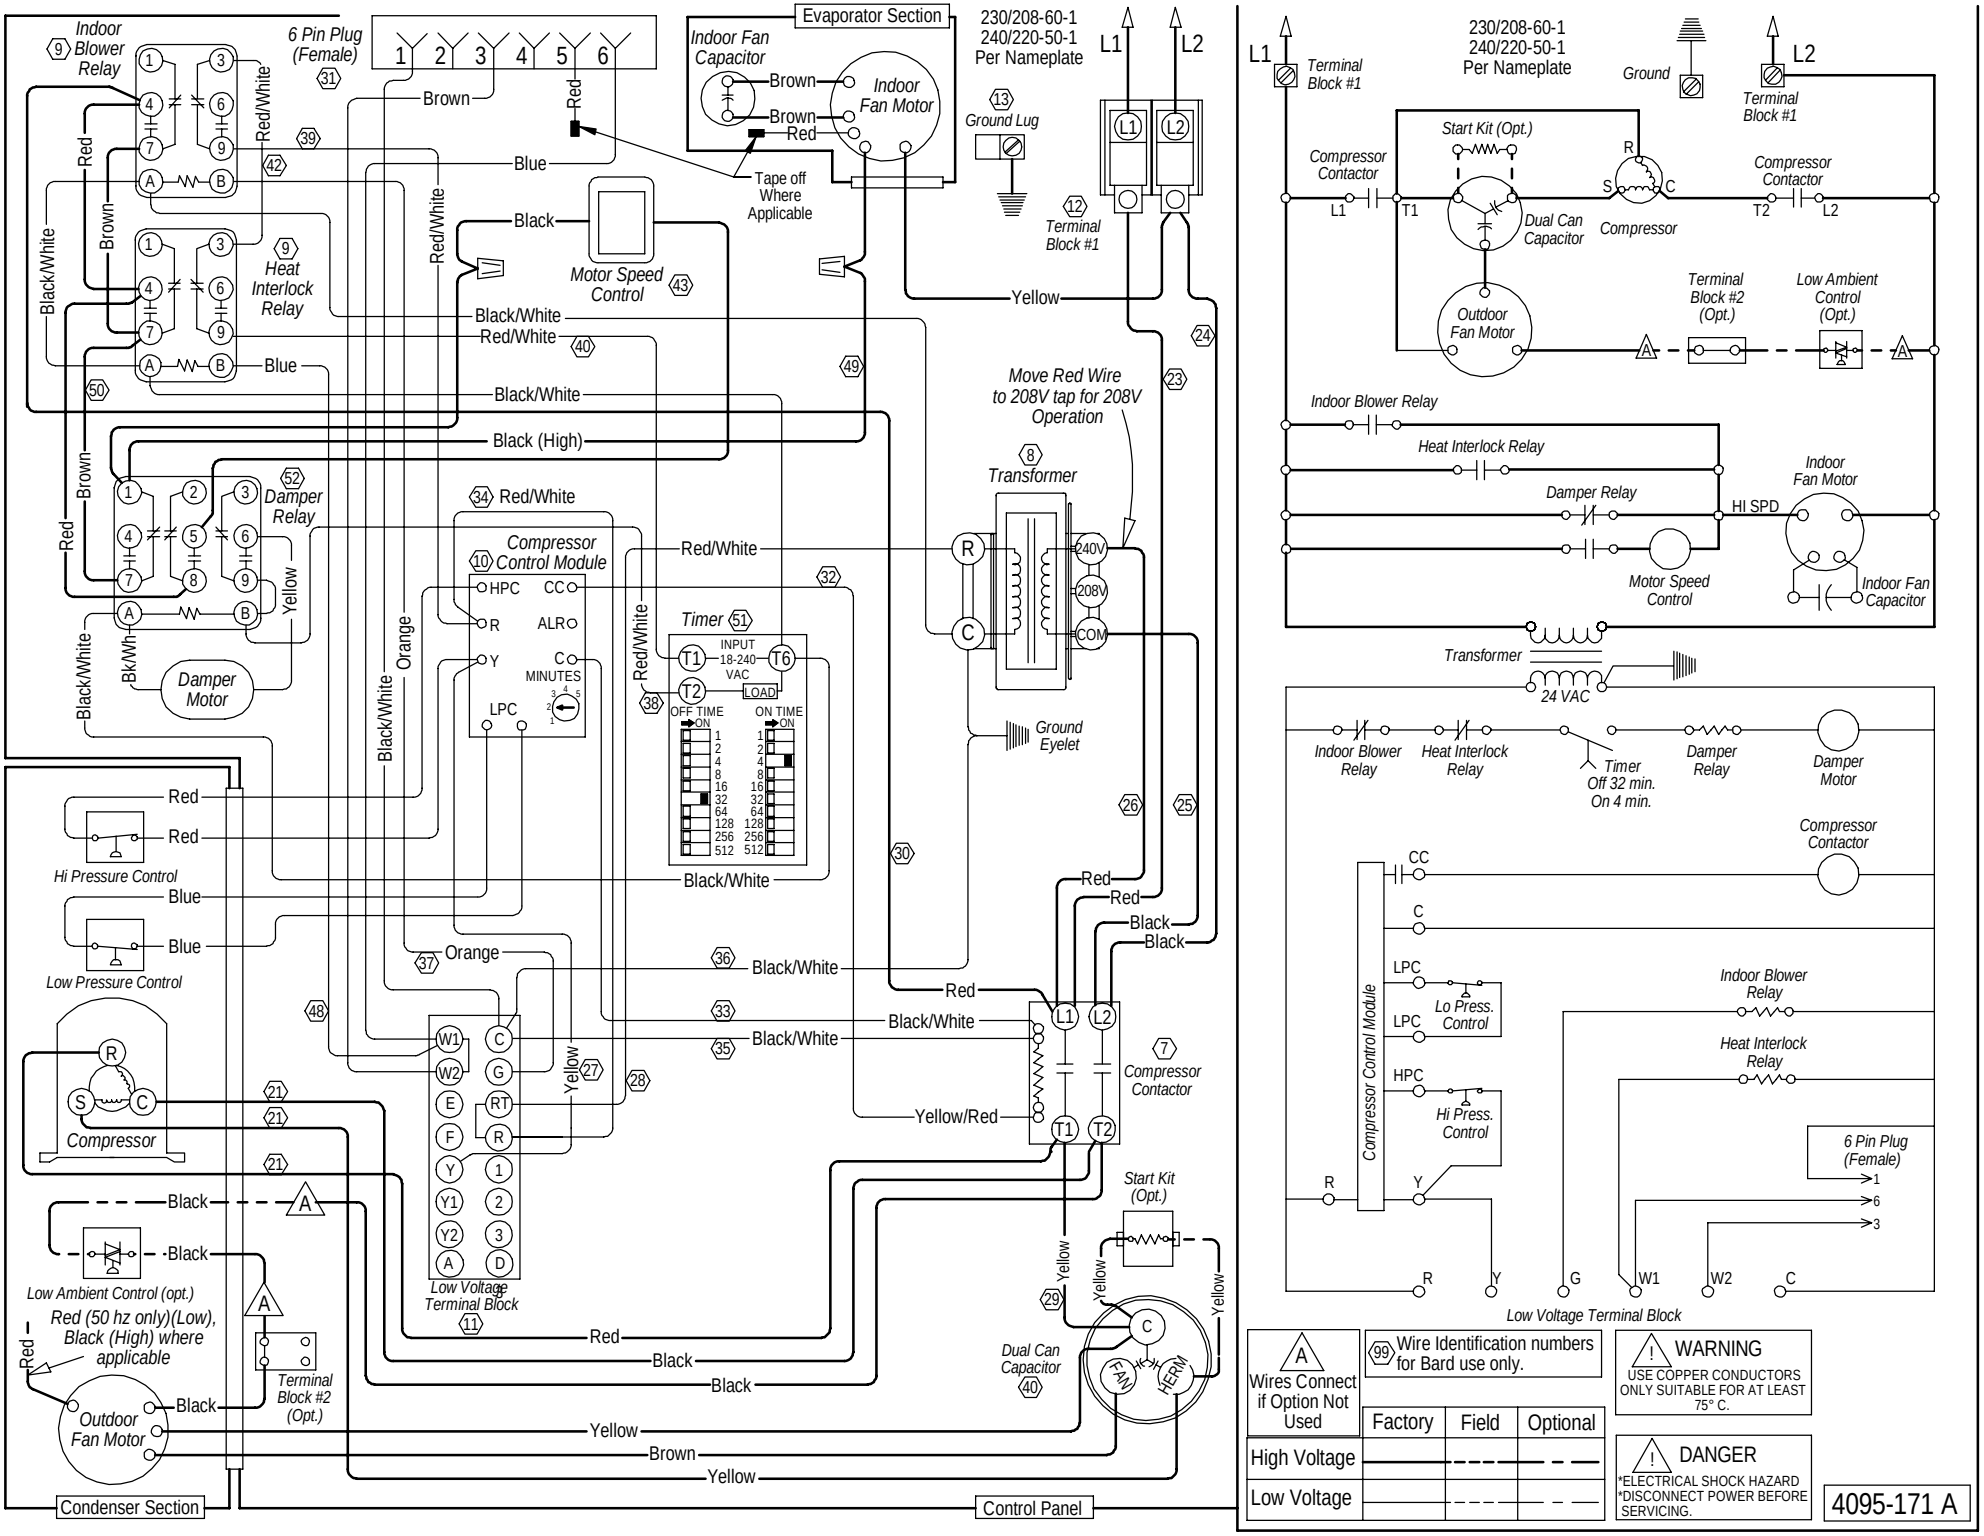
Indoor Blower Relay
6 Pin Plug (Female)
Evaporator Section
Indoor Fan Capacitor
Indoor Fan Motor
230/208-60-1
240/220-50-1
Per Nameplate
L1
L2
Ground Lug
Terminal Block #1
Tape off Where Applicable
Heat Interlock Relay
Motor Speed Control
Move Red Wire to 208V tap for 208V Operation
Transformer
240V
208V
COM
Damper Relay
Compressor Control Module
HPC
CC
R
ALR
Y
C
LPC
Timer
INPUT
18-240 VAC
LOAD
MINUTES
OFF TIME
ON TIME
Ground Eyelet
Damper Motor
Hi Pressure Control
Low Pressure Control
Compressor
Compressor Contactor
Low Voltage Terminal Block
Start Kit (Opt.)
Low Ambient Control (opt.)
Red (50 hz only)(Low), Black (High) where applicable
Terminal Block #2 (Opt.)
Outdoor Fan Motor
Dual Can Capacitor
FAN
HERM
Condenser Section
Control Panel
Ground
Compressor Contactor
Start Kit (Opt.)
Dual Can Capacitor
Compressor
Terminal Block #2 (Opt.)
Low Ambient Control (Opt.)
Outdoor Fan Motor
Indoor Blower Relay
Heat Interlock Relay
Damper Relay
HI SPD
Indoor Fan Motor
Motor Speed Control
Indoor Fan Capacitor
Transformer
24 VAC
Timer Off 32 min. On 4 min.
Damper Motor
Lo Press. Control
Hi Press. Control
6 Pin Plug (Female)
Low Voltage Terminal Block
A Wires Connect if Option Not Used
99 Wire Identification numbers for Bard use only.
WARNING
USE COPPER CONDUCTORS ONLY SUITABLE FOR AT LEAST 75° C.
DANGER
*ELECTRICAL SHOCK HAZARD
*DISCONNECT POWER BEFORE SERVICING.
Factory
Field
Optional
High Voltage
Low Voltage
4095-171 A