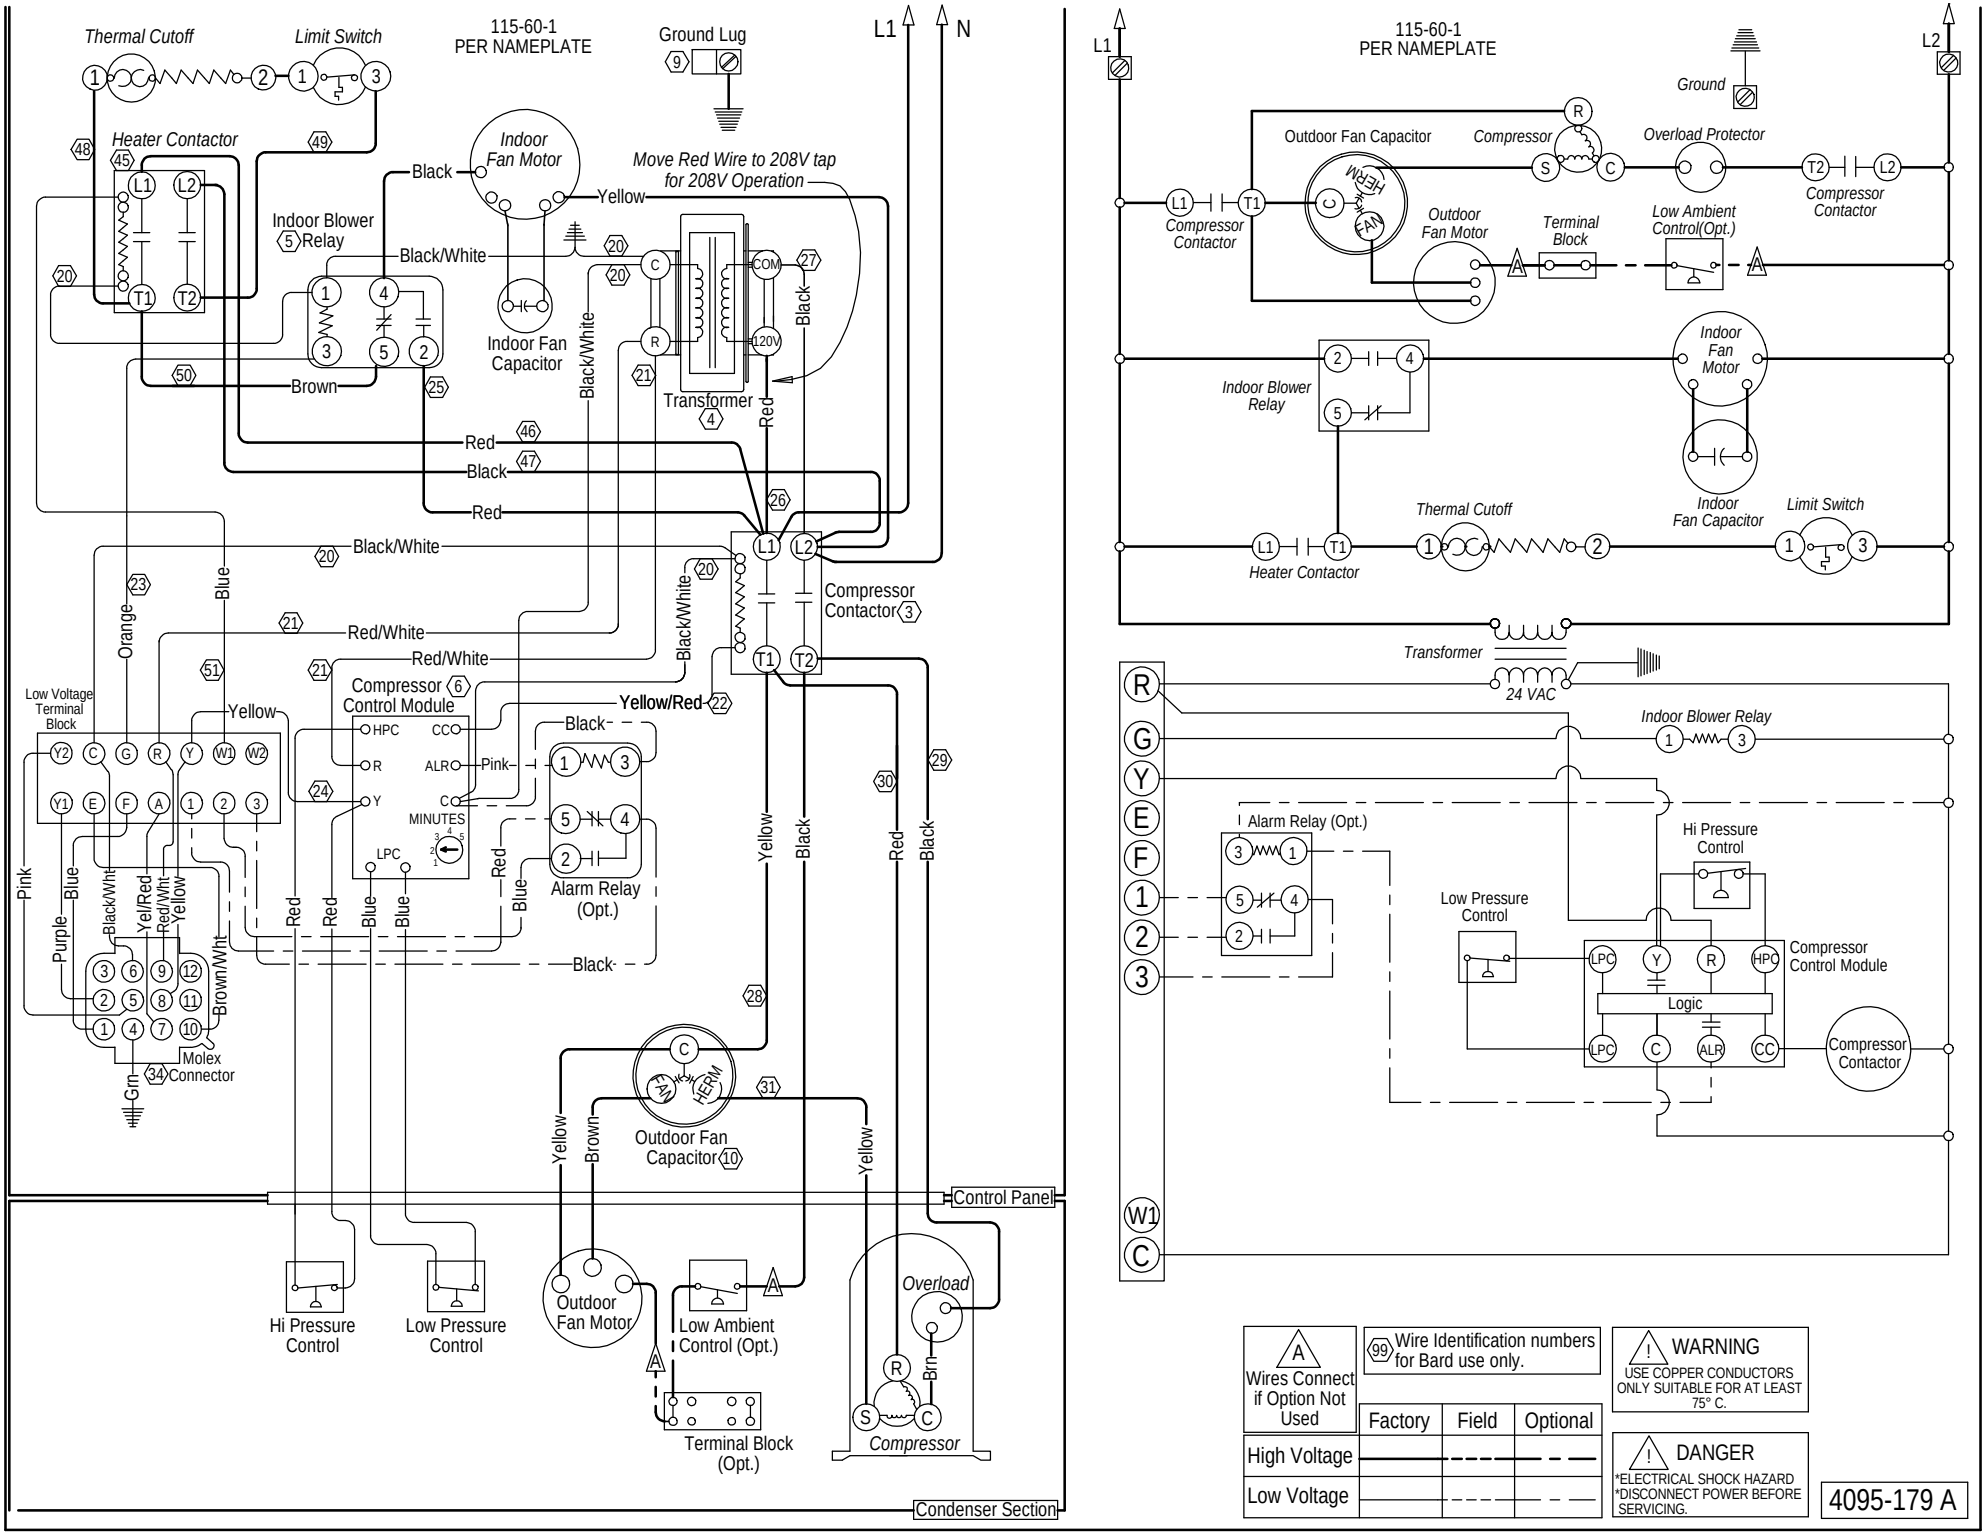
Thermal Cutoff
Limit Switch
115-60-1
PER NAMEPLATE
Ground Lug
L1
N
Heater Contactor
Indoor Fan Motor
Move Red Wire to 208V tap for 208V Operation
Indoor Blower Relay
Indoor Fan Capacitor
Transformer
Compressor Contactor
Compressor Control Module
Low Voltage Terminal Block
Alarm Relay (Opt.)
Molex Connector
Outdoor Fan Capacitor
Hi Pressure Control
Low Pressure Control
Outdoor Fan Motor
Low Ambient Control (Opt.)
Terminal Block (Opt.)
Overload
Compressor
Control Panel
Condenser Section
Outdoor Fan Capacitor
Compressor
Overload Protector
Compressor Contactor
Outdoor Fan Motor
Terminal Block
Low Ambient Control(Opt.)
Ground
L2
Indoor Fan Motor
Thermal Cutoff
Limit Switch
Heater Contactor
Transformer
24 VAC
Indoor Blower Relay
Alarm Relay (Opt.)
Hi Pressure Control
Low Pressure Control
Compressor Control Module
Logic
Compressor Contactor
A Wires Connect if Option Not Used
99 Wire Identification numbers for Bard use only.
Factory
Field
Optional
High Voltage
Low Voltage
WARNING
USE COPPER CONDUCTORS ONLY SUITABLE FOR AT LEAST 75° C.
DANGER
*ELECTRICAL SHOCK HAZARD
*DISCONNECT POWER BEFORE SERVICING.
4095-179 A