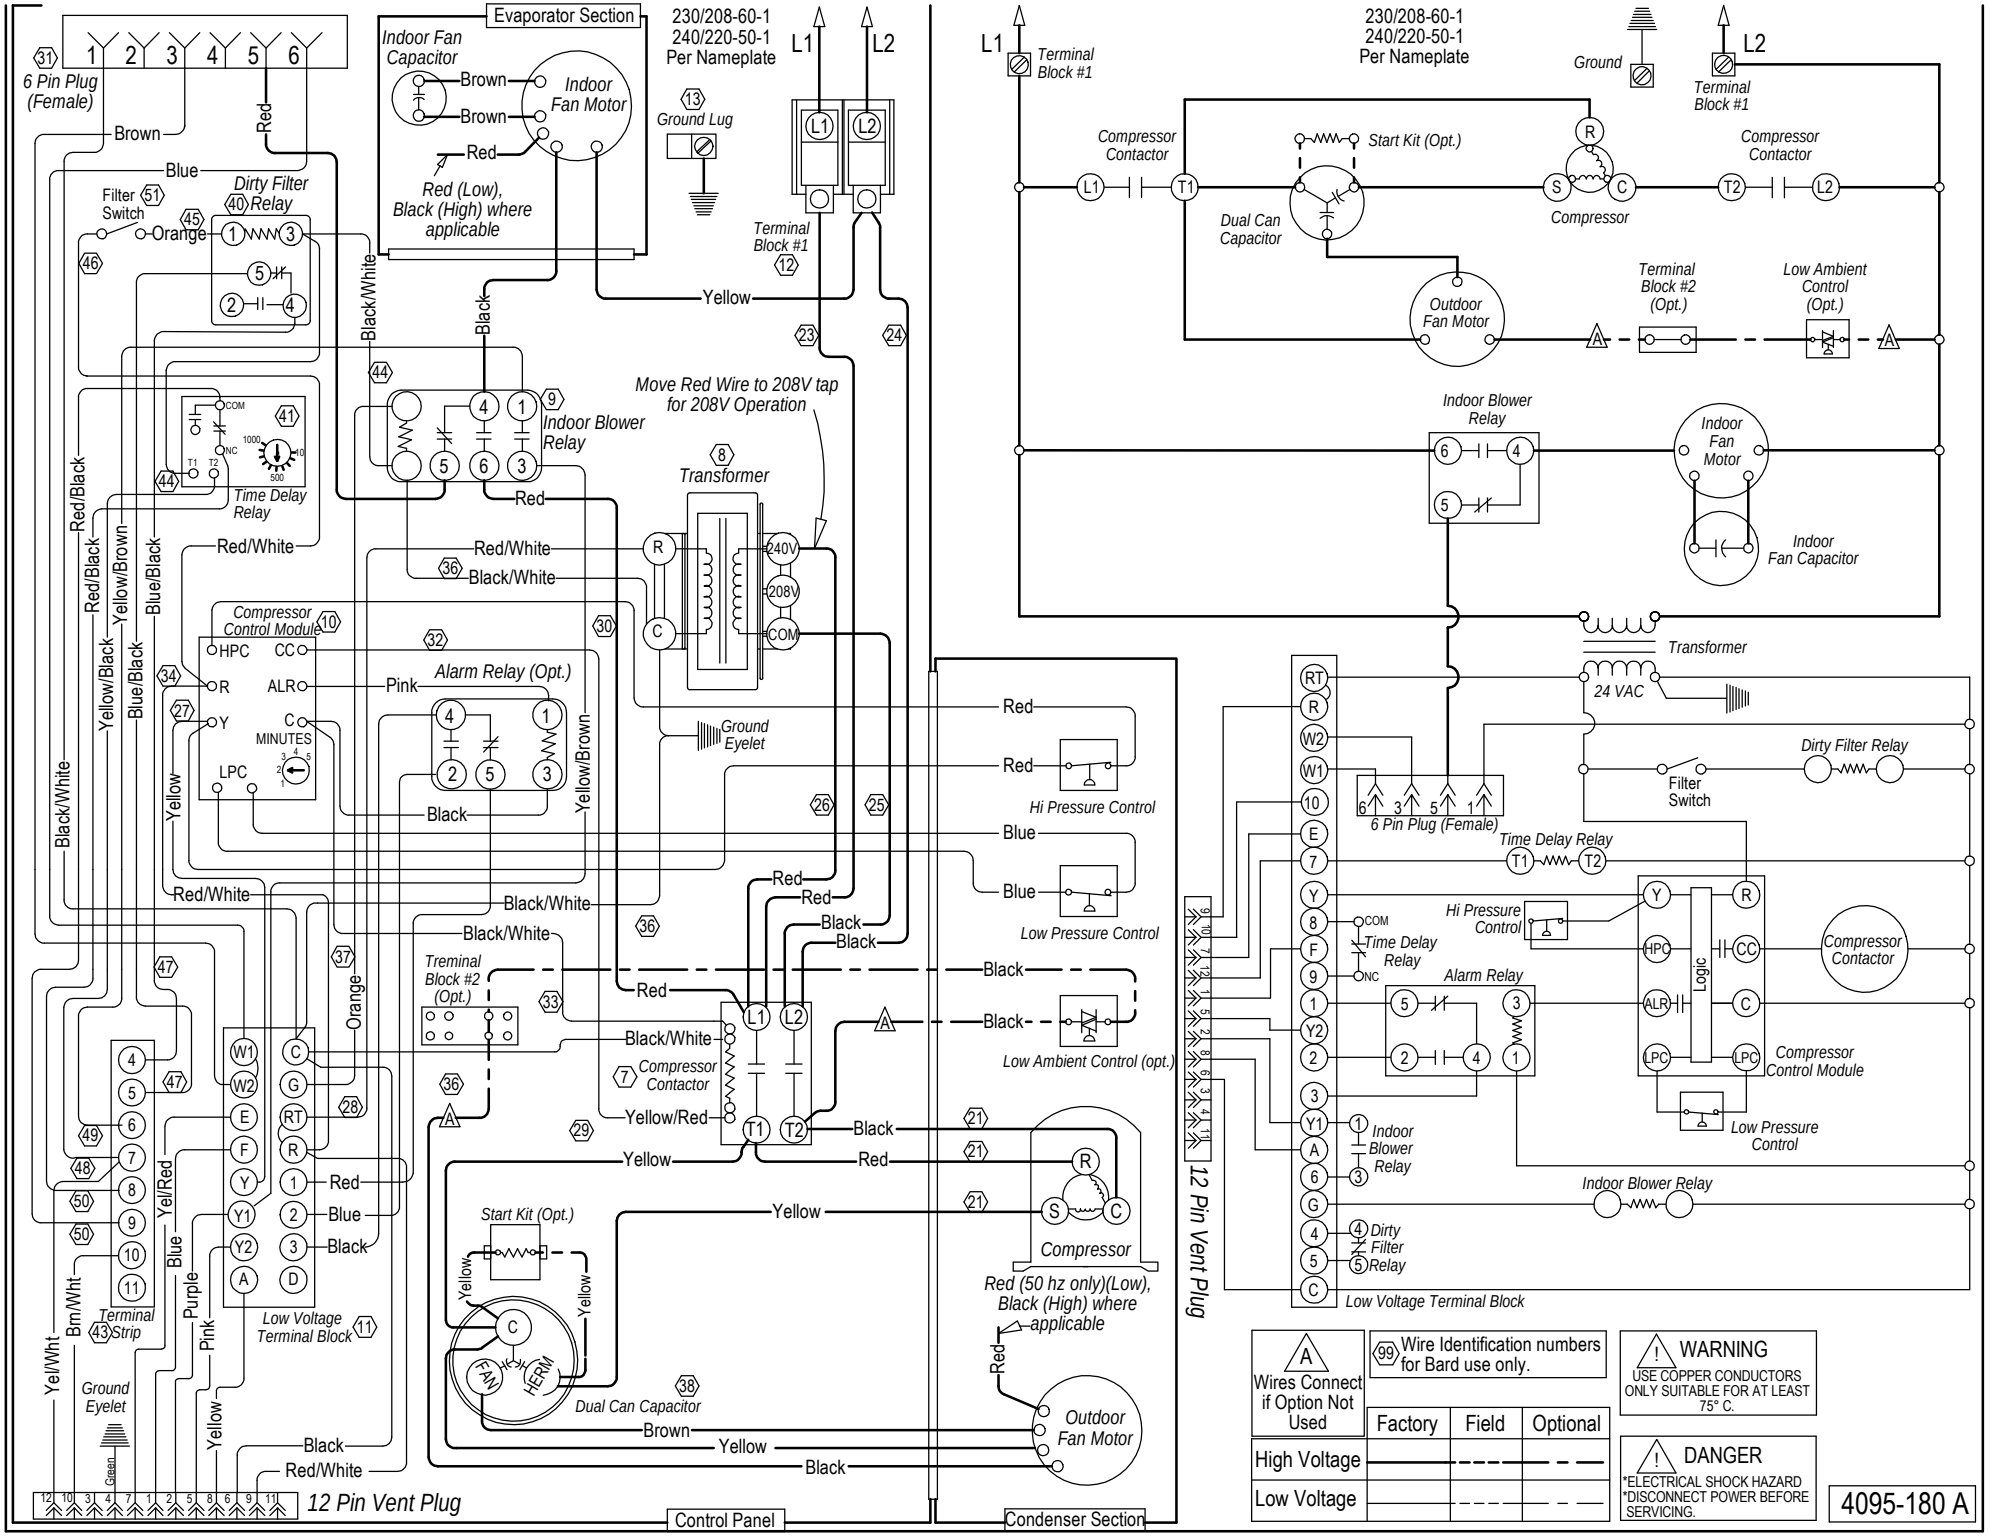

Evaporator Section
Control Panel
Condenser Section
230/208-60-1
240/220-50-1
Per Nameplate
L1
L2
Terminal Block #1
Ground
Ground Lug
6 Pin Plug (Female)
Indoor Fan Capacitor
Indoor Fan Motor
Red (Low), Black (High) where applicable
Dirty Filter Relay
Filter Switch
Orange
Brown
Blue
Yellow
Black
Black/White
Red
Red/White
Red/Black
Yellow/Black
Yellow/Brown
Blue/Black
Indoor Blower Relay
Move Red Wire to 208V tap for 208V Operation
Transformer
240V
208V
COM
Time Delay Relay
Compressor Control Module
HPC
CC
R
ALR
C
Y
MINUTES
LPC
Alarm Relay (Opt.)
Pink
Ground Eyelet
Hi Pressure Control
Low Pressure Control
Low Ambient Control (opt.)
Treminal Block #2 (Opt.)
Compressor Contactor
Yellow/Red
Start Kit (Opt.)
Dual Can Capacitor
Compressor
Red (50 hz only)(Low), Black (High) where applicable
Outdoor Fan Motor
Terminal Strip
Low Voltage Terminal Block
12 Pin Vent Plug
Yel/Wht
Brn/Wht
Purple
Pink
Yel/Red
Green
Compressor Contactor
Start Kit (Opt.)
Dual Can Capacitor
Compressor
Terminal Block #2 (Opt.)
Low Ambient Control
Indoor Blower Relay
Indoor Fan Motor
Indoor Fan Capacitor
Transformer
24 VAC
Dirty Filter Relay
Filter Switch
6 Pin Plug (Female)
Time Delay Relay
Hi Pressure Control
Alarm Relay
Logic
Compressor Contactor
Compressor Control Module
Low Pressure Control
Indoor Blower Relay
Dirty Filter Relay
Low Voltage Terminal Block
12 Pin Vent Plug
A Wires Connect if Option Not Used
99 Wire Identification numbers for Bard use only.
Factory
Field
Optional
High Voltage
Low Voltage
WARNING
USE COPPER CONDUCTORS ONLY SUITABLE FOR AT LEAST 75° C.
DANGER
*ELECTRICAL SHOCK HAZARD
*DISCONNECT POWER BEFORE SERVICING.
4095-180 A