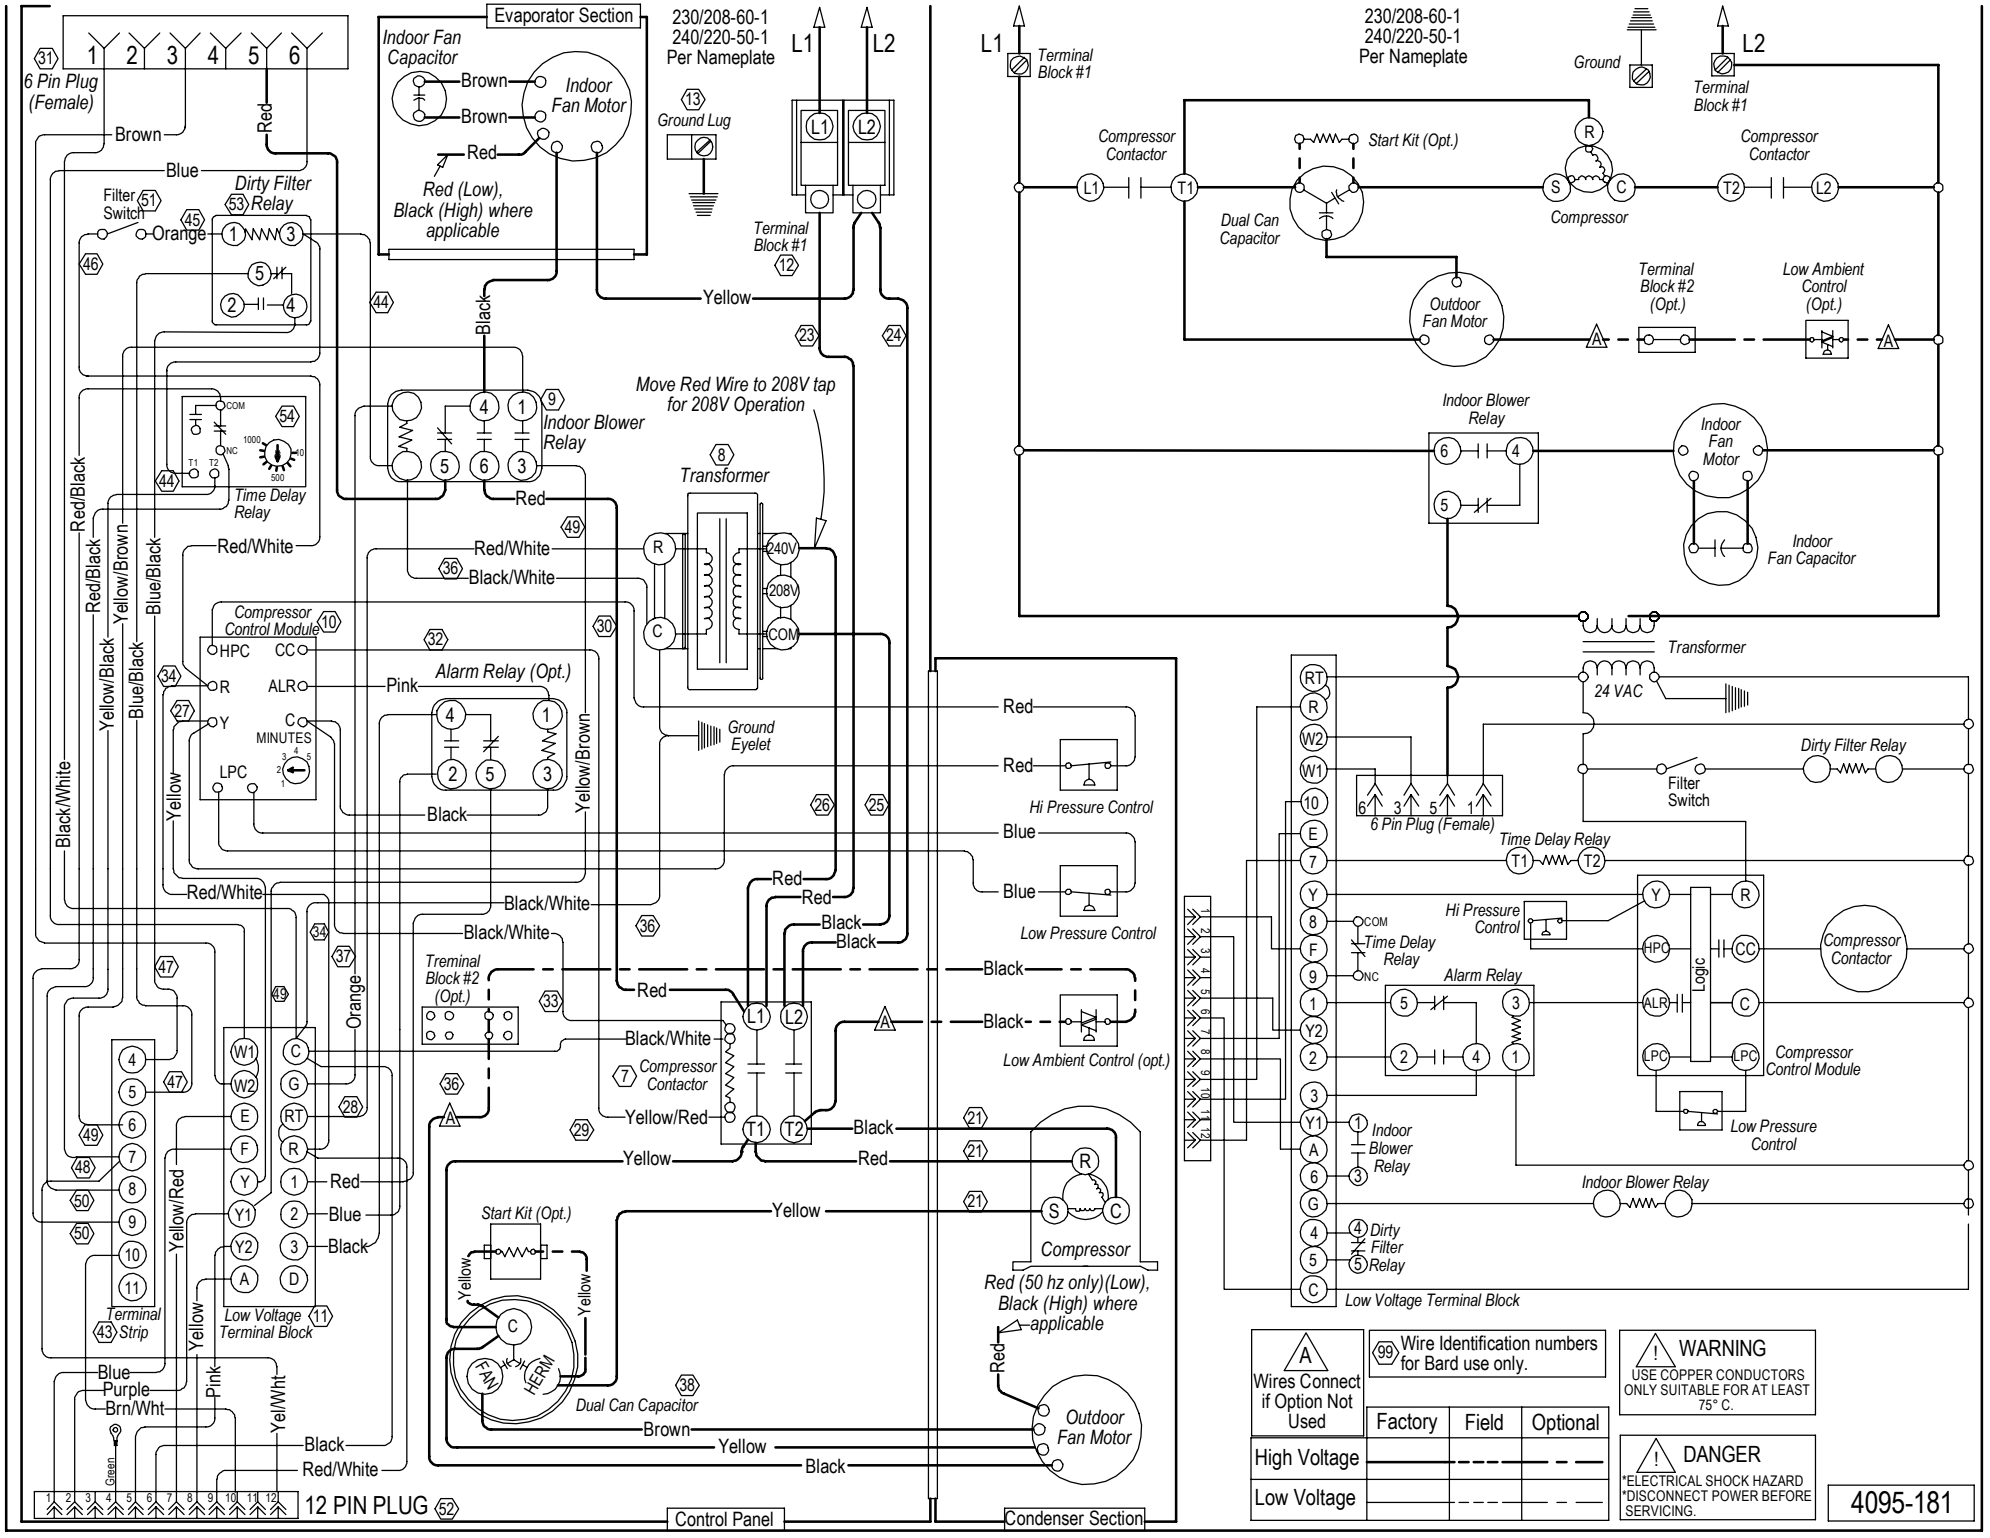
Evaporator Section
Control Panel
Condenser Section
230/208-60-1
240/220-50-1
Per Nameplate
6 Pin Plug (Female)
Indoor Fan Capacitor
Indoor Fan Motor
Red (Low), Black (High) where applicable
Ground Lug
Terminal Block #1
Filter Switch
Dirty Filter Relay
Time Delay Relay
Indoor Blower Relay
Move Red Wire to 208V tap for 208V Operation
Transformer
Compressor Control Module
Alarm Relay (Opt.)
Ground Eyelet
Hi Pressure Control
Low Pressure Control
Low Ambient Control (opt.)
Terminal Block #2 (Opt.)
Compressor Contactor
Start Kit (Opt.)
Dual Can Capacitor
Compressor
Outdoor Fan Motor
Terminal Strip
Low Voltage Terminal Block
12 PIN PLUG
Ground
Terminal Block #1
Compressor Contactor
Start Kit (Opt.)
Dual Can Capacitor
Compressor
Outdoor Fan Motor
Terminal Block #2 (Opt.)
Low Ambient Control (Opt.)
Indoor Blower Relay
Indoor Fan Motor
Indoor Fan Capacitor
Transformer
24 VAC
Dirty Filter Relay
Filter Switch
6 Pin Plug (Female)
Time Delay Relay
Hi Pressure Control
Time Delay Relay
Alarm Relay
Logic
Compressor Contactor
Compressor Control Module
Low Pressure Control
Indoor Blower Relay
Indoor Blower Relay
Dirty Filter Relay
Low Voltage Terminal Block
A Wires Connect if Option Not Used
99 Wire Identification numbers for Bard use only.
Factory
Field
Optional
High Voltage
Low Voltage
WARNING
USE COPPER CONDUCTORS ONLY SUITABLE FOR AT LEAST 75° C.
DANGER
*ELECTRICAL SHOCK HAZARD
*DISCONNECT POWER BEFORE SERVICING.
4095-181