


230/208-60-1
Per Nameplate L1 L2

For Unit Ladder Diagram, Vent Wiring, or controller/thermostat connections, see installation instructions or go to www.bardhvac.com

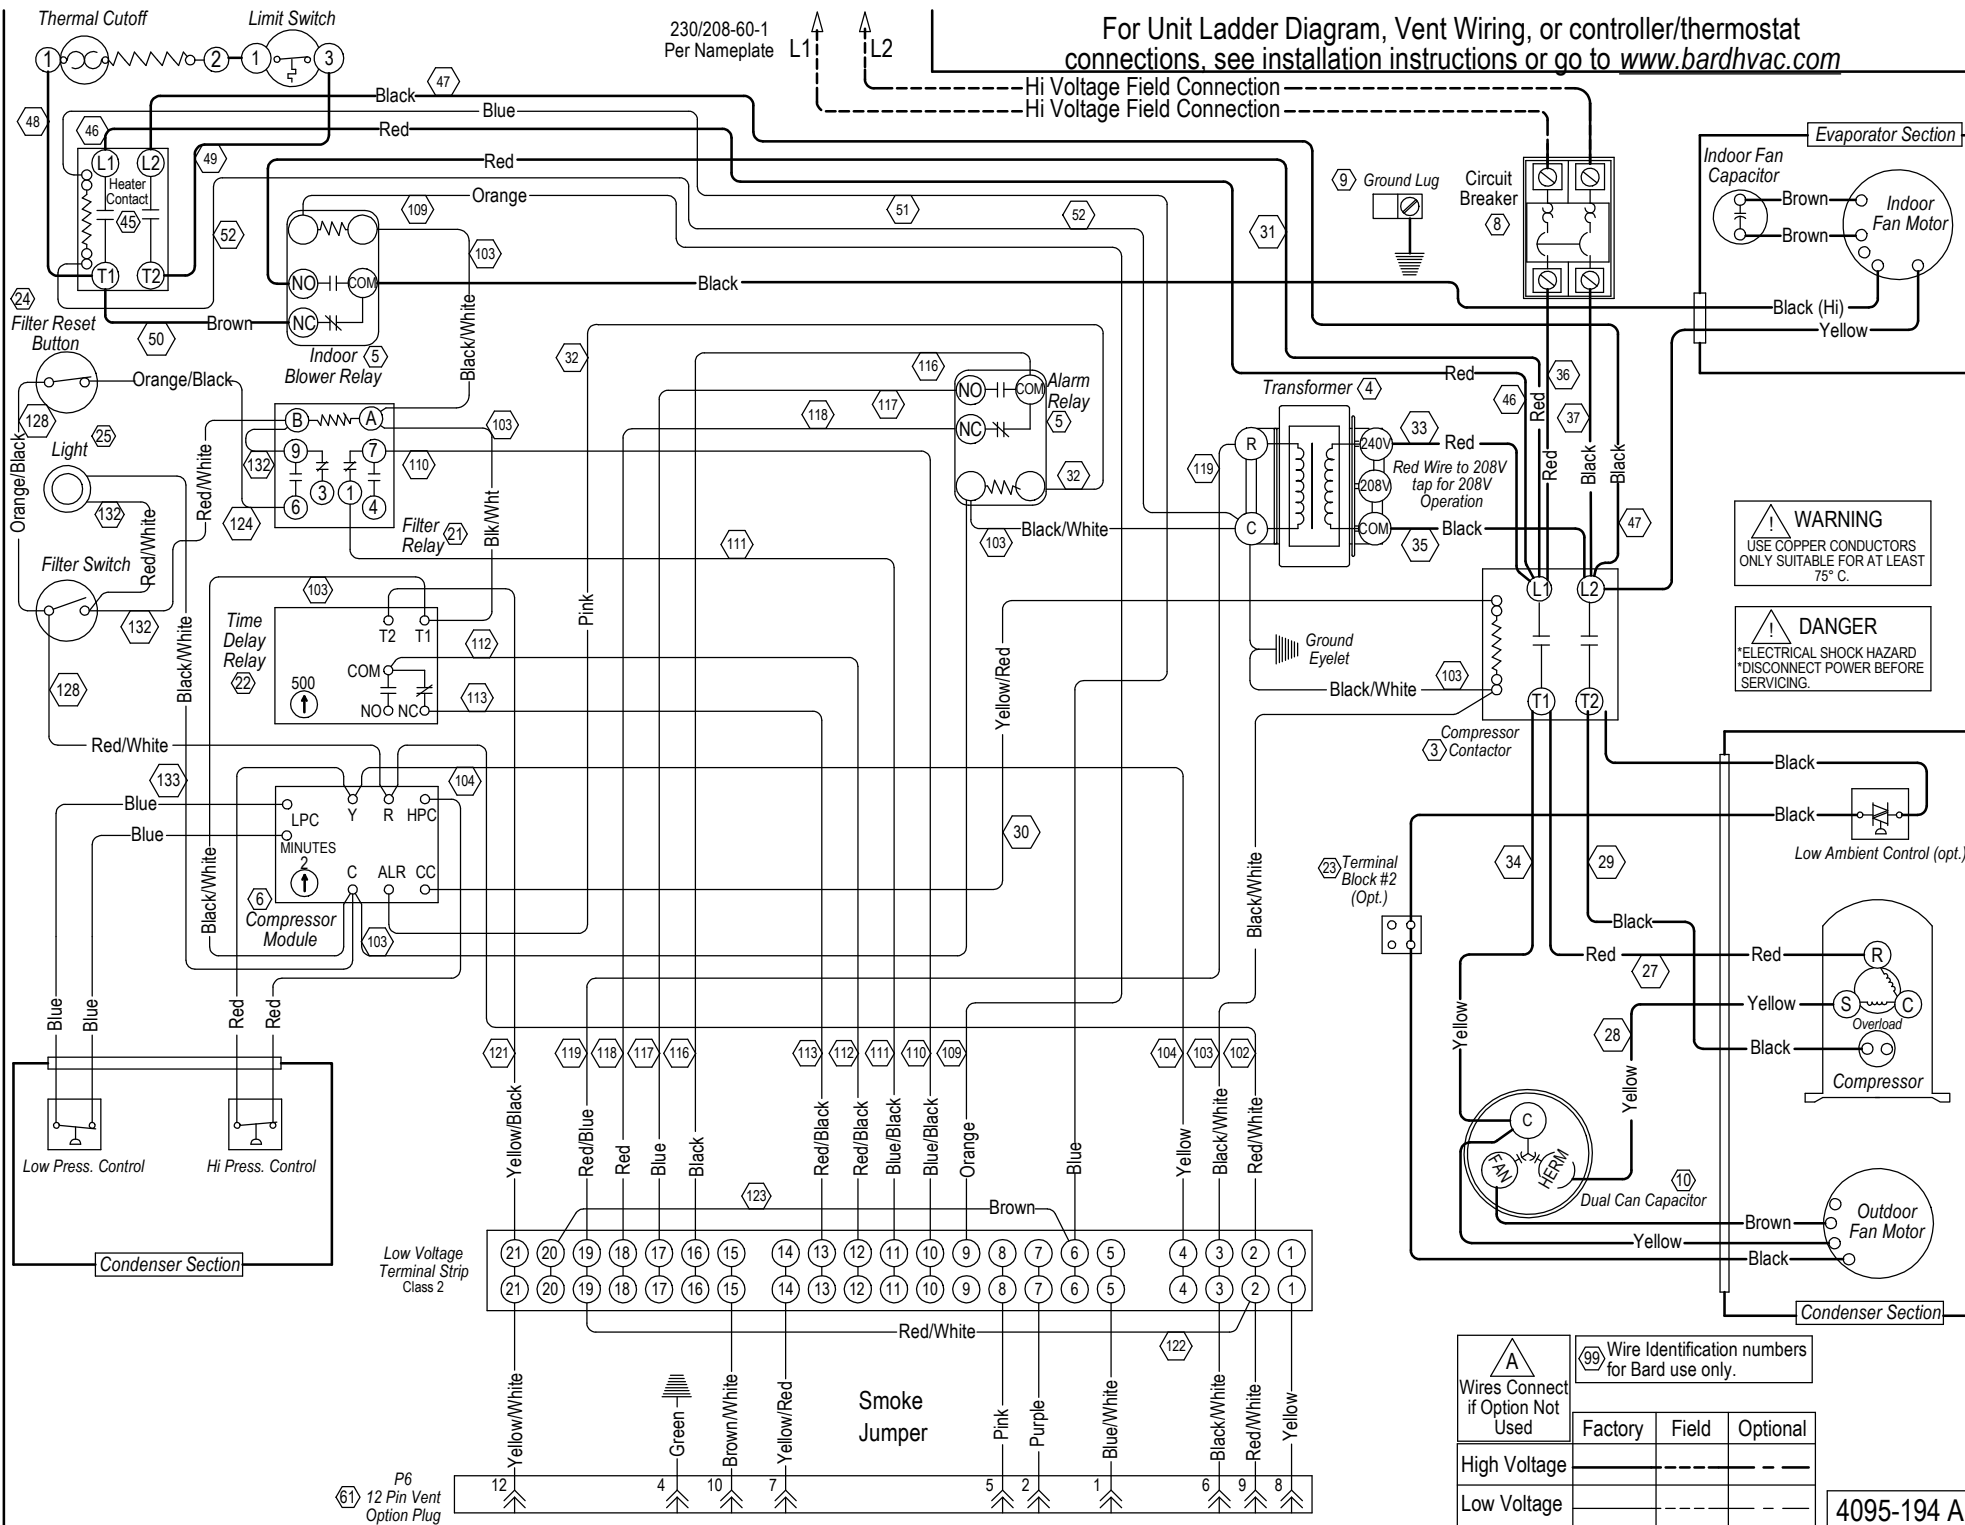

Wires Connect if Option Not Used	Wire Identification numbers for Bard use only.		
	Factory	Field	Optional
High Voltage			
Low Voltage			

4095-194 A