



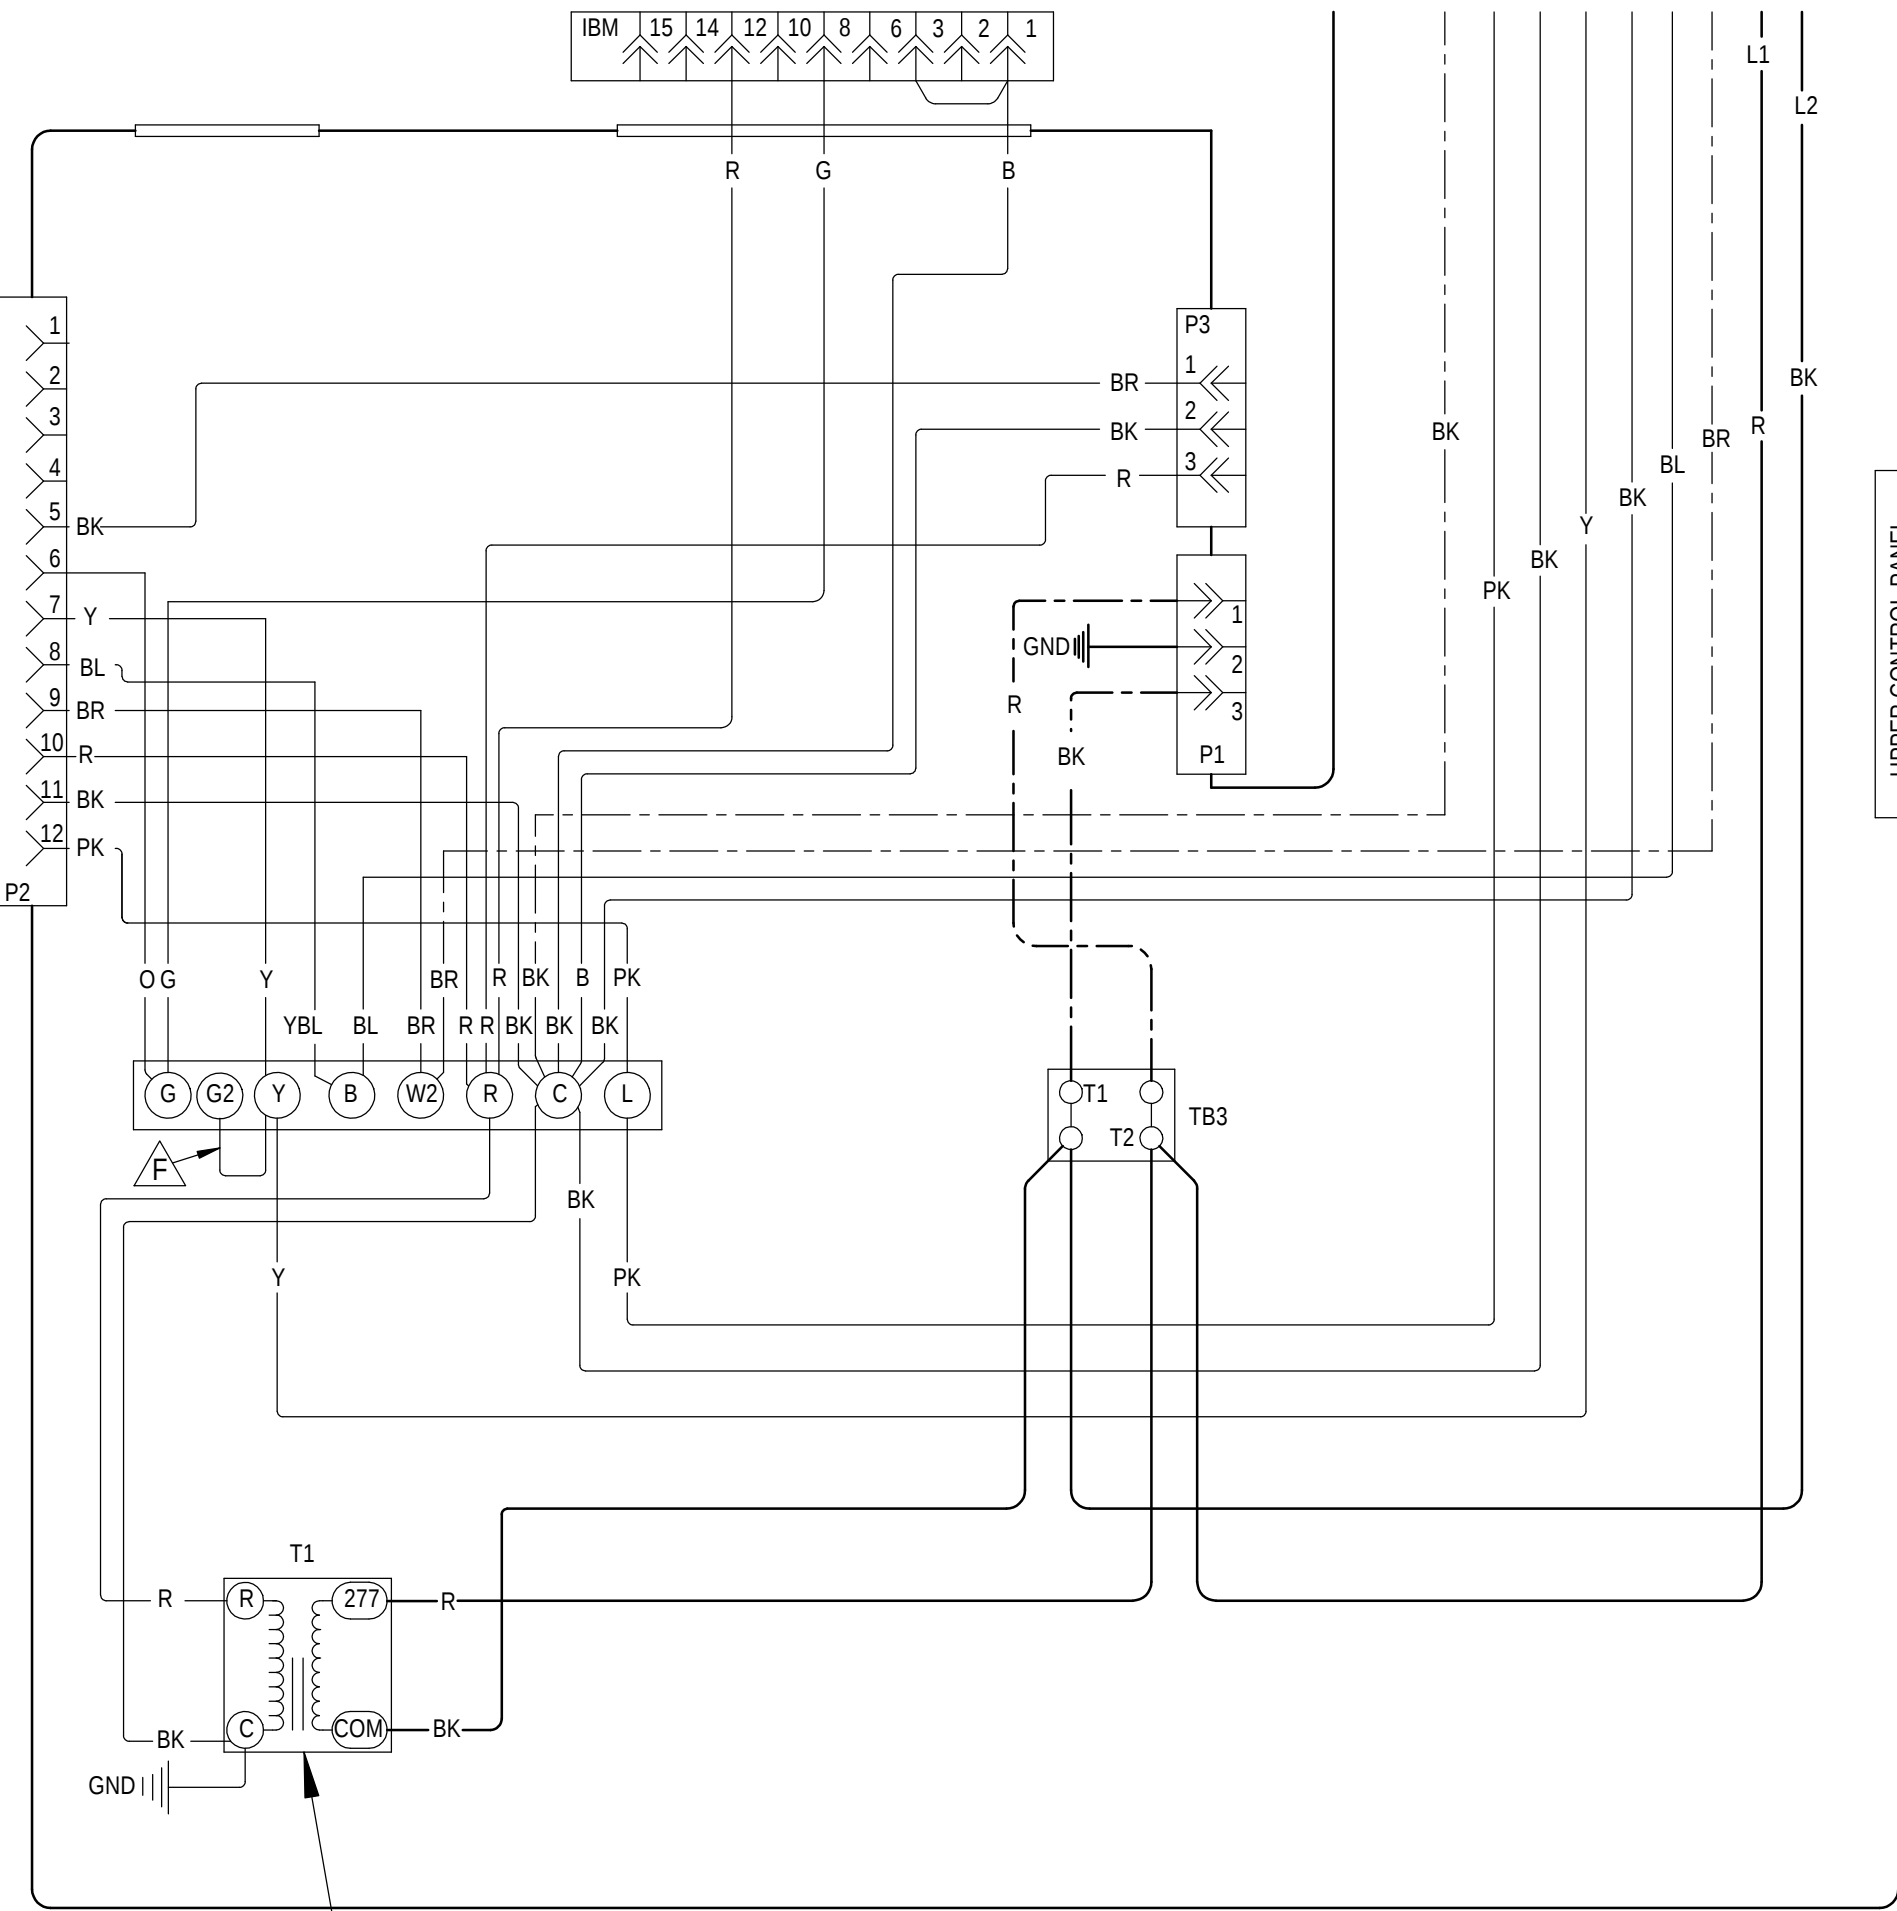

TRANSFORMER CHANGED TO SINGULAR 277 V
TAP INSTEAD OF TRI-VOLTAGE TAP STYLE

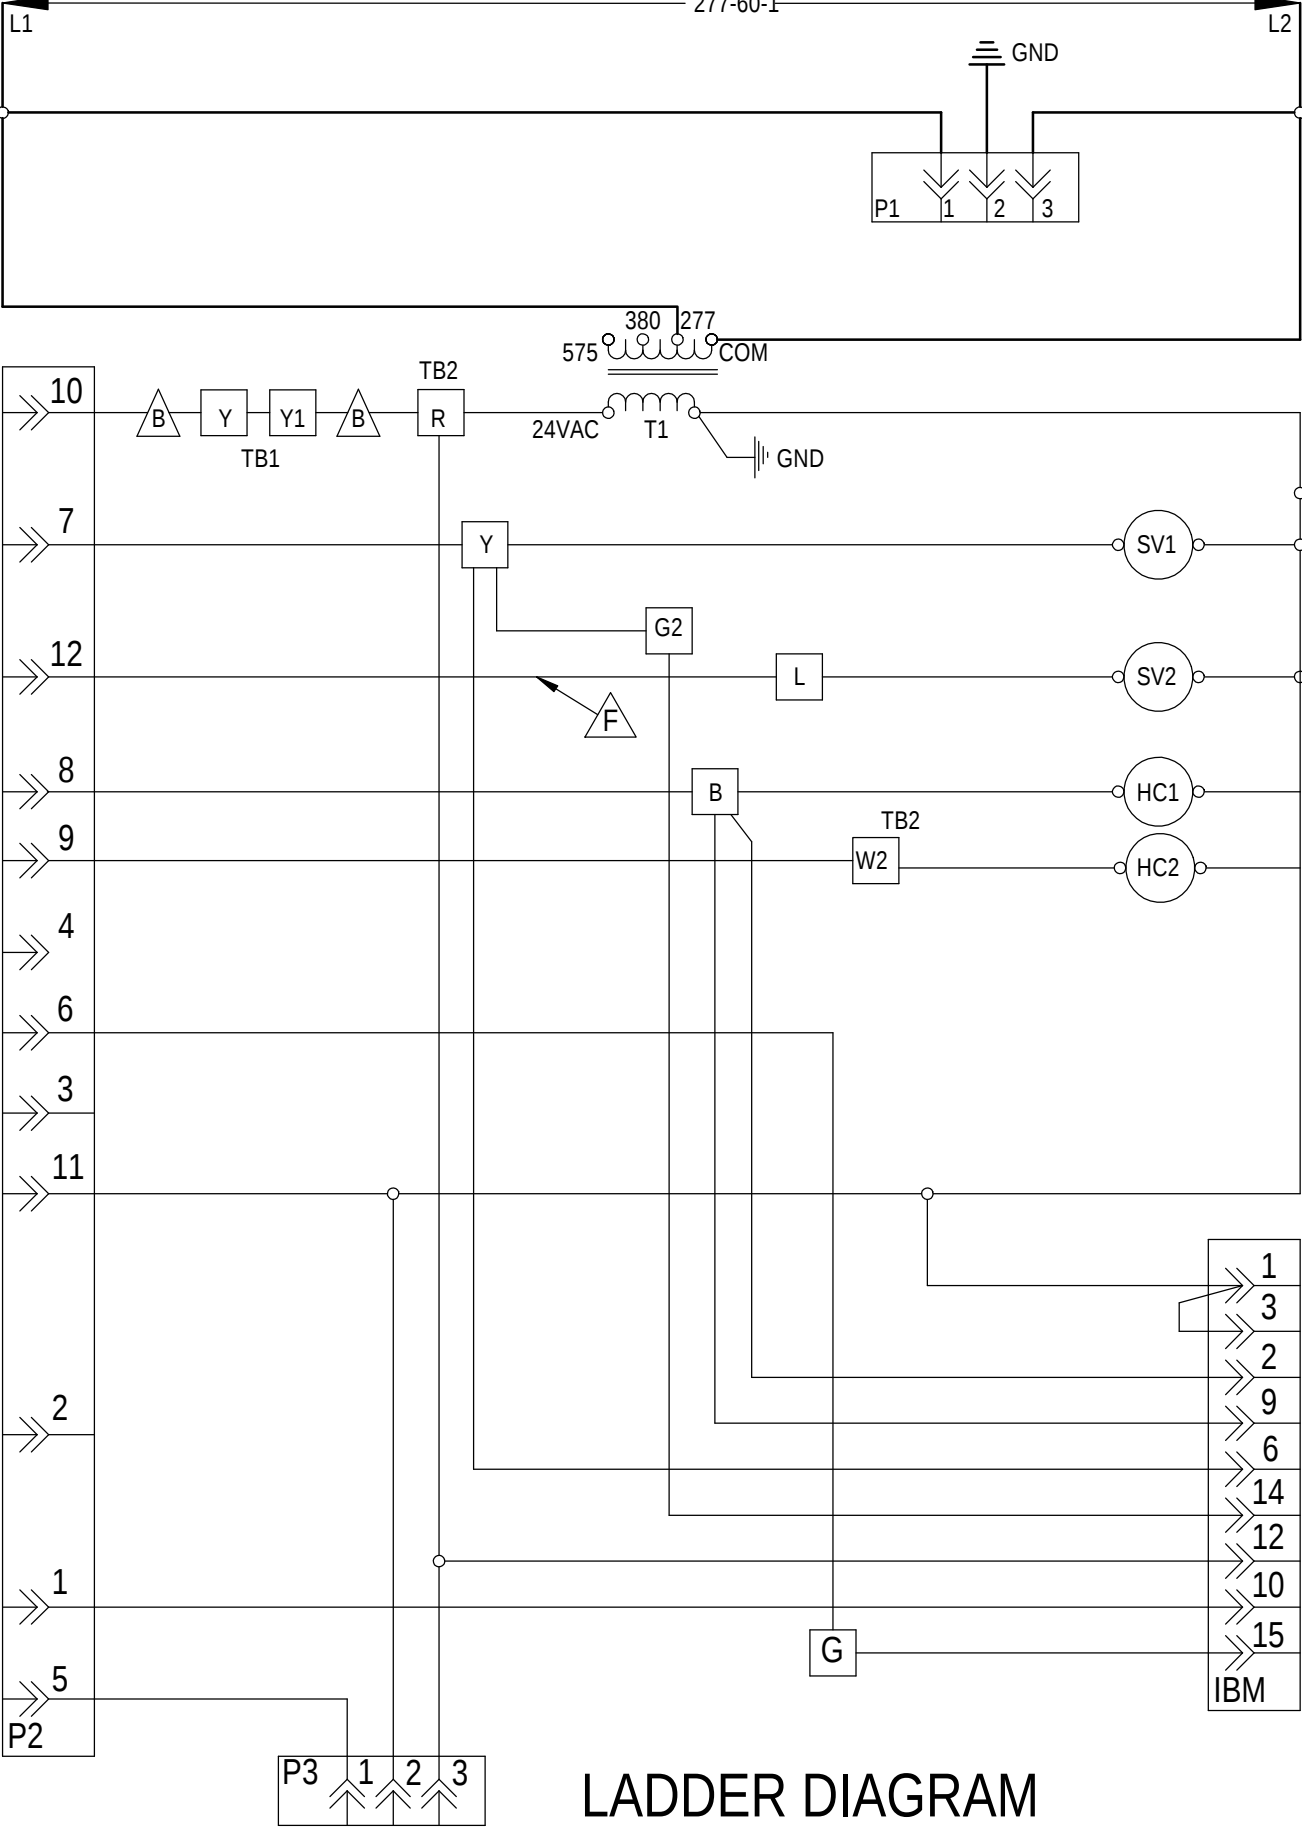

LADDER DIAGRAM

COMPONENT CODE	
CBI	CIRCUIT BREAKER #1
FB	FUSE BLOCK
GND	GROUND
HC1	HEATER CONTACTOR #1
HS1	HEAT STRIP #1
IBM	INDOOR BLOWER MOTOR
LS	LIMIT SWITCH
P1	ERV (HV) ACCESSORY PLUG
P2	CLIMATE CONTROL PLUG
P3	VENT (LV) ACCESSORY PLUG
SV1	SOLENOID VALVE #1
SV2	SOLENOID VALVE #2
T1	TRANSFORMER #1
TB1	TERMINAL BLOCK #1
TB2	TERMINAL BLOCK #2
TB3	TERMINAL BLOCK #3

A B C D LABELED WIRES CONNECT
IF NO OPTIONS USED

A INSTALL JUMPER FOR HIGH SPEED
BLOWER OPERATION

WIRING CODE			
	FACTORY STD.	FIELD	OPTIONAL
HIGH VOLTAGE			
LOW VOLTAGE			
ACCESSORY			

COLOR CODE			
BK	BLACK	PK	PINK
BL	BLUE	PR	PURPLE
BR	BROWN	R	RED
G	GREEN	T	TAN
D	ORANGE	Y	YELLOW

4100-129 B