
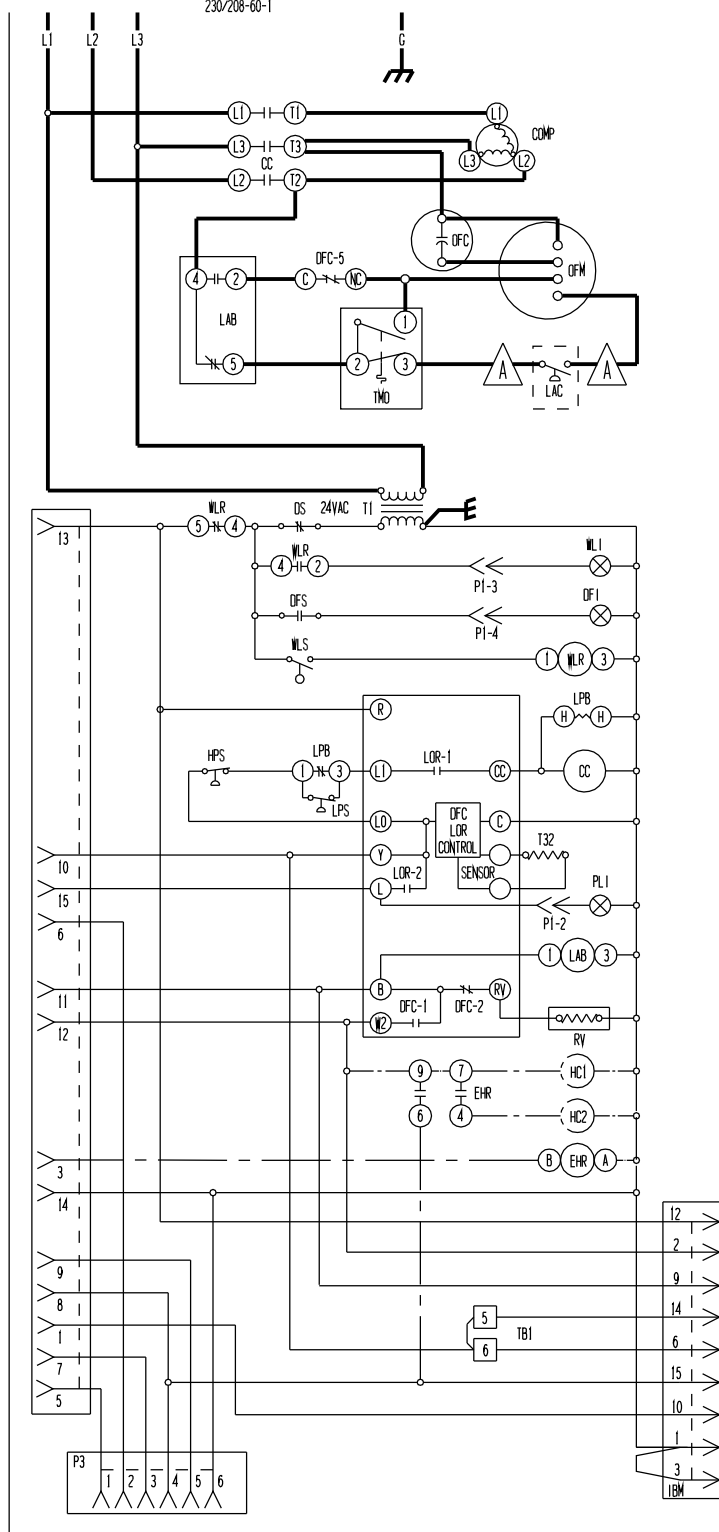


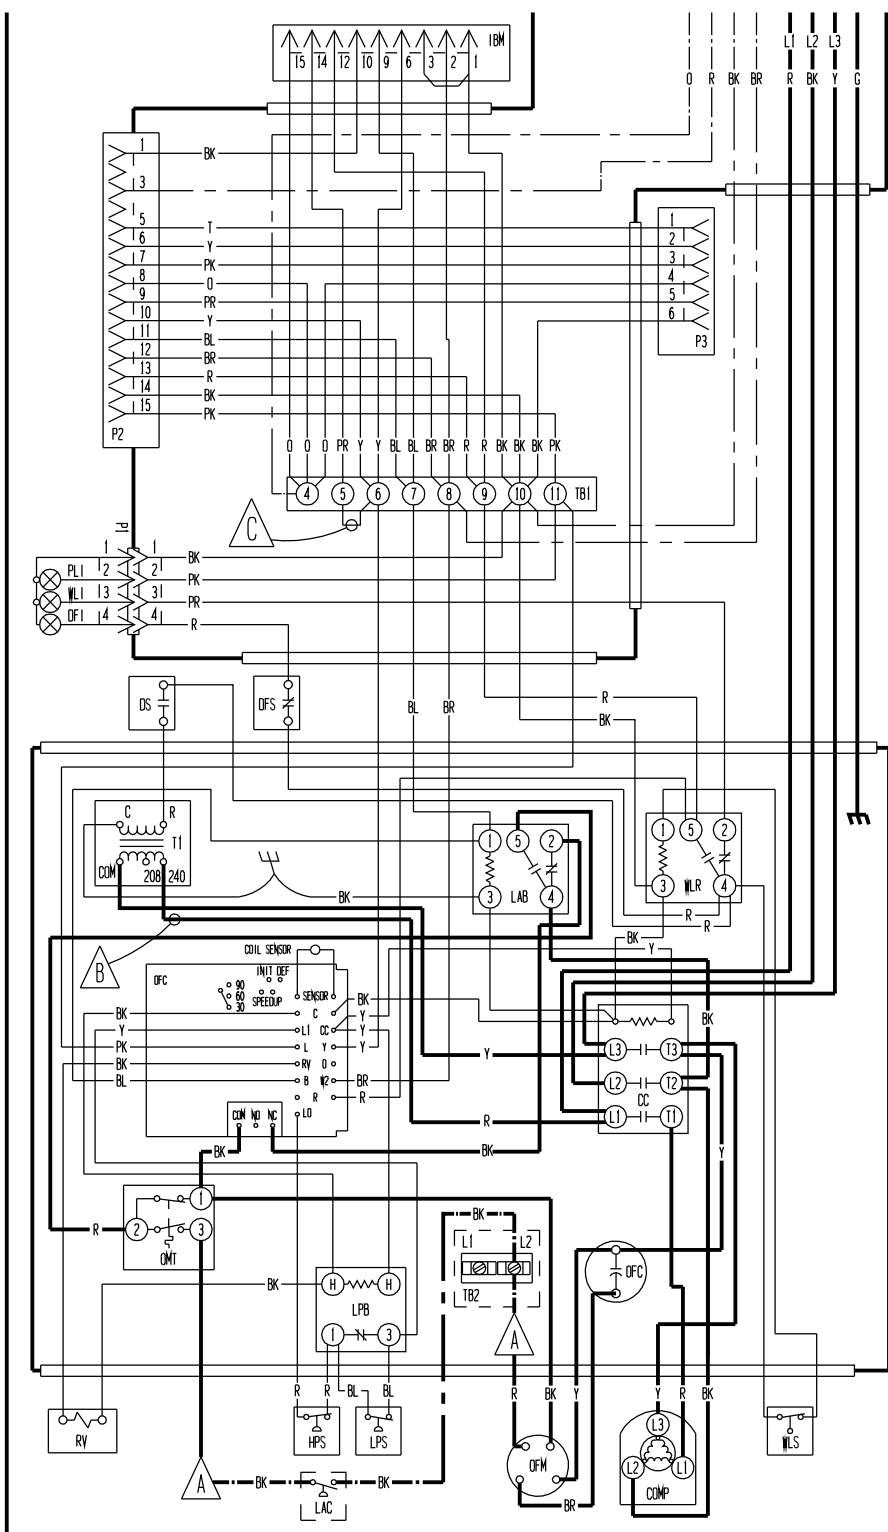

COMPONENT CODE

- CB1 CIRCUIT BREAKER #1
- CB2 CIRCUIT BREAKER #2
- CC COMPRESSOR CONTACTOR
- COMP COMPRESSOR
- DFC DEFROST CONTROL
- DFI DIRTY FILTER INDICATOR
- DFS DIRTY FILTER SWITCH
- DS DOOR SWITCH
- EHR EMERGENCY HEAT RELAY
- GND GROUND
- HC1 HEATER CONTACTOR #1
- HC2 HEATER CONTACTOR #2
- HPS HIGH PRESSURE SWITCH
- HS1 HEAT STRIP #1
- HS2 HEAT STRIP #2
- IBM INDOOR BLOWER MOTOR
- LAB LOW AMBIENT BYPASS
- LAC LOW AMBIENT CONTROL
- LPB LOW PRESSURE BYPASS
- LPS LOW PRESSURE SWITCH
- LS LIMIT SWITCH
- OFC OUTDOOR FAN CAPACITOR
- OFM OUTDOOR FAN MOTOR
- OMT OUTDOOR MOTOR THERMOSTAT
- P1 ACCESSORY PLUG #1
- P2 ACCESSORY PLUG #2
- P3 ACCESSORY PLUG #3
- PLI PRESSURE LOCKOUT INDICATOR
- RV REV. VALVE SOLINOID
- T1 TRANSFORMER
- TB1 TERMINAL BLOCK #1
- TB2 TERMINAL BLOCK #2
- WL1 HIGH WATER LEVEL INDICATOR
- WLR WATER LEVEL RELAY
- WLS WATER LEVEL SWITCH

USE COPPER CONDUCTORS ONLY
SUITABLE FOR AT LEAST 75°C

- A** LABELED WIRES CONNECT IF NO OPTIONS USED.
- B** MOVE RED WIRE TO 208 V TAP FOR 208 V OPERATION
- C** REMOVE JUMPER FOR LOW SPEED BLOWER OPERATION

	FACTORY STD.	FIELD	OPTIONAL
HIGH VOLTAGE			
LOW VOLTAGE			
ACCESSORY			
BK - BLACK G - GREEN T - TAN BN - BROWN BL - BLUE PK - PINK R - RED PR - PURPLE L - LAVENDER O - ORANGE CY - GREY Y - YELLOW W - WHITE			

4100-200