
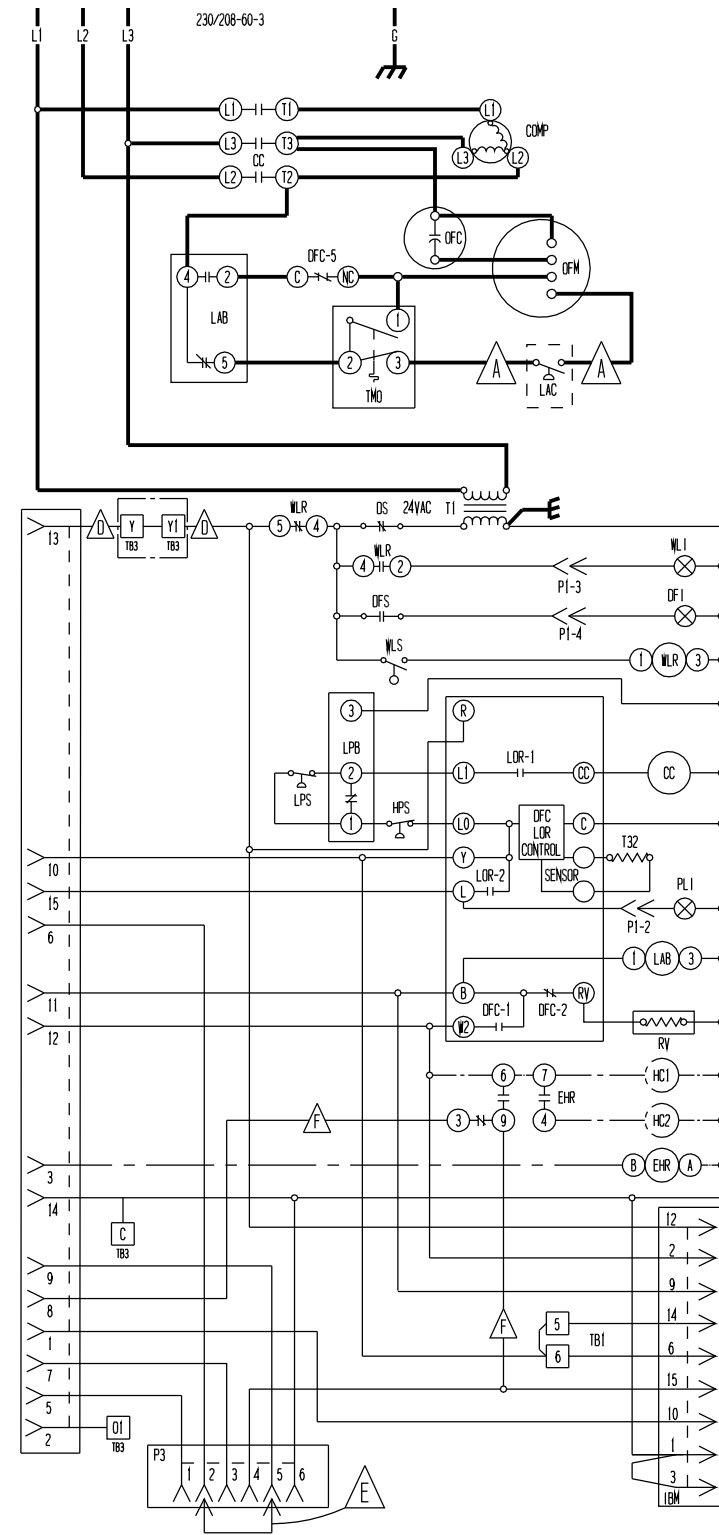


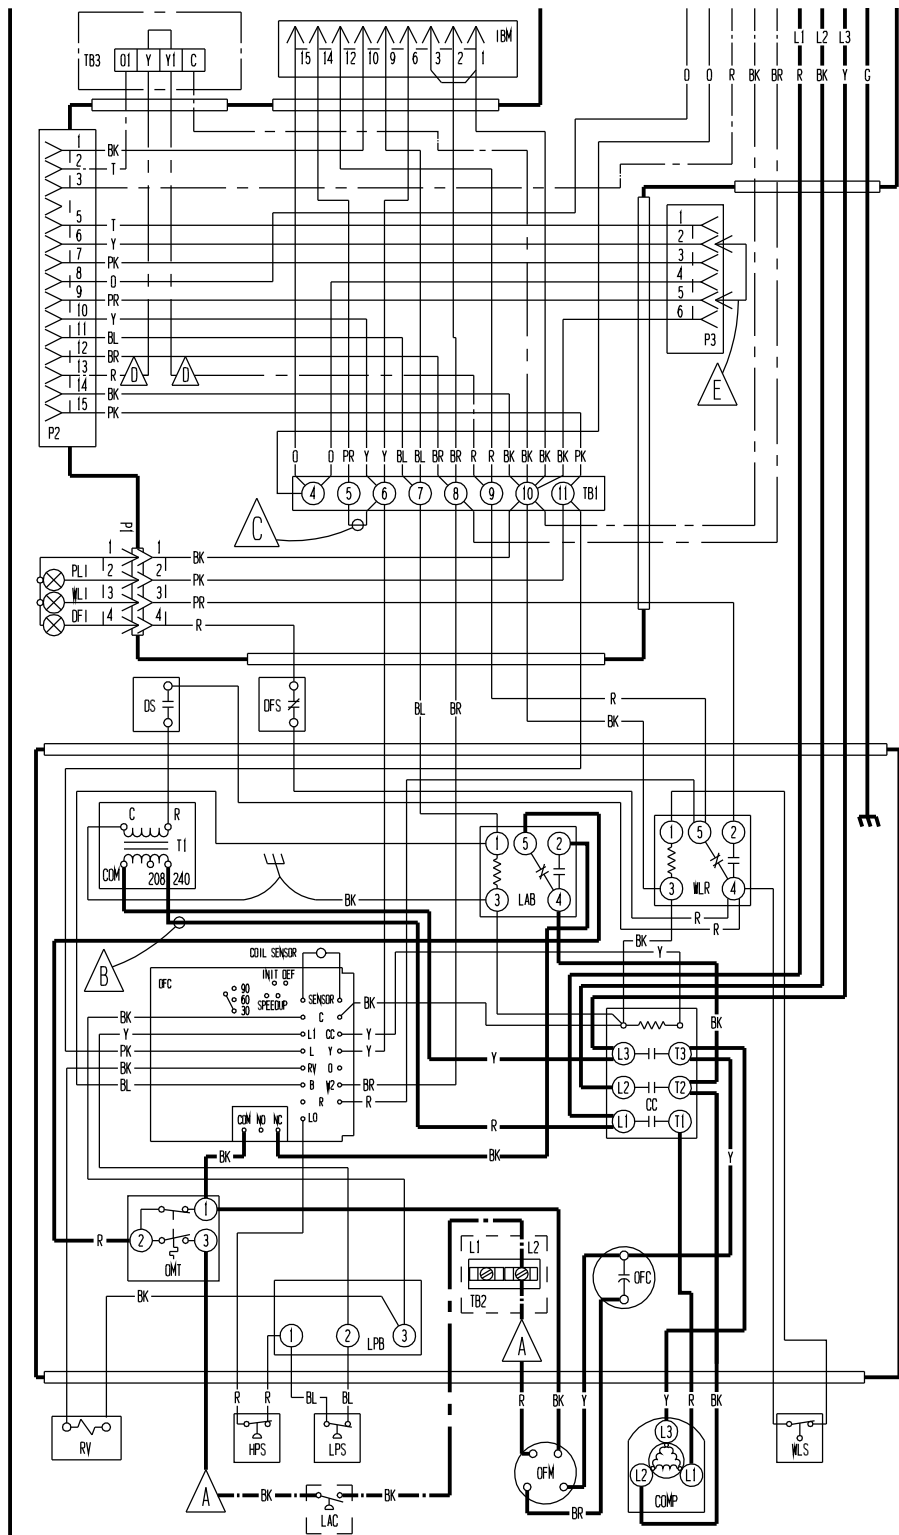

COMPONENT CODE			
CB1	CIRCUIT BREAKER #1		
CB2	CIRCUIT BREAKER #2		
CC	COMPRESSOR CONTACTOR		
COMP	COMPRESSOR		
DFC	DEFROST CONTROL		
DFI	DIRTY FILTER INDICATOR		
DFS	DIRTY FILTER SWITCH		
DS	DOOR SWITCH		
EHR	EMERGENCY HEAT RELAY		
GND	GROUND		
HC1	HEATER CONTACTOR #1		
HC2	HEATER CONTACTOR #2		
HPS	HIGH PRESSURE SWITCH		
HS1	HEAT STRIP #1		
HS2	HEAT STRIP #2		
IBM	INDOOR BLOWER MOTOR		
LAB	LOW AMBIENT BYPASS		
LAC	LOW AMBIENT CONTROL		
LPB	LOW PRESSURE BYPASS		
LPS	LOW PRESSURE SWITCH		
LS	LIMIT SWITCH		
DFC	OUTDOOR FAN CAPACITOR		
OFM	OUTDOOR FAN MOTOR		
OMT	OUTDOOR MOTOR THERMOSTAT		
P1	ACCESSORY PLUG #1		
P2	ACCESSORY PLUG #2		
P3	ACCESSORY PLUG #3		
PL1	PRESSURE LOCKOUT INDICATOR		
RV	REV. VALVE SOLINOID		
T1	TRANSFORMER		
TB1	TERMINAL BLOCK #1		
TB2	TERMINAL BLOCK #2		
TB3	TERMINAL BLOCK #3		
WL1	HIGH WATER LEVEL INDICATOR		
WLR	WATER LEVEL RELAY		
WLS	WATER LEVEL SWITCH		

USE COPPER CONDUCTORS ONLY SUITABLE FOR AT LEAST 75°C			
A	D	F	LABELLED WIRES CONNECT IF NO OPTIONS USED.
B	MOVE RED WIRE TO 208 V TAP FOR 208 V OPERATION		
C	INSTALL JUMPER FOR HIGH SPEED BLOWER OPERATION ON MODELS 36 & 42		
E	IF VENT OPTION IS INSTALLED, PLUG WITH JUMPER 2 TO 5 IS REMOVED & PLUG FROM VENT OPTION INSERTED		

	FACTORY STD.	FIELD	OPTIONAL
HIGH VOLTAGE			
LOW VOLTAGE			
ACCESSORY			

BK - BLACK	G - GREEN	T - TAN
BN - BROWN	BL - BLUE	PK - PINK
R - RED	PR - PURPLE	L - LAVENDER
O - ORANGE	GY - GREY	
Y - YELLOW	W - WHITE	

4100-201 C