
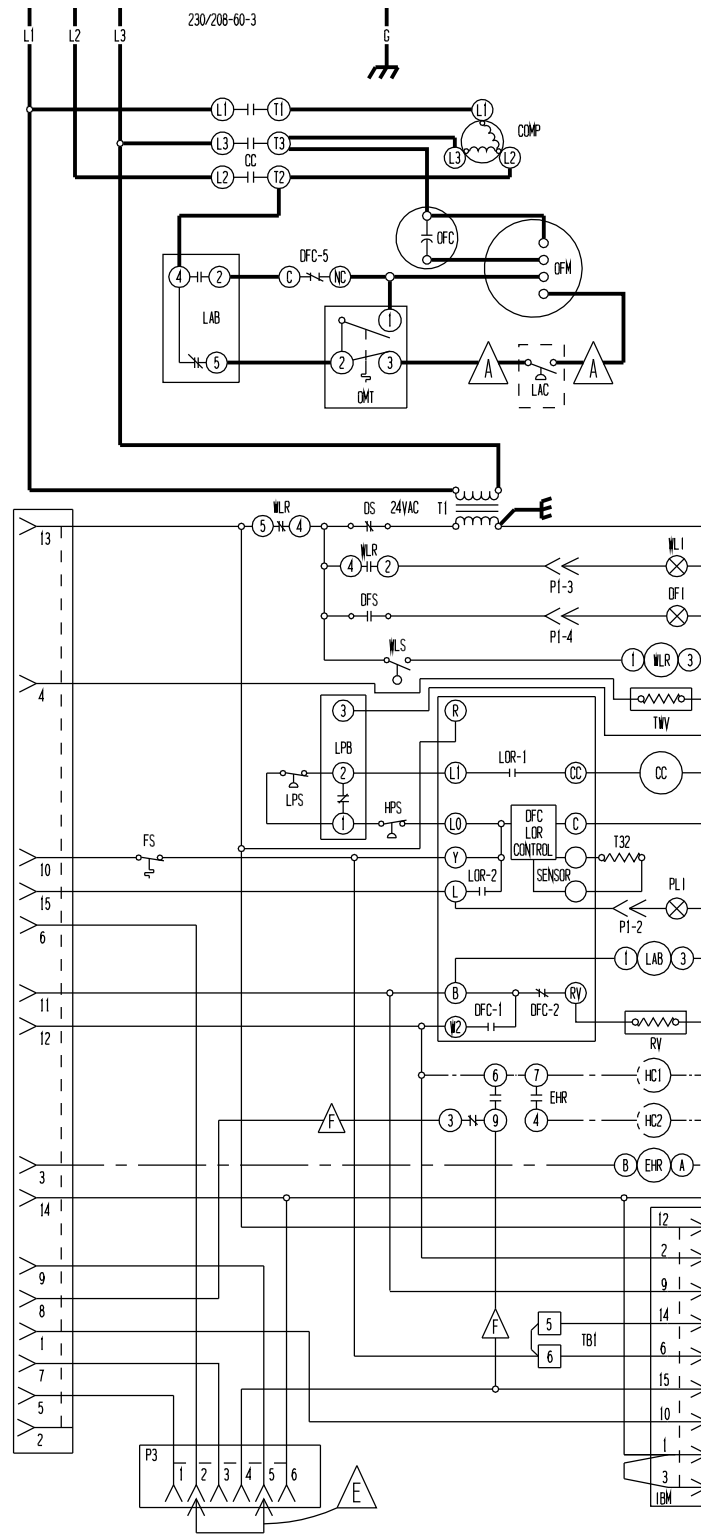


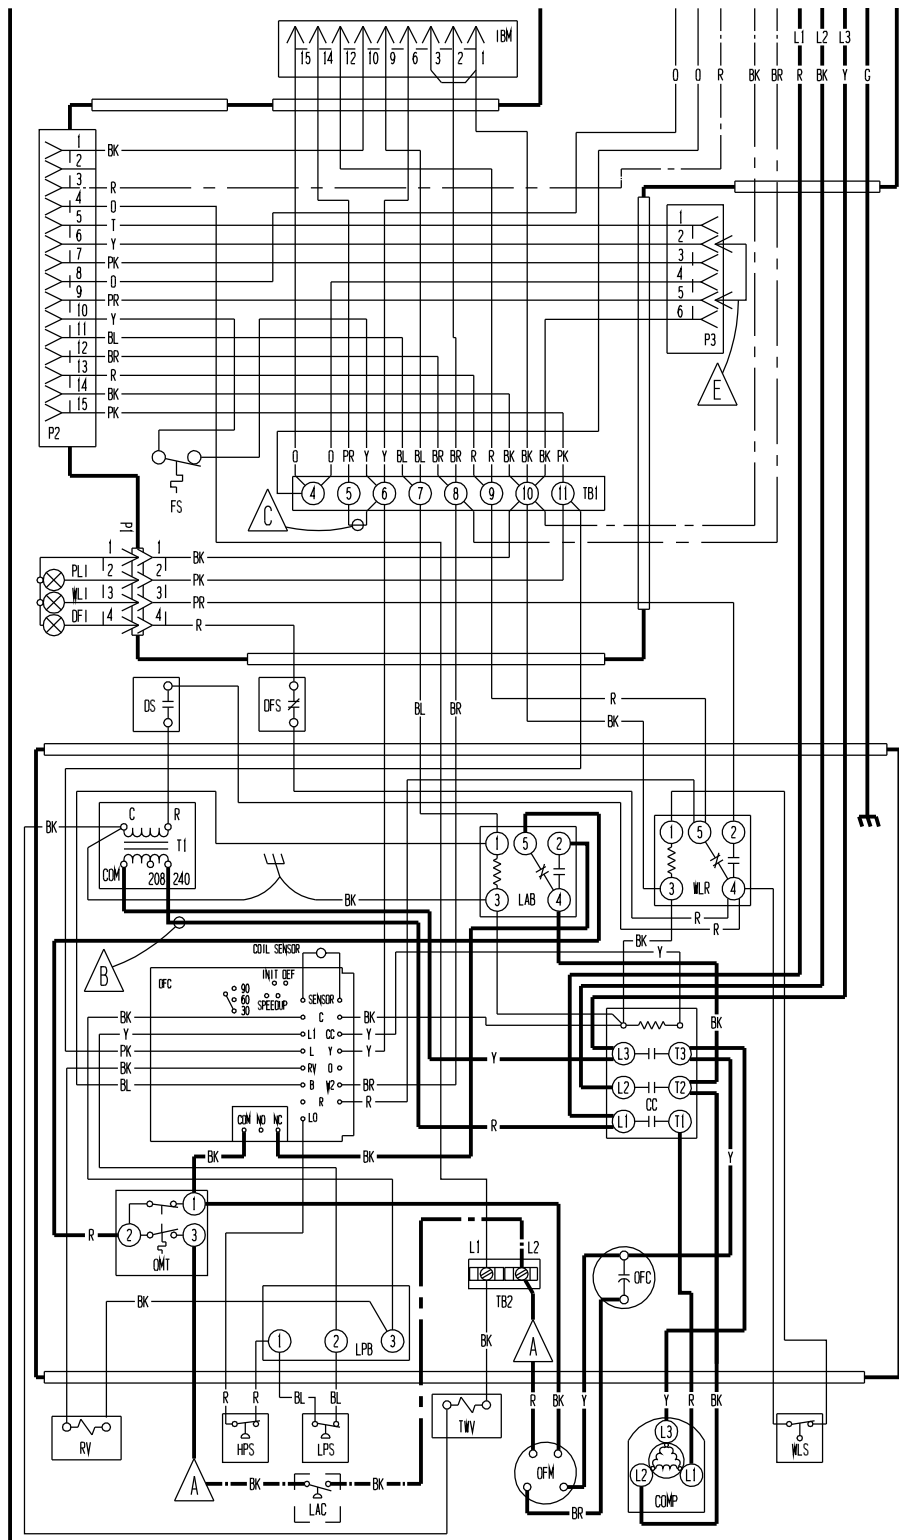

COMPONENT CODE

CB1	CIRCUIT BREAKER #1
CB2	CIRCUIT BREAKER #2
CC	COMPRESSOR CONTACTOR
COMP	COMPRESSOR
CC	DUAL CAN CAPACITOR
DFC	DEFROST CONTROL
DFI	DIRTY FILTER INDICATOR
DFS	DIRTY FILTER SWITCH
DS	DOOR SWITCH
EHR	EMERGENCY HEAT RELAY
FS	FREESTOP THERMOSTAT
GND	GROUND
HC1	HEATER CONTACTOR #1
HC2	HEATER CONTACTOR #2
HPS	HIGH PRESSURE SWITCH
HS1	HEAT STRIP #1
HS2	HEAT STRIP #2
IBM	INDOOR BLOWER MOTOR
LAC	LOW AMBIENT BYPASS
LAC	LOW AMBIENT CONTROL
LPB	LOW PRESSURE BYPASS
LPS	LOW PRESSURE SWITCH
LS	LIMIT SWITCH
OFM	OUTDOOR FAN MOTOR
OMT	OUTDOOR MOTOR THERMOSTAT
P1	ACCESSORY PLUG #1
P2	ACCESSORY PLUG #2
P3	ACCESSORY PLUG #3
PL1	PRESSURE LOCKOUT INDICATOR
RV	REV. VALVE SOLINOID
T1	TRANSFORMER
TB1	TERMINAL BLOCK #1
TB2	TERMINAL BLOCK #2
TWV	THREE WAY VALVE
WL1	HIGH WATER LEVEL INDICATOR
WLR	WATER LEVEL RELAY
WLS	WATER LEVEL SWITCH

USE COPPER CONDUCTORS ONLY
SUITABLE FOR AT LEAST 75°C

A **F** LABELED WIRES CONNECT
IF NO OPTIONS USED.

B MOVE RED WIRE TO 208 V
TAP FOR 208 V OPERATION

C INSTALL JUMPER FOR HIGH SPEED
BLOWER OPERATION ON MODELS 36 & 42

E IF VENT OPTION IS INSTALLED, PLUG
WITH JUMPER 2 TO 5 IS REMOVED &
PLUG FROM VENT OPTION INSERTED

	FACTORY STD.	FIELD	OPTIONAL
--	-----------------	-------	----------

HIGH VOLTAGE

LOW VOLTAGE

ACCESSORY

BK - BLACK	G - GREEN	T - TAN
BN - BROWN	BL - BLUE	PK - PINK
R - RED	PR - PURPLE	L - LAVENDER
O - ORANGE	GY - GREY	
Y - YELLOW	W - WHITE	

4100-204 C