


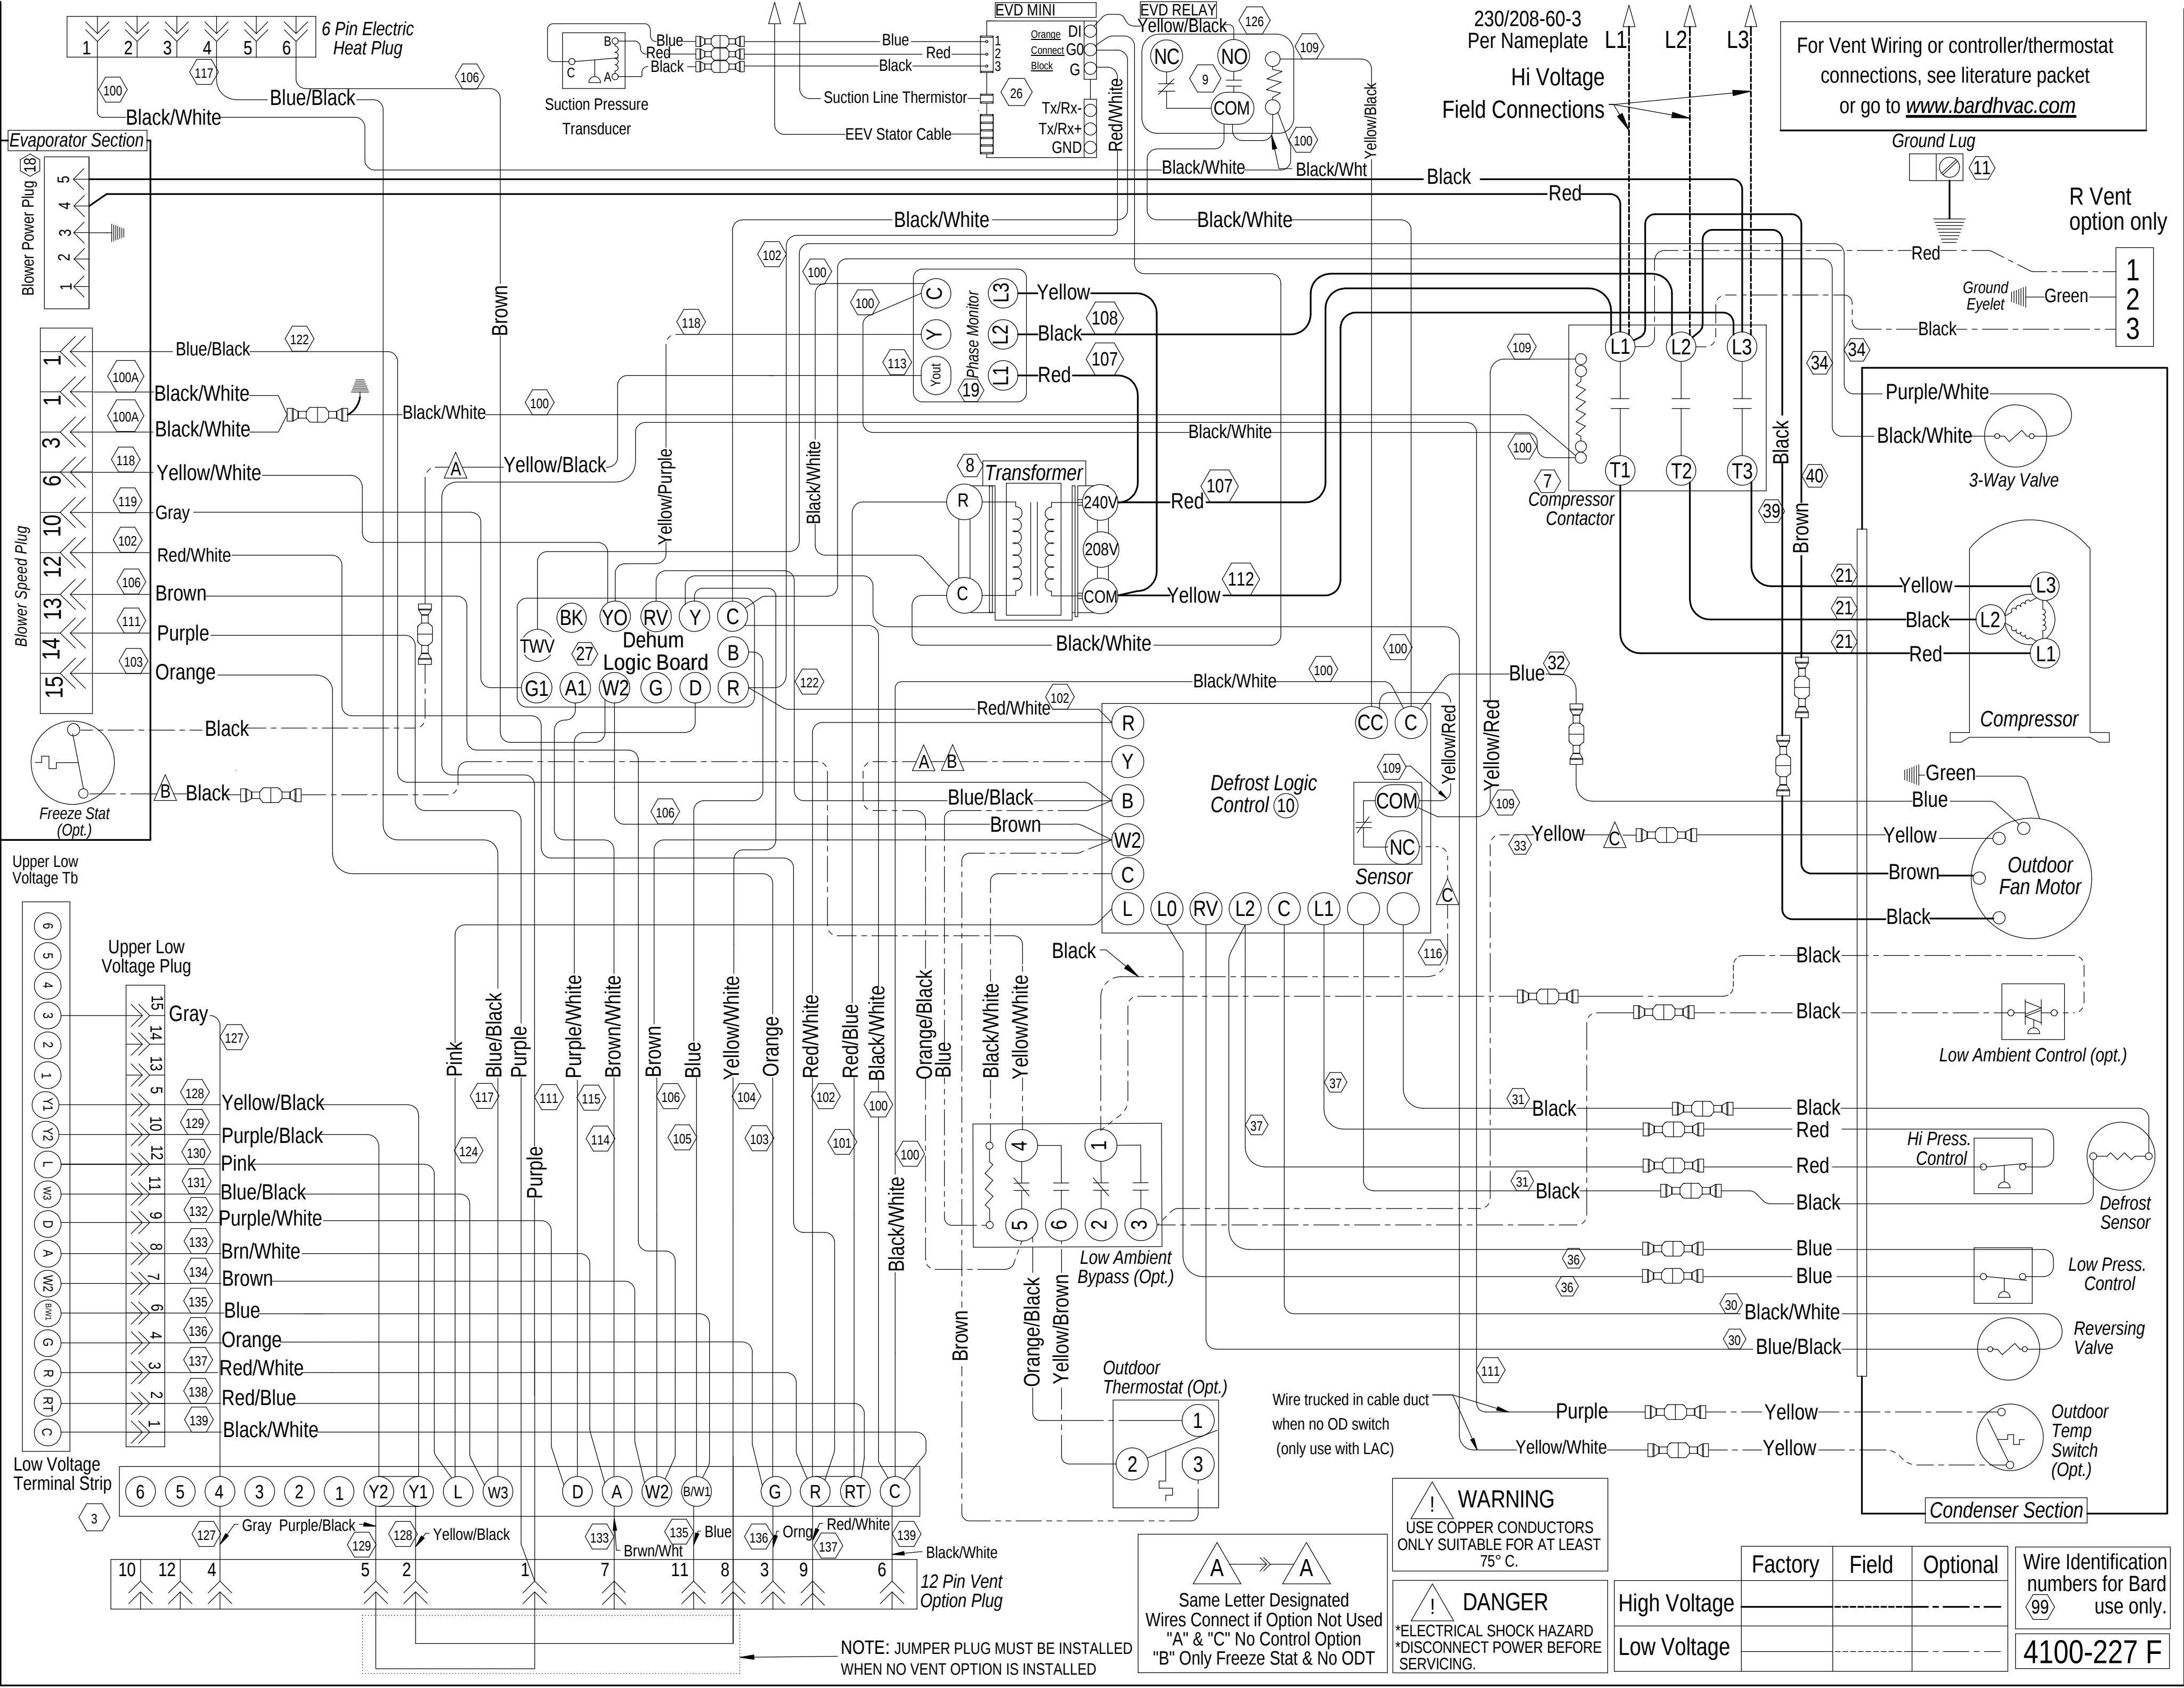

For Vent Wiring or controller/thermostat connections, see literature packet or go to www.bardhvac.com

R Vent option only

230/208-60-3
Per Nameplate
Hi Voltage
Field Connections

Ground Lug
11

Ground Eyelet
Green
1
2
3

Purple/White
Black/White
3-Way Valve

Yellow
Black
Red
Compressor

Green
Blue
Yellow
Brown
Black
Outdoor Fan Motor

Low Ambient Control (opt.)

Hi Press. Control
Defrost Sensor

Low Press. Control

Reversing Valve

Outdoor Temp Switch (Opt.)

Condenser Section

WARNING
USE COPPER CONDUCTORS
ONLY SUITABLE FOR AT LEAST
75° C.

DANGER
*ELECTRICAL SHOCK HAZARD
*DISCONNECT POWER BEFORE
SERVICING.

	Factory	Field	Optional
High Voltage			
Low Voltage			

Wire Identification
numbers for Bard
use only.
4100-227 F

A → **A**
Same Letter Designated
Wires Connect if Option Not Used
"A" & "C" No Control Option
"B" Only Freeze Stat & No ODT

NOTE: JUMPER PLUG MUST BE INSTALLED
WHEN NO VENT OPTION IS INSTALLED