
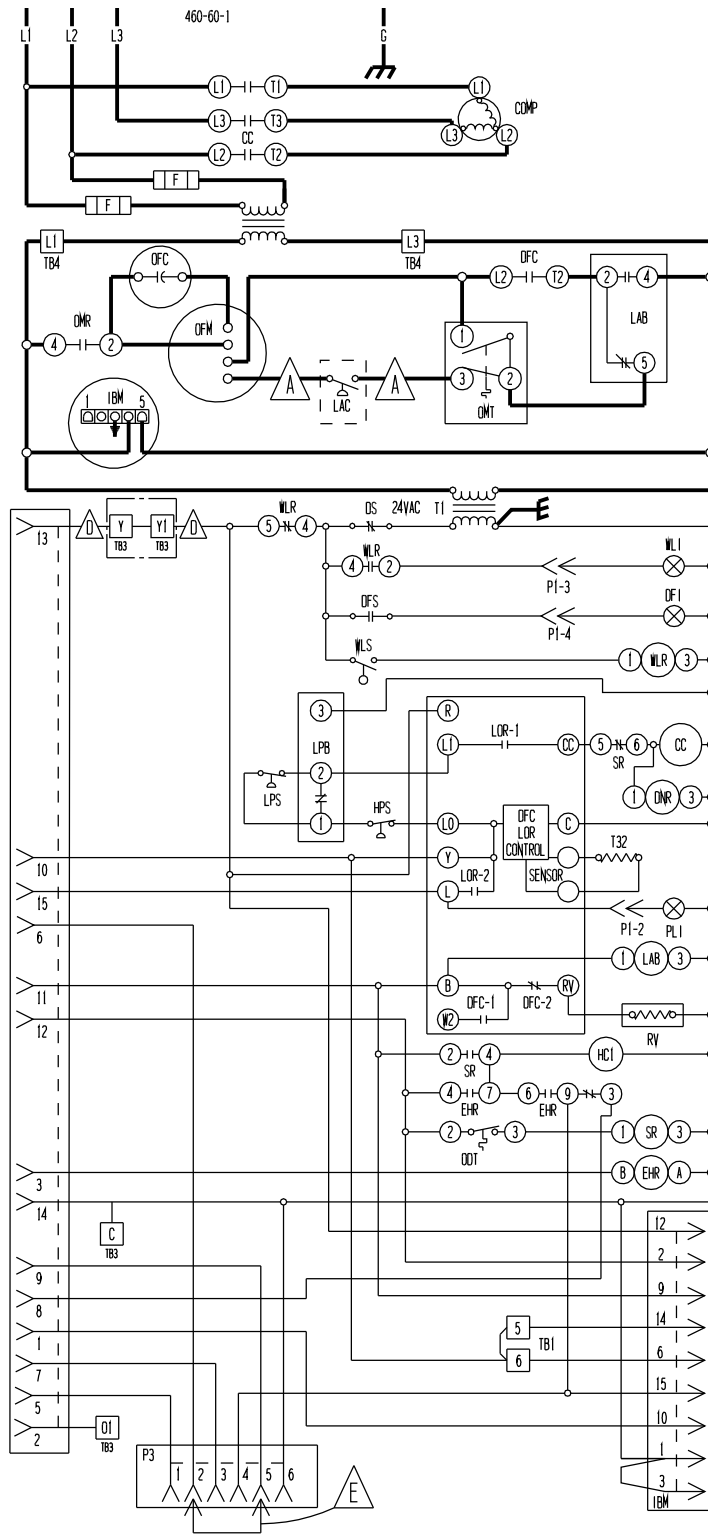


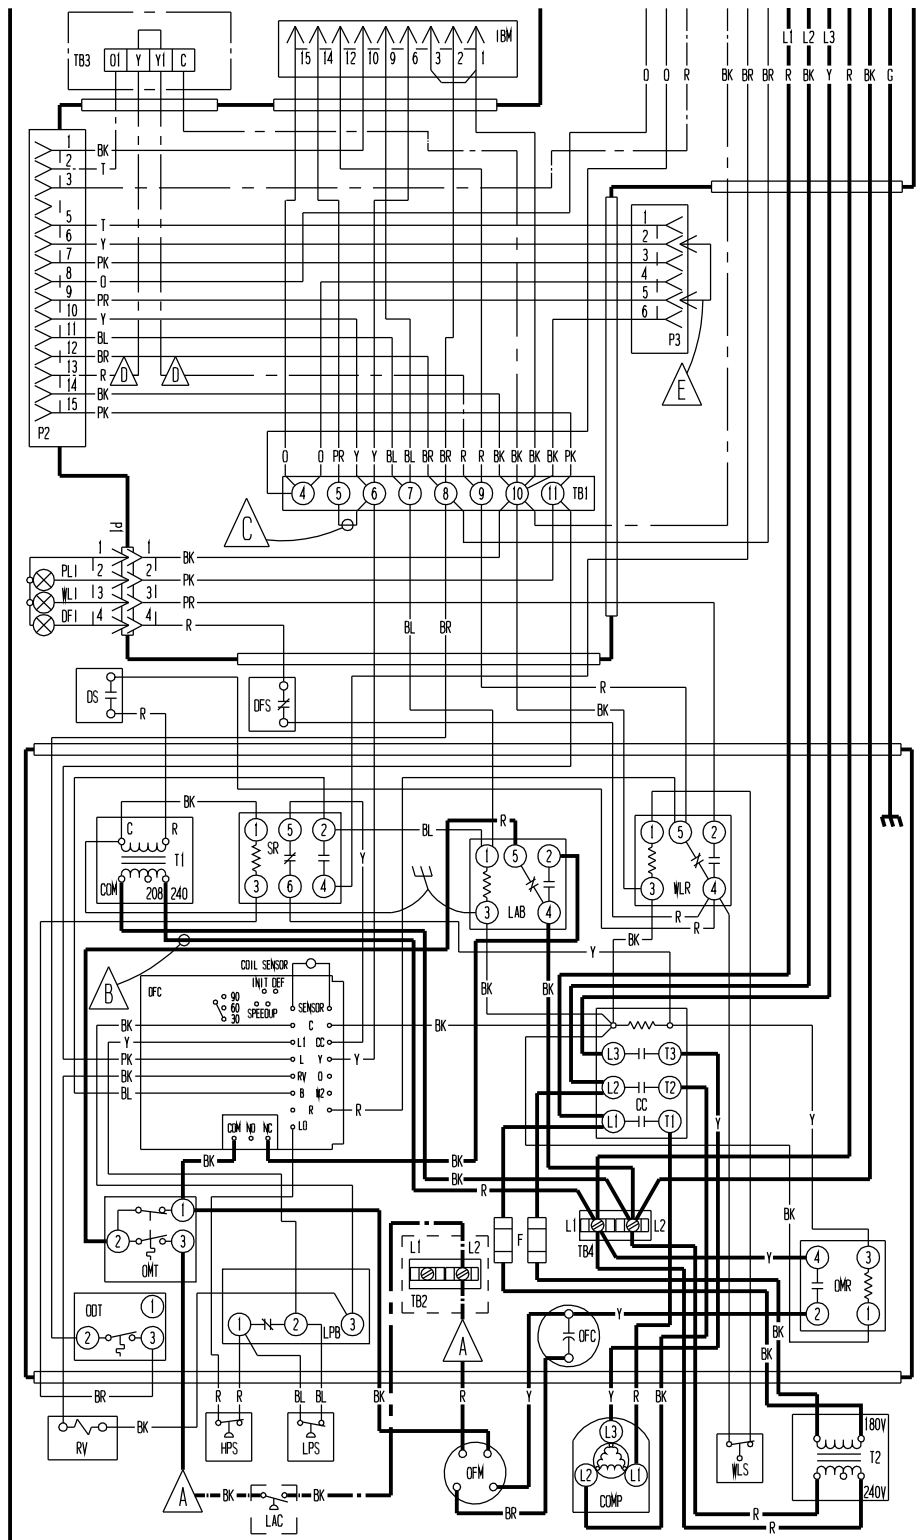

COMPONENT CODE

- CC COMPRESSOR CONTACTOR
- COMP COMPRESSOR
- DFC DEFROST CONTROL
- DFI DIRTY FILTER INDICATOR
- DFT DIRTY FILTER SWITCH
- DS DOOR SWITCH
- EHR EMERGENCY HEAT RELAY
- F FUSE CLASS CCOA OR COT4
- GND GROUND
- HCI HEATER CONTACTOR #1
- HCI2 HEATER CONTACTOR #2
- HPS HIGH PRESSURE SWITCH
- HSI HEAT STRIP #1
- IBM INDOOR BLOWER MOTOR
- LAB LOW AMBIENT BYPASS
- LAC LOW AMBIENT CONTROL
- LPB LOW PRESSURE BYPASS
- LPS LOW PRESSURE SWITCH
- LS LIMIT SWITCH
- DFC OUTDOOR FAN CAPACITOR
- DFM OUTDOOR FAN MOTOR
- DMT OUTDOOR MOTOR THERMOSTAT
- P0 PULL DISCONNECT
- P1 ACCESSORY PLUG #1
- P2 ACCESSORY PLUG #2
- P3 ACCESSORY PLUG #3
- PL1 PRESSURE LOCKOUT INDICATOR
- RV REV. VALVE SOLINOID
- SR STAGING RELAY
- T1 TRANSFORMER #1
- T2 TRANSFORMER #2
- TB1 TERMINAL BLOCK #1
- TB2 TERMINAL BLOCK #2
- TB3 TERMINAL BLOCK #3
- TB4 TERMINAL BLOCK #4
- DMR OUTDOOR MOTOR RELAY
- WL1 HIGH WATER LEVEL INDICATOR
- WLR WATER LEVEL RELAY
- WLS WATER LEVEL SWITCH

USE COPPER CONDUCTORS ONLY
SUITABLE FOR AT LEAST 75°C

- A** LABELED WIRES CONNECT IF NO OPTIONS USED.
- B** MOVE RED WIRE TO 208 V TAP FOR 208 V OPERATION
- C** INSTALL JUMPER FOR HIGH SPEED BLOWER OPERATION ON MODELS 36 & 42
- E** IF VENT OPTION IS INSTALLED, PLUG WITH JUMPER 2 TO 5 IS REMOVED & PLUG FROM VENT OPTION INSERTED

	FACTORY STD.	FIELD	OPTIONAL
HIGH VOLTAGE			
LOW VOLTAGE			
ACCESSORY			
BK - BLACK BN - BROWN R - RED O - ORANGE Y - YELLOW	G - GREEN BL - BLUE PR - PURPLE GY - GREY W - WHITE	T - TAN PK - PINK L - LAVENDER	

4100-302 G