
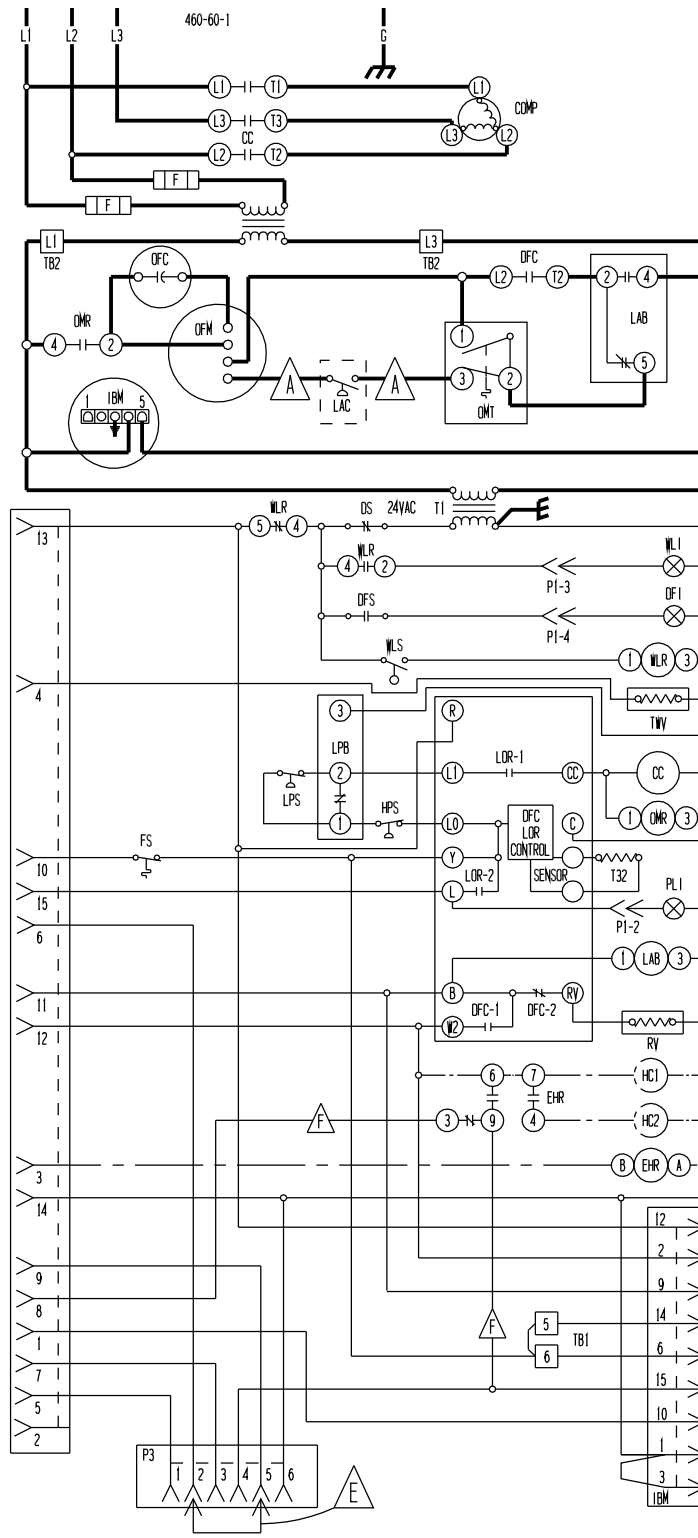


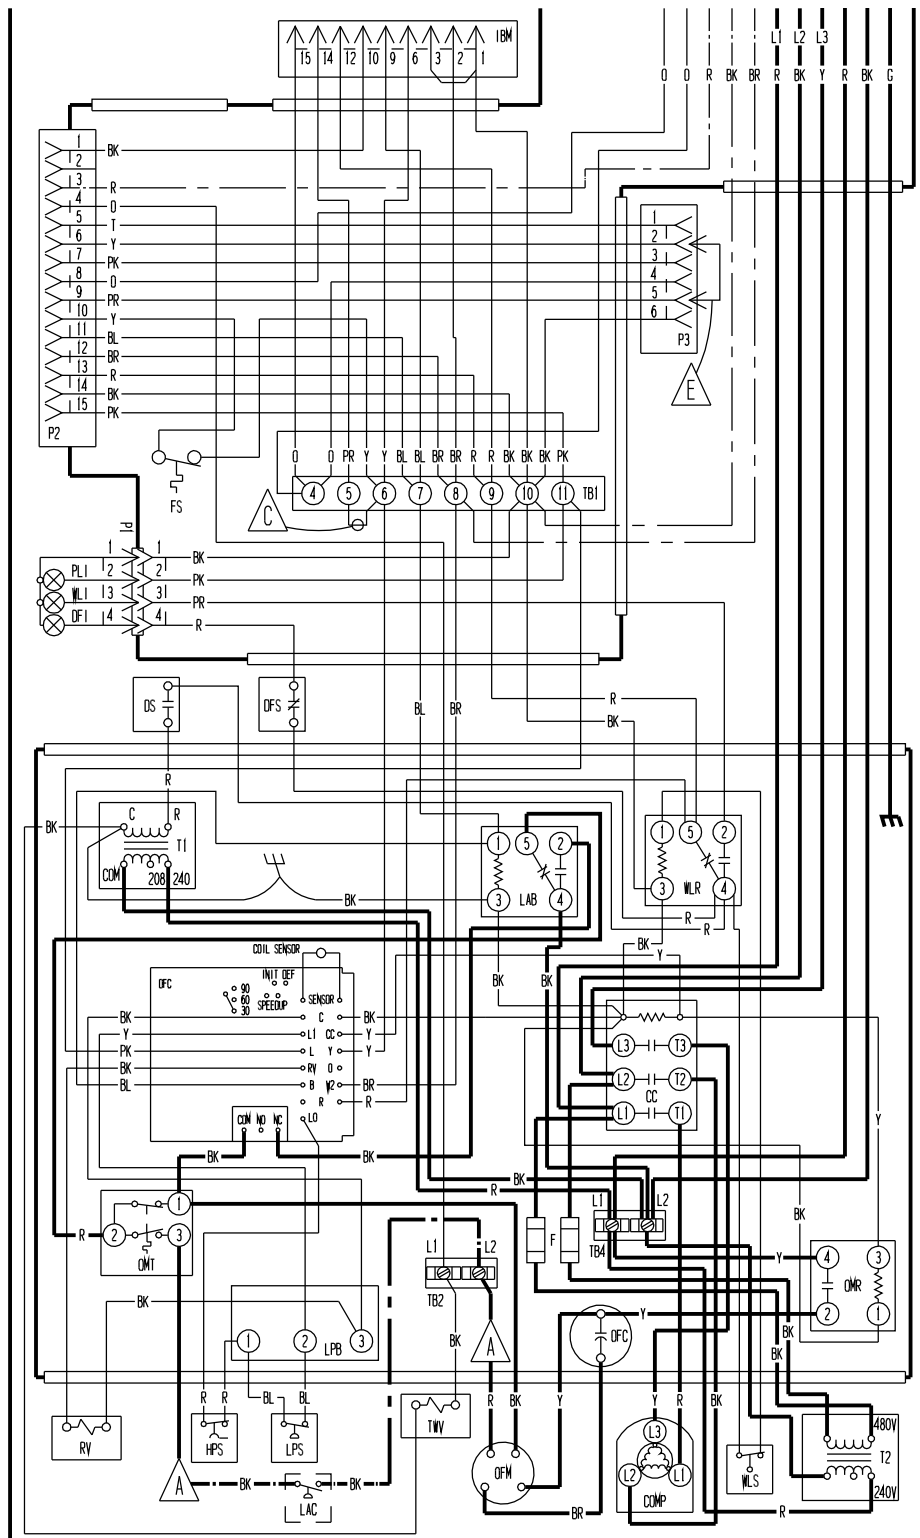

COMPONENT CODE

CB1	CIRCUIT BREAKER #1
CB2	CIRCUIT BREAKER #2
CC	COMPRESSOR CONTACTOR
COMP	COMPRESSOR
DFC	DEFROST CONTROL
DFI	DIRTY FILTER INDICATOR
DFS	DIRTY FILTER SWITCH
DS	DOOR SWITCH
EHR	EMERGENCY HEAT RELAY
F	FUSE CLASS CCGA OR CCGA
FS	FREEZE UP THERMISTAT
GND	GROUND
HC1	HEATER CONTACTOR #1
HC2	HEATER CONTACTOR #2
HPS	HIGH PRESSURE SWITCH
HS1	HEAT STRIP #1
HS2	HEAT STRIP #2
IBM	INDOOR BLOWER MOTOR
LAB	LOW AMBIENT BYPASS
LAC	LOW AMBIENT CONTROL
LPB	LOW PRESSURE BYPASS
LPS	LOW PRESSURE SWITCH
LS	LIMIT SWITCH
DFC	OUTDOOR FAN CAPACITOR
DFM	OUTDOOR FAN MOTOR
DMT	OUTDOOR MOTOR THERMISTAT
OMT	OUTDOOR MOTOR THERMISTAT
P1	ACCESSORY PLUG #1
P2	ACCESSORY PLUG #2
P3	ACCESSORY PLUG #3
PL1	PRESSURE LOCKOUT INDICATOR
RV	REV. VALVE SOLINOID
T1	TRANSFORMER #1
T2	TRANSFORMER #2
TB1	TERMINAL BLOCK #1
TB2	TERMINAL BLOCK #2
TB4	TERMINAL BLOCK #4
TWV	THREE WAY VALVE
DMR	OUTDOOR MOTOR RELAY
WL1	HIGH WATER LEVEL INDICATOR
WLR	WATER LEVEL RELAY
WLS	WAT

USE COPPER CONDUCTORS ONLY
SUITABLE FOR AT LEAST 75°C

- A** **F** LABELED WIRES CONNECT IF NO OPTIONS USED.
- C** **E** INSTALL JUMPER FOR HIGH SPEED BLOWER OPERATION ON MODELS 36 & 42
- E** IF VENT OPTION IS INSTALLED, PLUG WITH JUMPER 2 TO 5 IS REMOVED & PLUG FROM VENT OPTION INSERTED

	FACTORY STD.	FIELD	OPTIONAL
HIGH VOLTAGE			
LOW VOLTAGE			
ACCESSORY			
BK - BLACK	G - GREEN	T - TAN	
BN - BROWN	BL - BLUE	PK - PINK	
R - RED	PR - PURPLE	L - LAVENDER	
O - ORANGE	GY - GREY		
Y - YELLOW	W - WHITE		

4100-304 D