



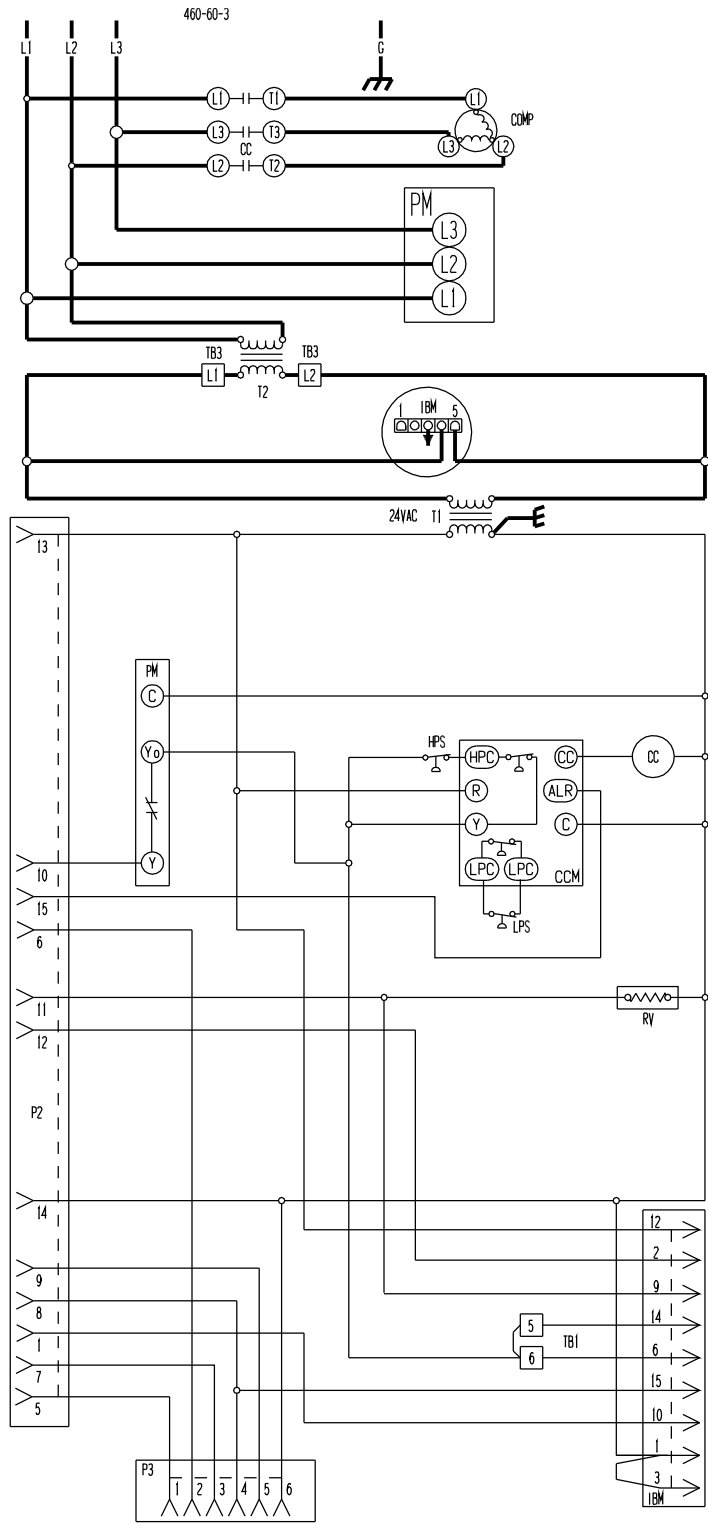

COMPONENT CODE

- CC COMPRESSOR CONTACTOR
- CCM COMPRESSOR CONTROL MODULE
- COMP COMPRESSOR
- OS ODOR SWITCH
- GND GROUND
- HPS HIGH PRESSURE SWITCH
- IBM INDOOR BLOWER MOTOR
- LPS LOW PRESSURE SWITCH
- P2 PLUG #2
- P3 ACCESSORY PLUG #3
- PD PULL DISCONNECT
- RV REV. VALVE SOLINOID
- T1 TRANSFORMER #1
- T2 TRANSFORMER #2
- TB1 TERMINAL BLOCK #1
- TB2 TERMINAL BLOCK #2
- TB3 TERMINAL BLOCK #3

USE COPPER CONDUCTORS ONLY
SUITABLE FOR AT LEAST 75°C

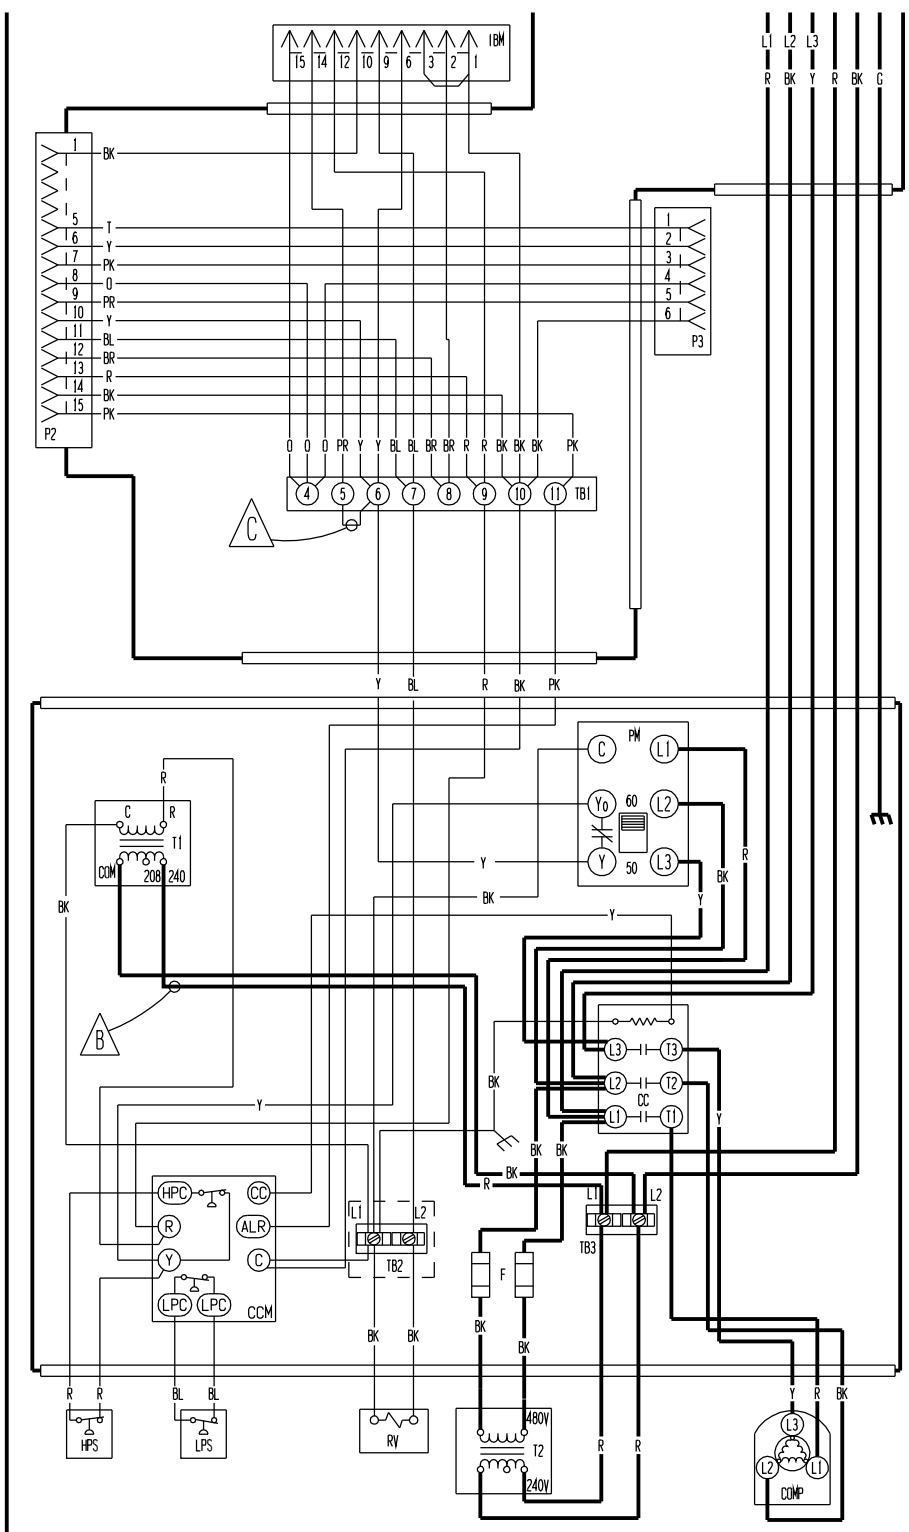

LABELED WIRES CONNECT
IF NO OPTIONS USED.



MOVE RED WIRE TO 208 V
TAP FOR 208 V OPERATION



REMOVE JUMPER FOR LOW
SPEED BLOWER OPERATION

	FACTORY STD.	FIELD	OPTIONAL
HIGH VOLTAGE			
LOW VOLTAGE			
ACCESSORY			
BK - BLACK BN - BROWN R - RED O - ORANGE Y - YELLOW	G - GREEN BL - BLUE PR - PURPLE CY - GREY W - WHITE	T - TAN PK - PINK L - LAVENDER	

4100-306