
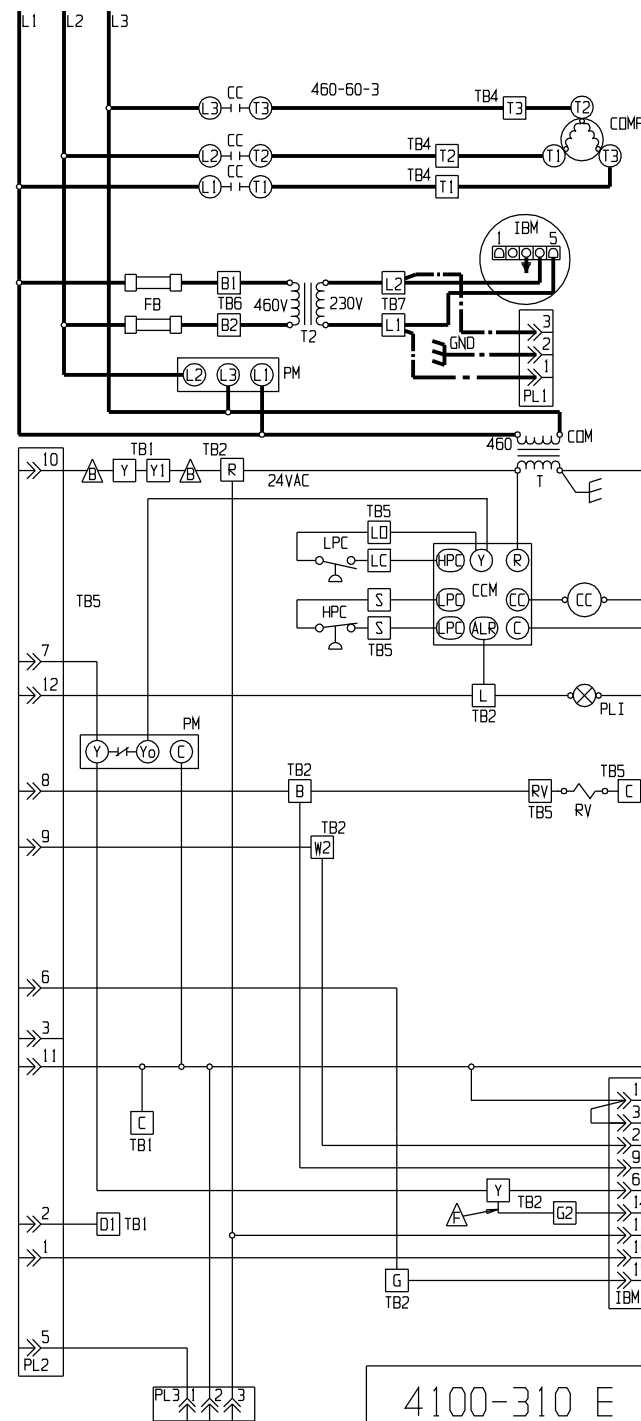


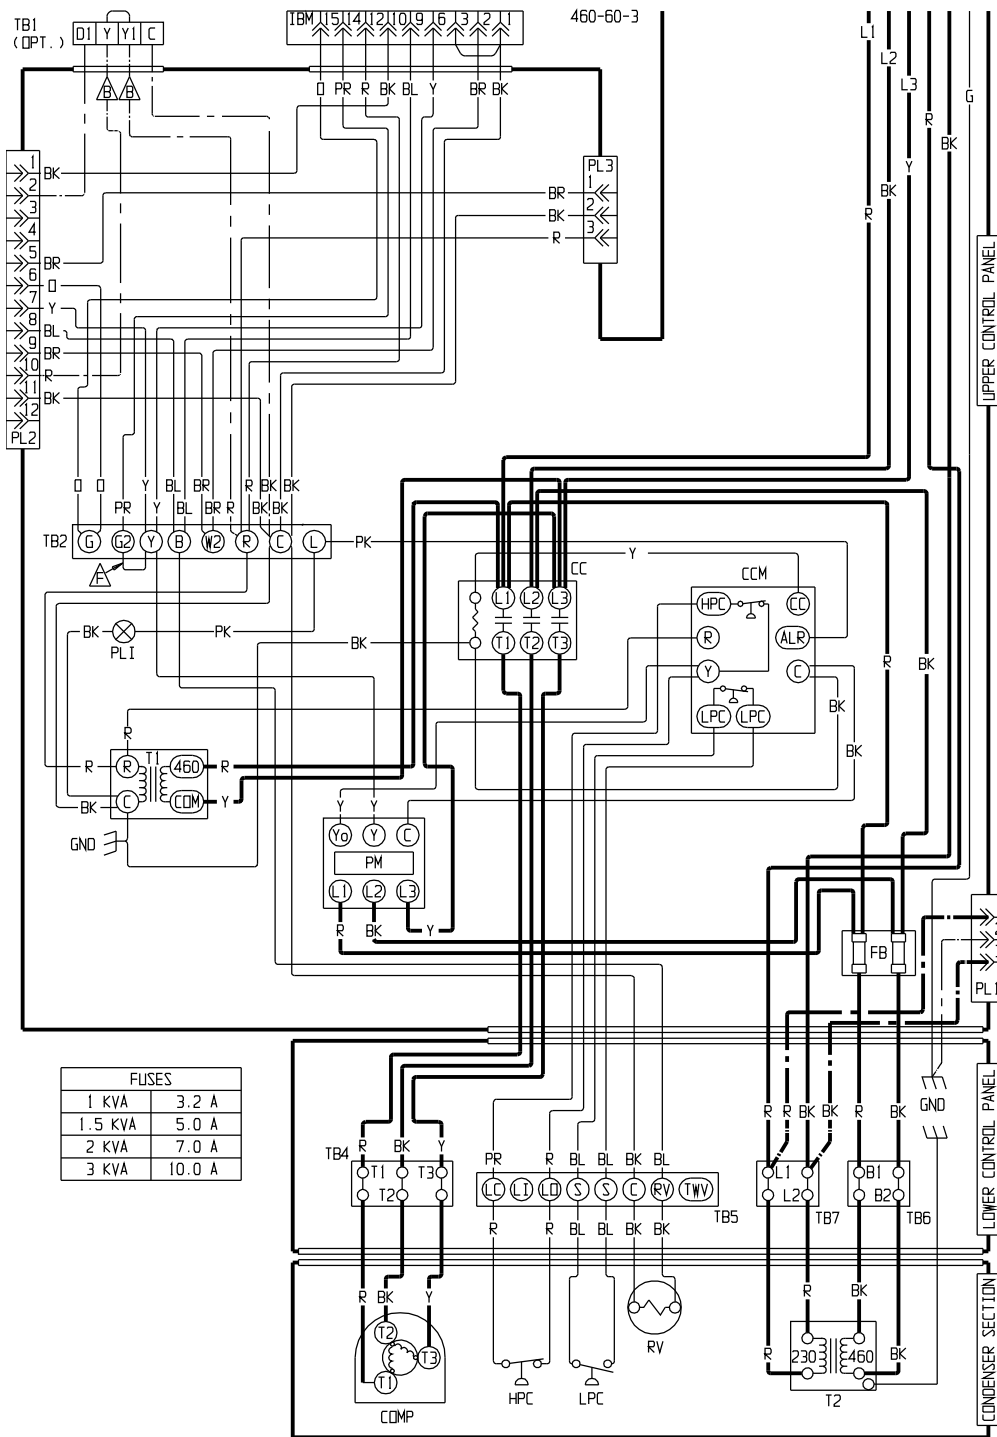

| COMPONENT CODE |                            |  |  |
|----------------|----------------------------|--|--|
| CB1            | CIRCUIT BREAKER #1         |  |  |
| CB2            | CIRCUIT BREAKER #2         |  |  |
| CC             | COMPRESSOR CONTACTOR       |  |  |
| CCM            | COMPRESSOR CONTROL MODULE  |  |  |
| COMP           | COMPRESSOR                 |  |  |
| DCC            | DUAL CAN CAPACITOR         |  |  |
| DFC            | DEFROST CONTROL            |  |  |
| DFS            | DEFROST SENSOR             |  |  |
| FB             | FUSE BLOCK                 |  |  |
| GND            | GROUND                     |  |  |
| HC1            | HEATER CONTACTOR #1        |  |  |
| HC2            | HEATER CONTACTOR #2        |  |  |
| HPC            | HIGH PRESSURE CONTROL      |  |  |
| HS1            | HEAT STRIP #1              |  |  |
| HS2            | HEAT STRIP #2              |  |  |
| IBM            | INDOOR BLOWER MOTOR        |  |  |
| LAB            | LOW AMBIENT BYPASS         |  |  |
| LAC            | LOW AMBIENT CONTROL        |  |  |
| LPB            | LOW PRESSURE BYPASS        |  |  |
| LPC            | LOW PRESSURE CONTROL       |  |  |
| LS             | LIMIT SWITCH               |  |  |
| OFM            | OUTDOOR FAN MOTOR          |  |  |
| OMR            | OUTDOOR MOTOR RELAY        |  |  |
| P1             | ACCESSORY PLUG #1          |  |  |
| P2             | ACCESSORY PLUG #2          |  |  |
| P3             | ACCESSORY PLUG #3          |  |  |
| PLI            | PRESSURE LOCKOUT INDICATOR |  |  |
| PM             | PHASE MONITOR              |  |  |
| RV             | REV. VALVE SOLINOID        |  |  |
| SR             | STAGING RELAY              |  |  |
| T1             | TRANSFORMER #1             |  |  |
| T2             | TRANSFORMER #2             |  |  |
| TB1            | TERMINAL BLOCK #1          |  |  |
| TB2            | TERMINAL BLOCK #2          |  |  |
| TB3            | TERMINAL BLOCK #3          |  |  |
| TB4            | TERMINAL BLOCK #4          |  |  |
| TB5            | TERMINAL BLOCK #5          |  |  |
| TB6            | TERMINAL BLOCK #6          |  |  |
| TB7            | TERMINAL BLOCK #7          |  |  |
| TWV            | THREE WAY VALVE            |  |  |

|                                                                          |  |  |  |
|--------------------------------------------------------------------------|--|--|--|
| Labeled wires connect if no options used.                                |  |  |  |
| Move red wire to 208V tap for 208V operation.                            |  |  |  |
| Install jumper for high speed blower oper. on models 36, 42, 48, and 60. |  |  |  |
| Remove jumper when LAC is installed.                                     |  |  |  |

| WIRING CODE  |              |       |          |
|--------------|--------------|-------|----------|
|              | FACTORY STD. | FIELD | OPTIONAL |
| HIGH VOLTAGE |              |       |          |
| LOW VOLTAGE  |              |       |          |
| ACCESSORY    |              |       |          |

| COLOR CODE |        |    |        |
|------------|--------|----|--------|
| BK         | BLACK  | PK | PINK   |
| BL         | BLUE   | PR | PURPLE |
| BR         | BROWN  | R  | RED    |
| G          | GREEN  | T  | TAN    |
| GY         | GRAY   | Y  | YELLOW |
| O          | ORANGE |    |        |

4100-310 E