


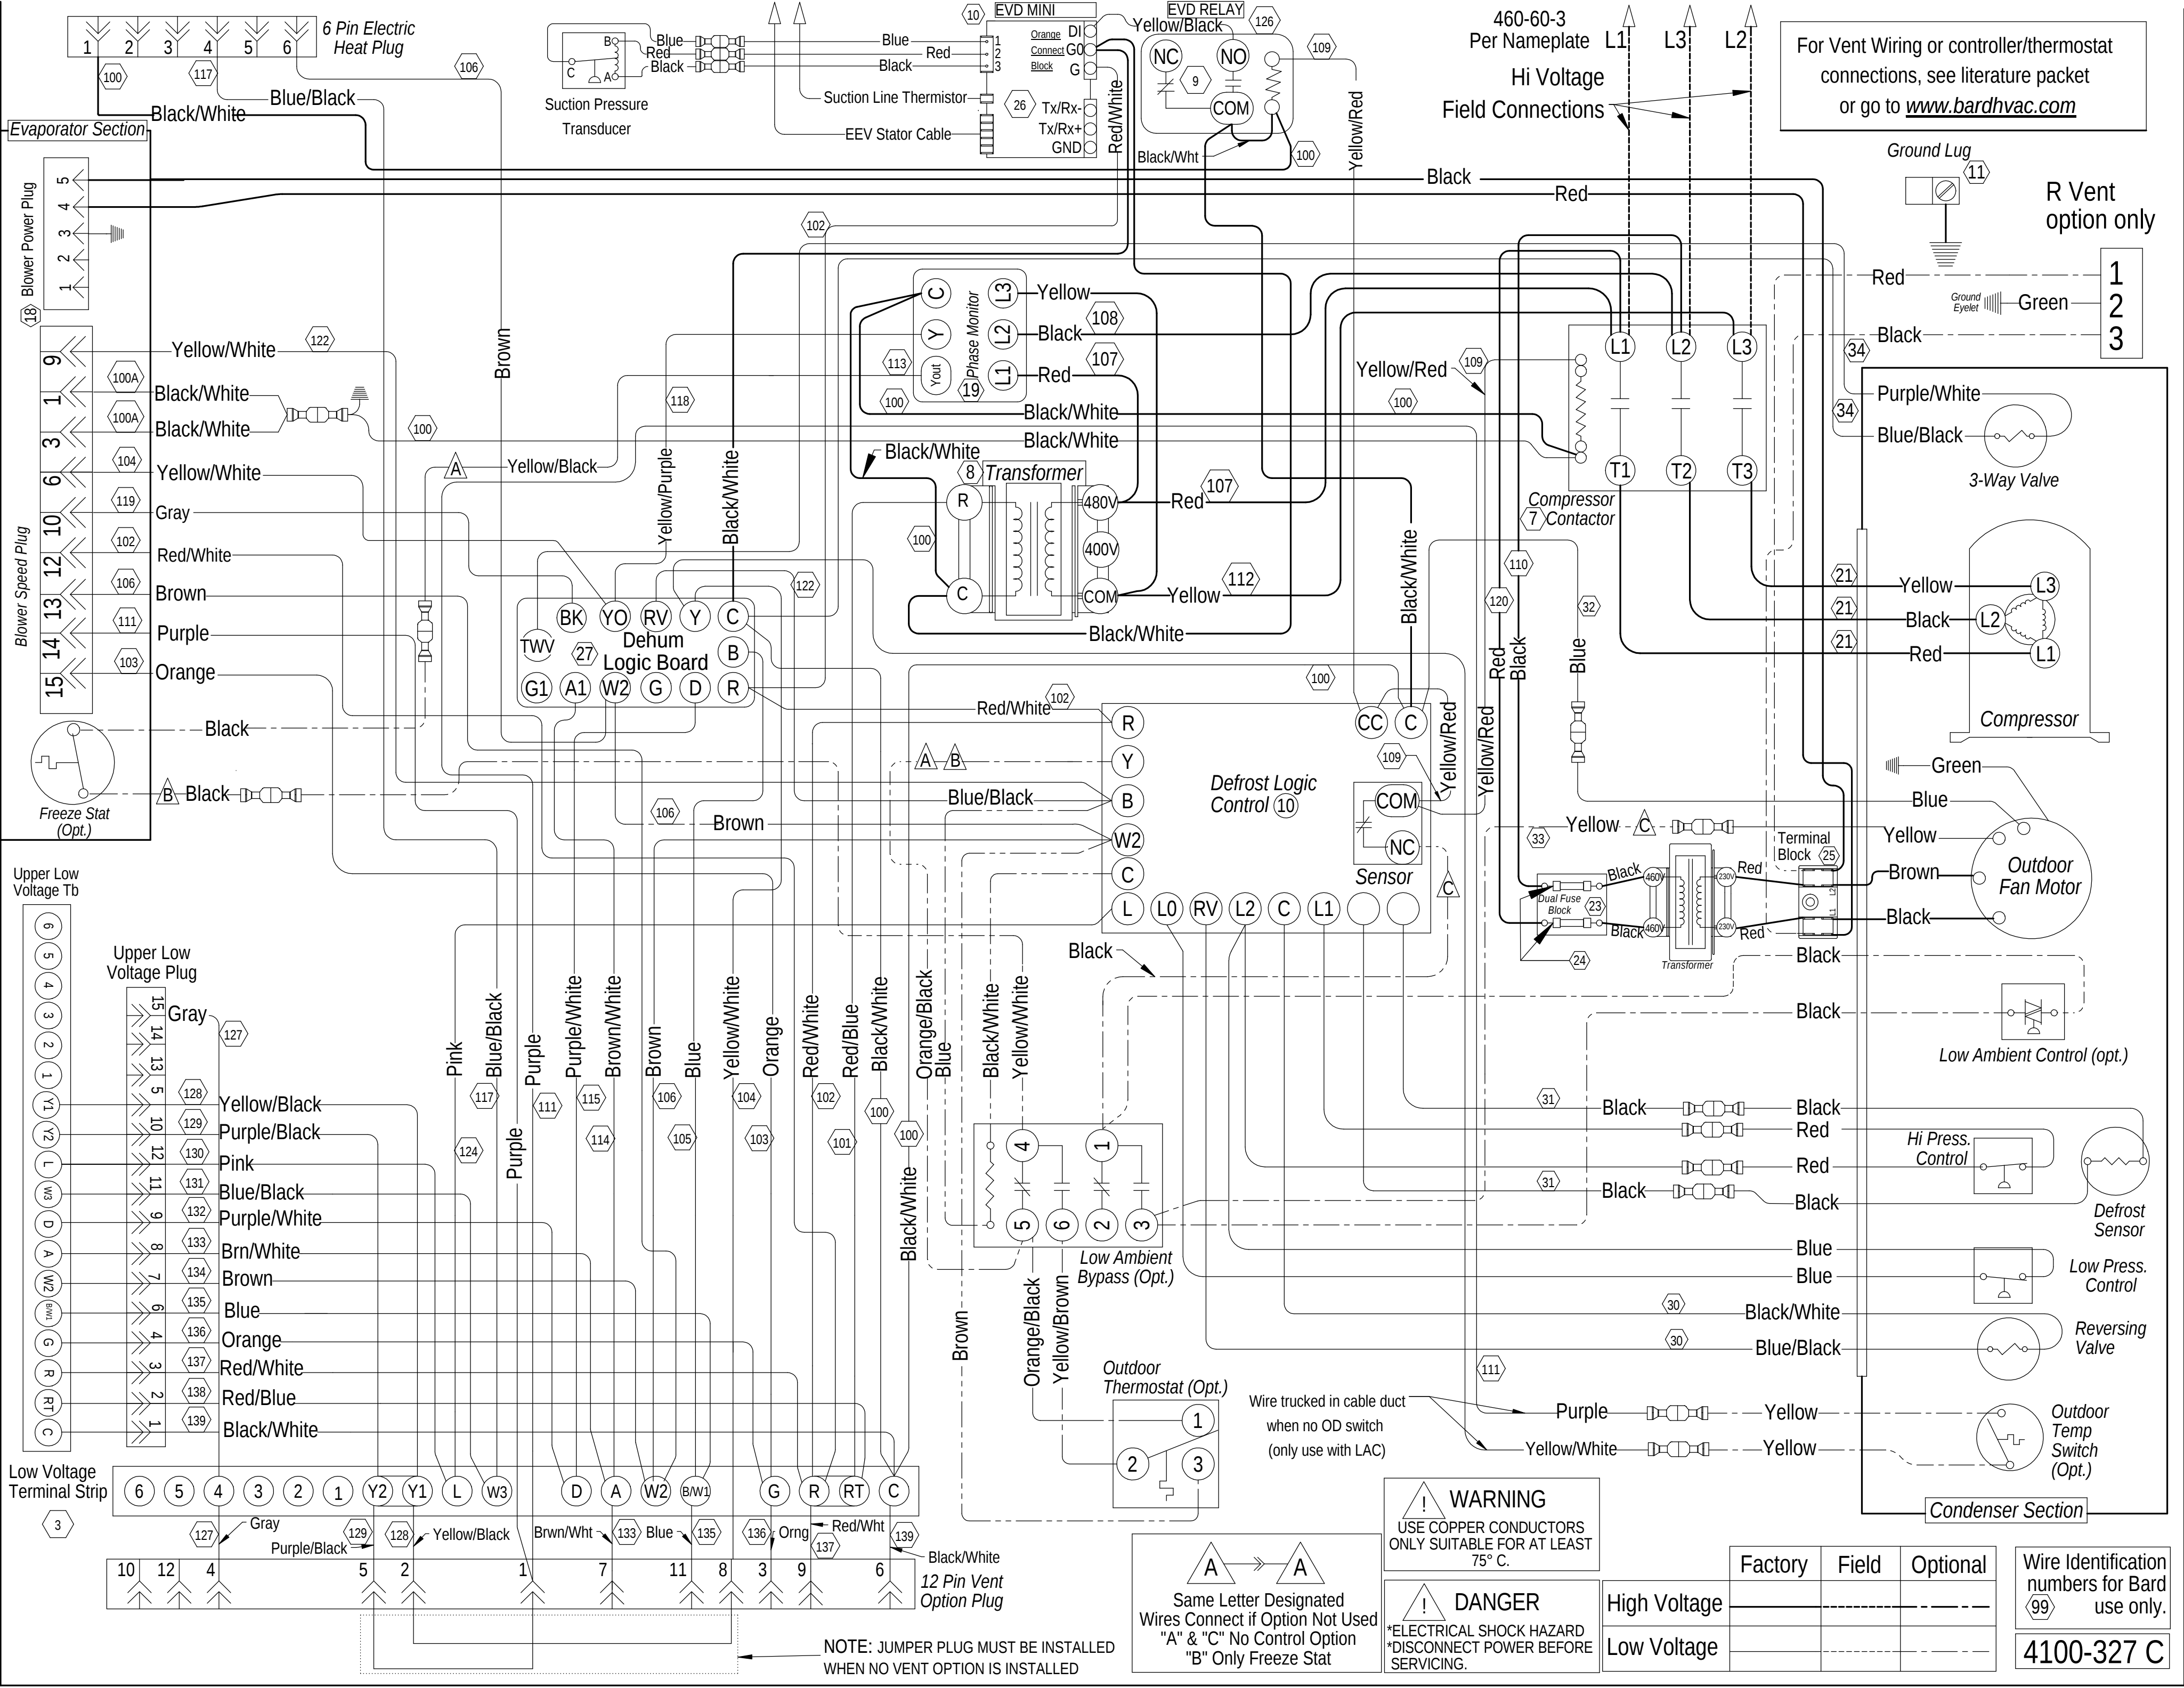

For Vent Wiring or controller/thermostat connections, see literature packet or go to www.bardhvac.com

R Vent option only

460-60-3
Per Nameplate
Hi Voltage
Field Connections

Ground Lug

Ground Eyelet

3-Way Valve

Compressor

Outdoor Fan Motor

Low Ambient Control (opt.)

Hi Press. Control

Defrost Sensor

Low Press. Control

Reversing Valve

Outdoor Temp Switch (Opt.)

Condenser Section

WARNING
USE COPPER CONDUCTORS
ONLY SUITABLE FOR AT LEAST
75° C.

DANGER
*ELECTRICAL SHOCK HAZARD
*DISCONNECT POWER BEFORE
SERVICING.

A → A
Same Letter Designated
Wires Connect if Option Not Used
"A" & "C" No Control Option
"B" Only Freeze Stat

	Factory	Field	Optional
High Voltage			
Low Voltage			

Wire Identification numbers for Bard use only.
4100-327 C

NOTE: JUMPER PLUG MUST BE INSTALLED WHEN NO VENT OPTION IS INSTALLED