


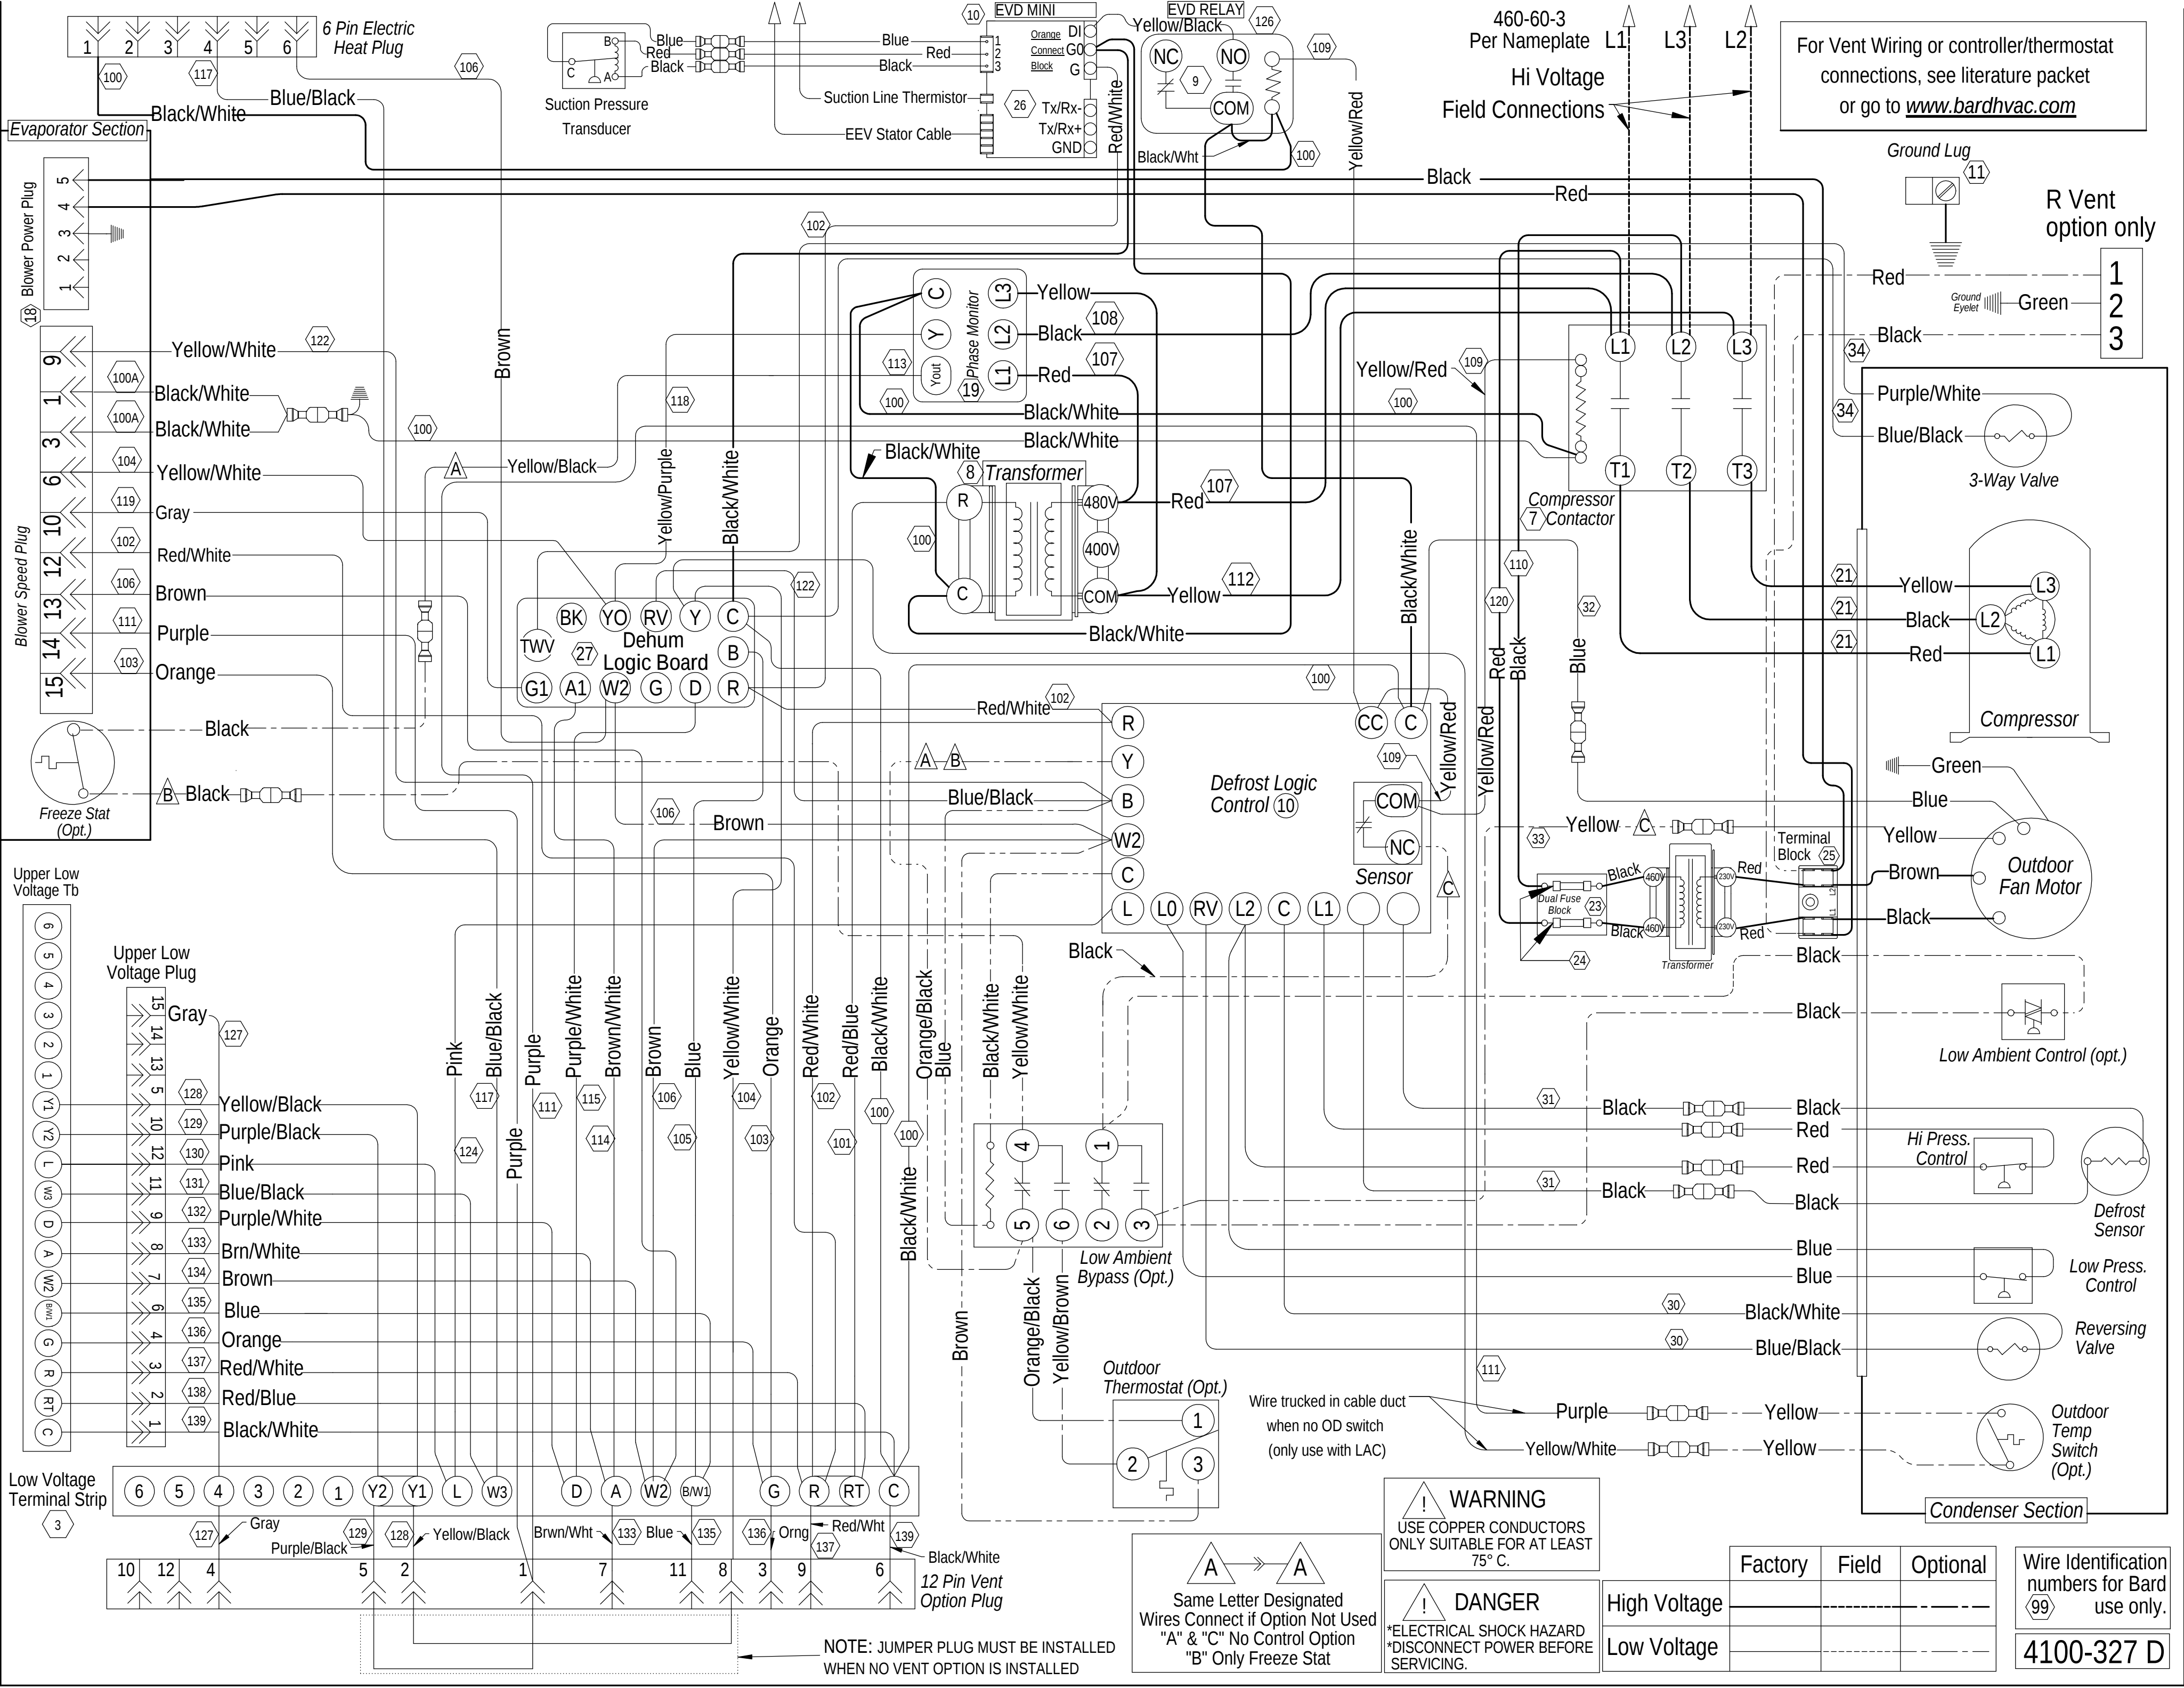

For Vent Wiring or controller/thermostat connections, see literature packet or go to www.bardhvac.com

R Vent option only

460-60-3
Per Nameplate
Hi Voltage
Field Connections

Ground Lug
(11)

1
2
3
Ground Eyelet
Green

34
Purple/White
Blue/Black
3-Way Valve

Compressor
L1
L2
L3
Yellow
Black
Red

Outdoor Fan Motor
Green
Blue
Yellow
Brown
Black

Low Ambient Control (opt.)

Hi Press. Control
Defrost Sensor

Low Press. Control

Reversing Valve

Outdoor Temp Switch (Opt.)

Condenser Section

WARNING
USE COPPER CONDUCTORS
ONLY SUITABLE FOR AT LEAST
75° C.

DANGER
*ELECTRICAL SHOCK HAZARD
*DISCONNECT POWER BEFORE
SERVICING.

	Factory	Field	Optional
High Voltage			
Low Voltage			

Wire Identification numbers for Bard use only.
4100-327 D

A → A
Same Letter Designated
Wires Connect if Option Not Used
"A" & "C" No Control Option
"B" Only Freeze Stat

NOTE: JUMPER PLUG MUST BE INSTALLED
WHEN NO VENT OPTION IS INSTALLED