



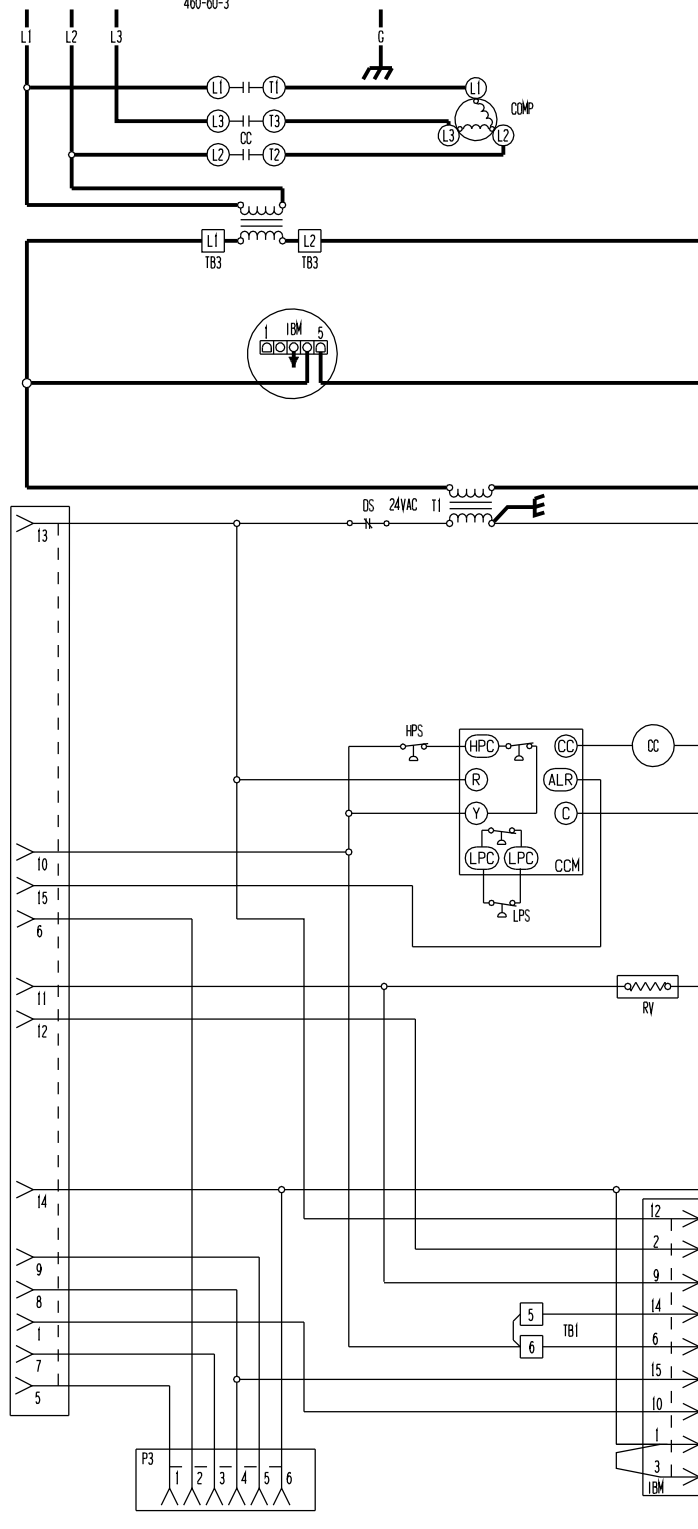

COMPONENT CODE

CC	COMPRESSOR CONTACTOR
CCM	COMPRESSOR CONTROL MODULE
CC	COMPRESSOR
DS	ODOR SWITCH
GND	GROUND
HPS	HIGH PRESSURE SWITCH
IBM	INDOOR BLOWER MOTOR
LPS	LOW PRESSURE SWITCH
P2	ACCESSORY PLUG #2
P3	ACCESSORY PLUG #3
PD	PULL DISCONNECT
RV	REV. VALVE SOLINOID
T1	TRANSFORMER #1
T2	TRANSFORMER #2
TB1	TERMINAL BLOCK #1
TB2	TERMINAL BLOCK #2
TB3	TERMINAL BLOCK #3

USE COPPER CONDUCTORS ONLY
SUITABLE FOR AT LEAST 75°C

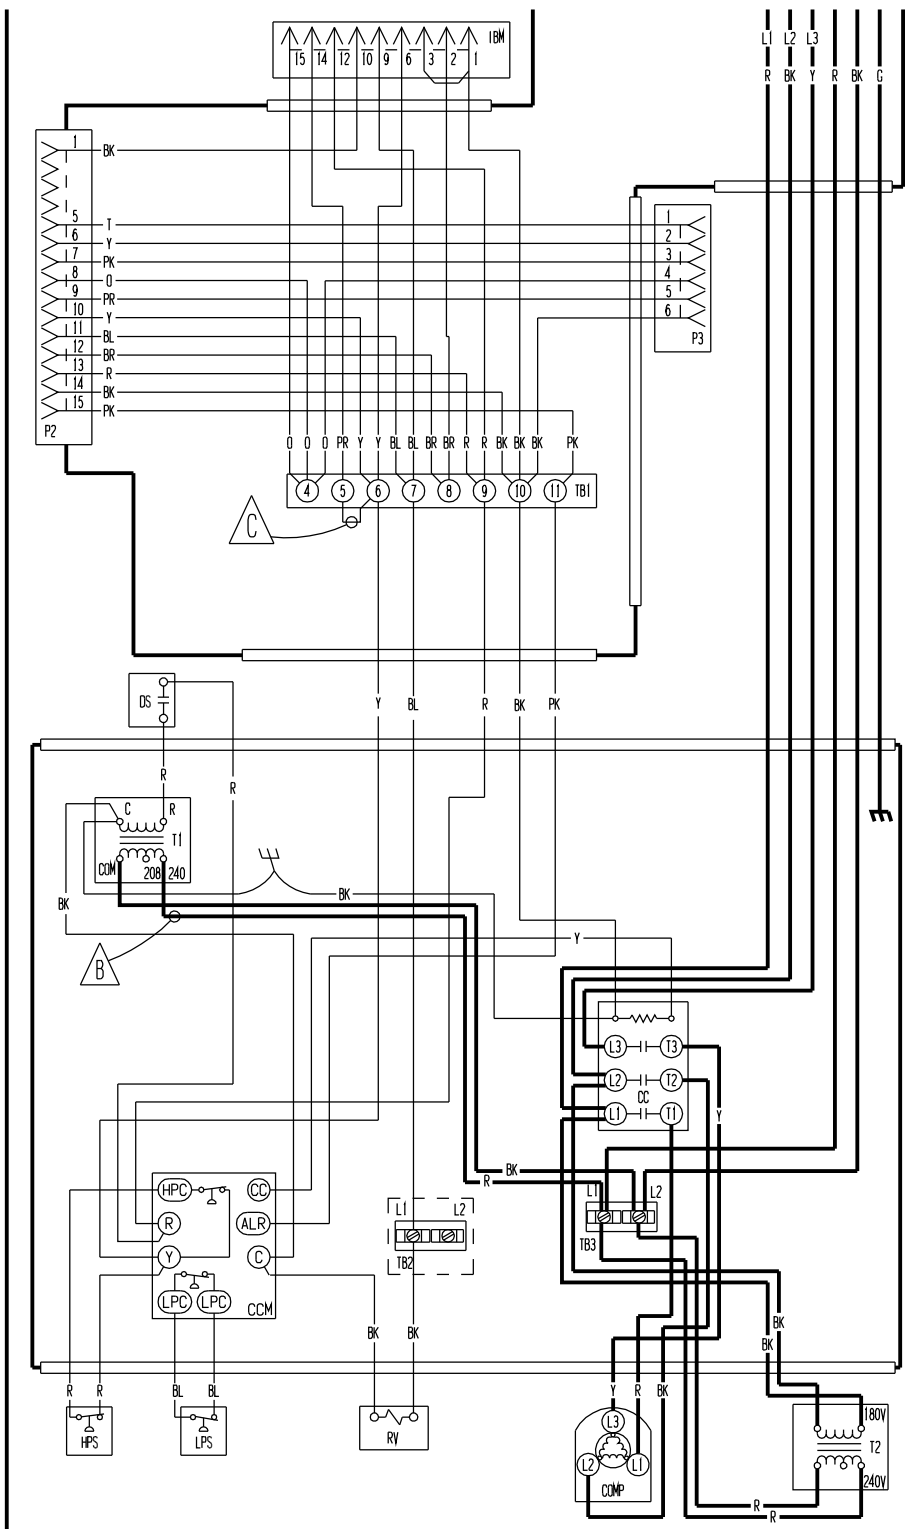

LABELLED WIRES CONNECT
IF NO OPTIONS USED.



MOVE RED WIRE TO 208 V
TAP FOR 208 V OPERATION



REMOVE JUMPER FOR LOW
SPEED BLOWER OPERATION

	FACTORY STD.	FIELD	OPTIONAL
HIGH VOLTAGE			
LOW VOLTAGE			
ACCESSORY			
BK - BLACK BN - BROWN R - RED O - ORANGE Y - YELLOW	G - GREEN BL - BLUE PR - PURPLE CY - GREY W - WHITE	T - TAN PK - PINK L - LAVENDER	

4100-801