



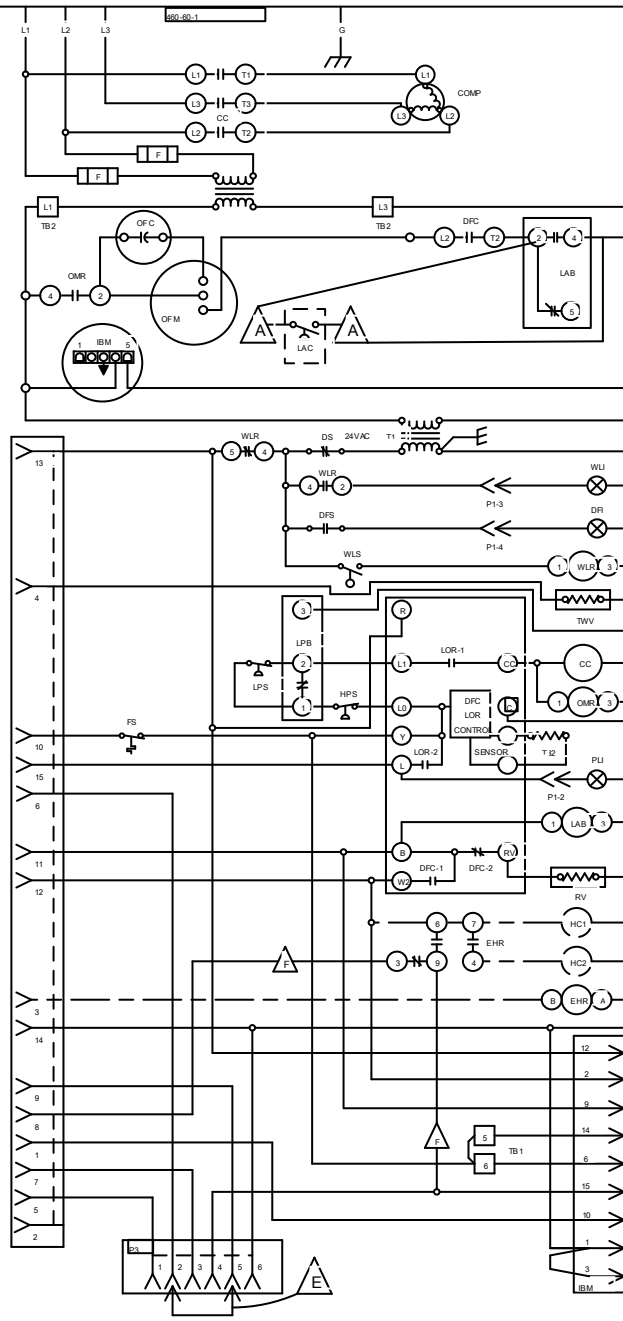

COMPONENT CODE

CB1 CIRCUIT BREAKER #1
 CB2 CIRCUIT BREAKER #2
 CC COMPRESSOR CONTACTOR
 COMP COMPRESSOR
 DFC DEFROST CONTROL
 DFI DIRTY FILTER INDICATOR
 DFS DIRTY FILTER SWITCH
 DS DOOR SWITCH
 EHR EMERGENCY HEAT RELAY
 F FUSE CLASS CC5A OR CC7A
 FS FREEZE UP THERMOSTAT
 GND GROUND
 HC1 HEATER CONTACTOR #1
 HC2 HEATER CONTACTOR #2
 HPS HIGH PRESSURE SWITCH
 HS1 HEAT STRIP #1
 HS2 HEAT STRIP #2
 IBM INDOOR BLOWER MOTOR
 LAB LOW AMBIENT BYPASS
 LAC LOW AMBIENT CONTROL
 LPB LOW PRESSURE BYPASS
 LPS LOW PRESSURE SWITCH
 LS LIMIT SWITCH
 ODC OUTDOOR FAN CAPACITOR
 OFM OUTDOOR FAN MOTOR
 OMT OUTDOOR MOTOR THERMOSTAT
 P1 ACCESSORY PLUG #1
 P2 ACCESSORY PLUG #2
 P3 ACCESSORY PLUG #3
 PU PRESSURE LOCKOUT INDICATOR
 RV REV. VALVE SOINOID
 T1 TRANSFORMER #1
 T2 TRANSFORMER #2
 TB1 TERMINAL BLOCK #1
 TB2 TERMINAL BLOCK #2
 TB4 TERMINAL BLOCK #4
 TWV THREE WAY VALVE
 OMR OUTDOOR MOTOR RELAY
 WLI HIGH WATER LEVEL INDICATOR
 WLR WATER LEVEL RELAY
 WLS WAT

USE COPPER CONDUCTORS ONLY
SUITABLE FOR AT LEAST 75°C

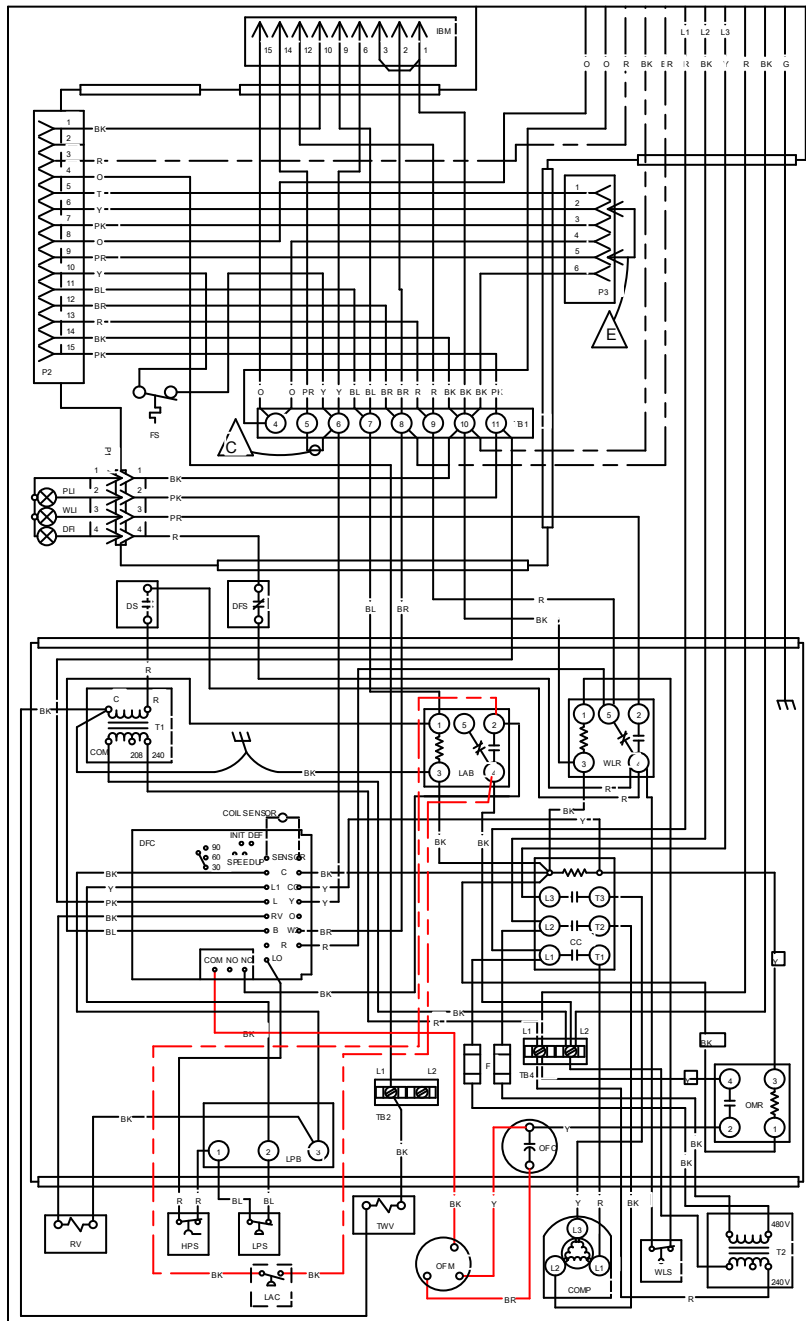

LABELED WIRES CONNECT
IF NO OPTIONS USED.



INSTALL JUMPER FOR HIGH SPEED
BLOWER OPERATION ON MODELS 36 & 42



IF VENT OPTION IS INSTALLED, PLUG
WITH JUMPER 2 TO 5 IS REMOVED &
PLUG FROM VENT OPTION INSERTED

FACTORY FIELD OPTIONAL
STD.

HIGH VOLTAGE

LOW VOLTAGE

ACCESSORY

BK - BLACK G - GREEN T - TAN
 BN - BROWN BL - BLUE PK - PINK
 R - RED PR - PURPLE LV - LAVENDER
 O - ORANGE GR - GREY
 Y - YELLOW W - WHITE

4100-804