

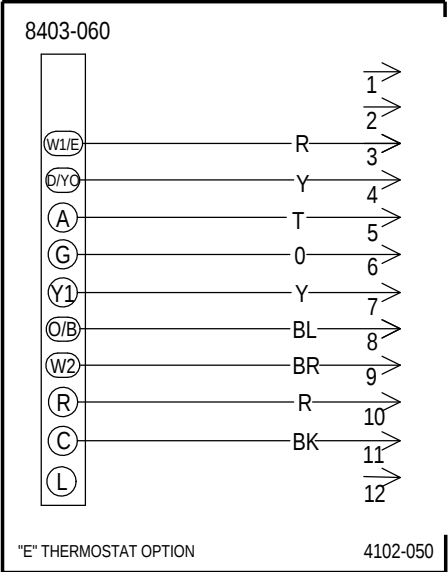
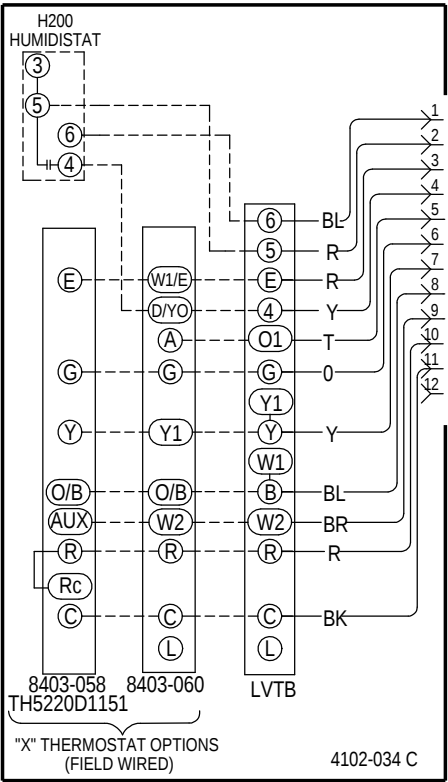
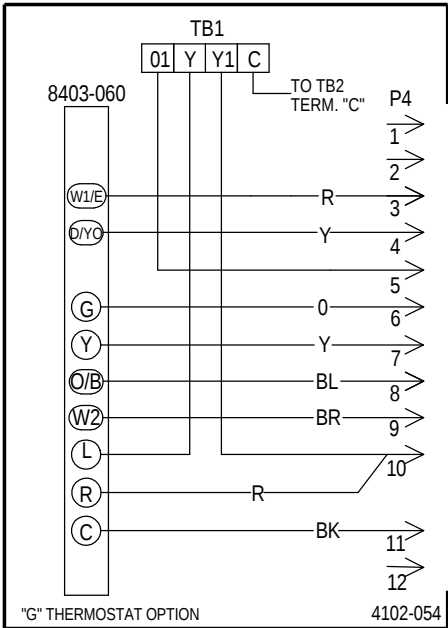


COMPOSITE WIRING DIAGRAM QW DEHUMIDIFICATION SERIES 2
230/208/60-1, REPRESENTS UNIT WITH CIRCUIT BREAKER KIT.

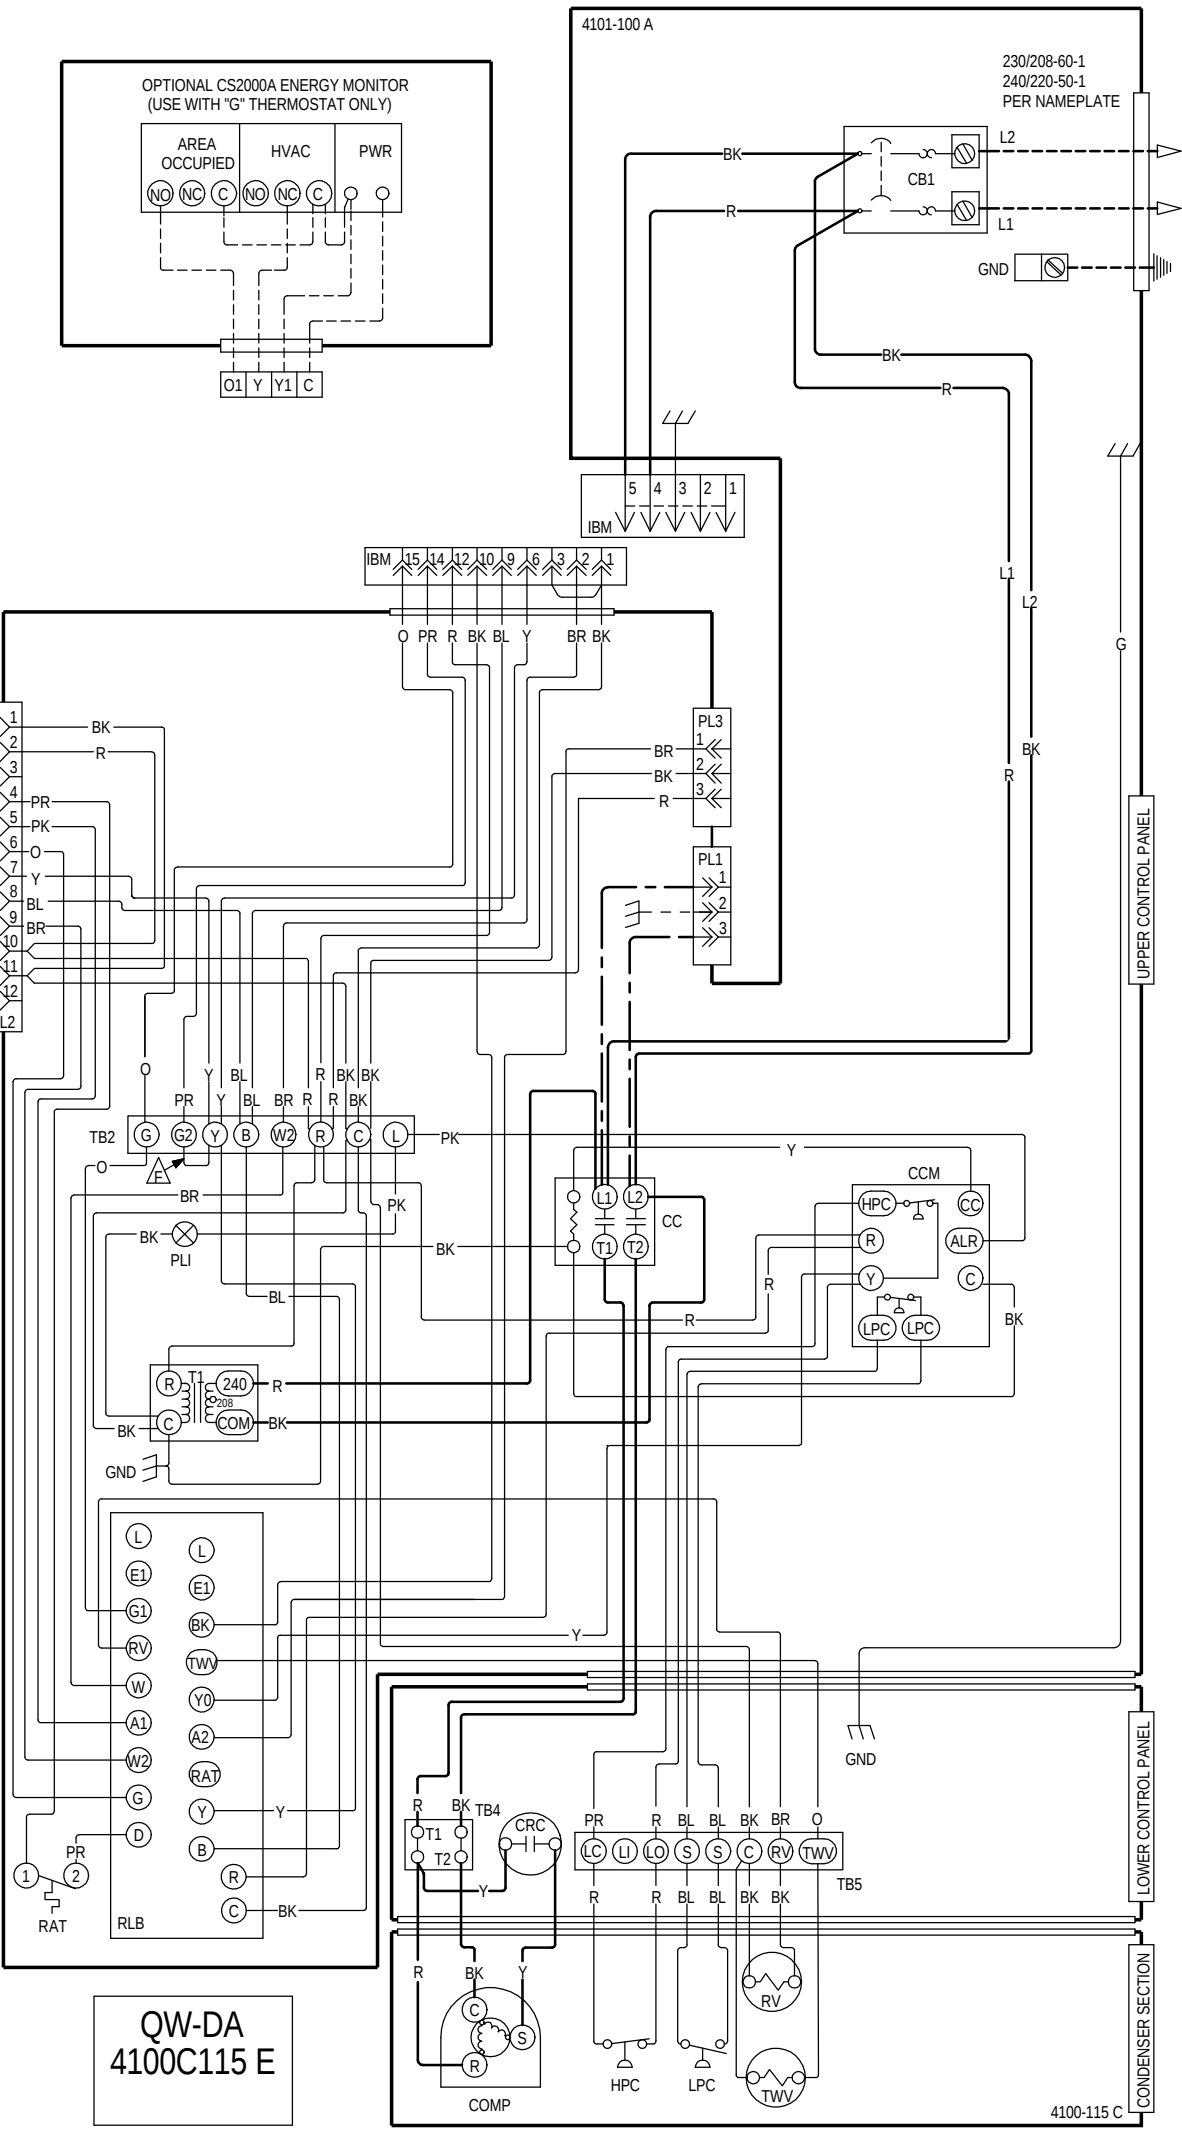

"E" AND "G" ARE FACTORY WIRED THERMOSTAT OPTIONS

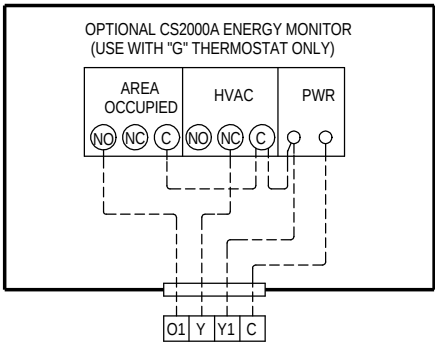

COMPONENT CODE	
CB1	CIRCUIT BREAKER #1
CB2	CIRCUIT BREAKER #2
CC	COMPRESSOR CONTACTOR
CCM	COMPRESSOR CONTROL MODULE
COMP	COMPRESSOR
CRC	COMPRESSOR RUN CAPACITOR
FB	FUSE BLOCK
GND	GROUND
HPC	HIGH PRESSURE CONTROL
HS1	HEAT STRIP #1
HS2	HEAT STRIP #2
IBM	INDOOR BLOWER MOTOR
LPB	LOW PRESSURE BYPASS
LPC	LOW PRESSURE CONTROL
OFM	OUTDOOR FAN MOTOR
OMR	OUTDOOR MOTOR RELAY
P1	ACCESSORY PLUG #1
P2	ACCESSORY PLUG #2
P3	ACCESSORY PLUG #3
PLI	PRESSURE LOCKOUT INDICATOR
PM	PHASE MONITOR
RAT	RETURN AIR TSTAT
RLB	RELAY LOGIC BOARD
RV	REV. VALVE SOLINOID
T1	TRANSFORMER #1
T2	TRANSFORMER #2
TB1	TERMINAL BLOCK #1
TB2	TERMINAL BLOCK #2
TB3	TERMINAL BLOCK #3
TB4	TERMINAL BLOCK #4
TB5	TERMINAL BLOCK #5
TB6	TERMINAL BLOCK #6
TB7	TERMINAL BLOCK #7
TWV	THREE WAY VALVE

 LABELED WIRES CONNECT
IF NO OPTIONS USED.

 MOVE RED WIRE TO 208V TAP
FOR 208V OPERATION **1**

△ INSTALL JUMPER FOR HIGH SPEED BLOWER OPER. ON MODELS 36, 42, 48, AND 60

 REMOVE JUMPER WHEN LAC IS INSTALLED

WIRING CODE				
	FACTORY STD.	FIELD	OPTIONAL	
HIGH VOLTAGE				
LOW VOLTAGE				
ACCESSORY				

COLOR CODE			
BK	BLACK	PK	PINK
BL	BLUE	PR	PURPLE
BR	BROWN	R	RED
G	GREEN	T	TAN
GY	GRAY	Y	YELLOW
O	ORANGE		