
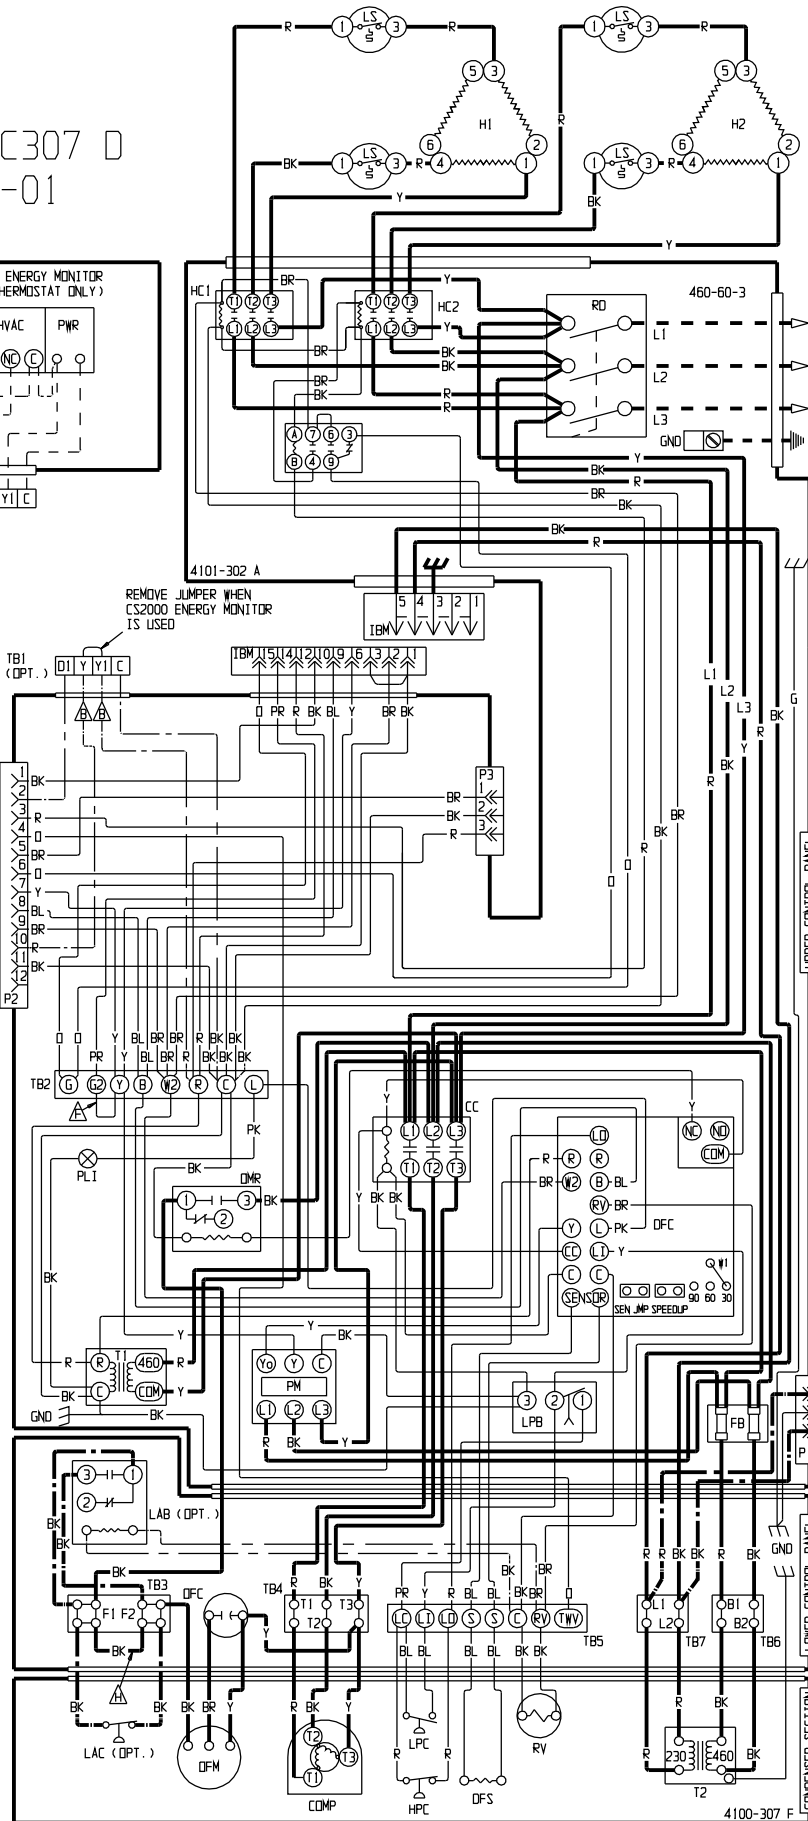
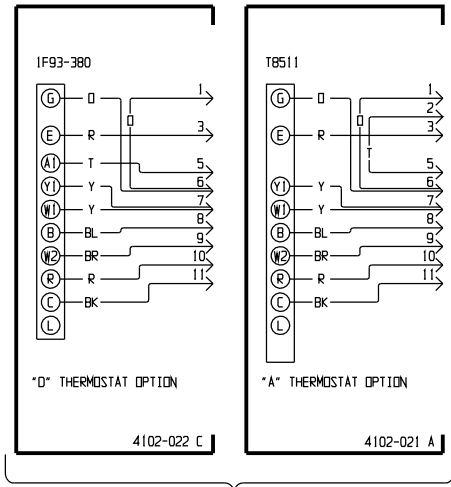
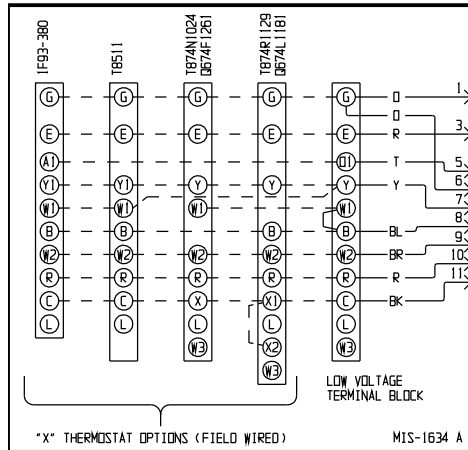


QH-C
4100C307 D
5-26-01

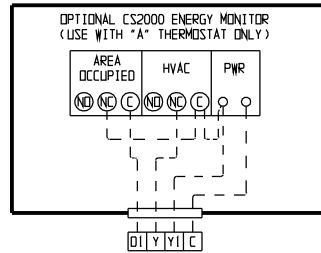

COMPONENT CODE			
CB1	CIRCUIT BREAKER #1		
CB2	CIRCUIT BREAKER #2		
CC	COMPRESSOR CONTACTOR		
COMP	COMPRESSOR		
DCC	DUAL CAN CAPACITOR		
DFC	DEFROST CONTROL		
DFS	DEFROST SENSOR		
FB	FUSE BLOCK		
GND	GROUND		
H1	HEATER CONTACTOR #1		
H2	HEATER CONTACTOR #2		
HPC	HIGH PRESSURE CONTROL		
H51	HEAT STRIP #1		
H52	HEAT STRIP #2		
IBM	INDOOR BLOWER MOTOR		
LAB	LOW AMBIENT BYPASS		
LAC	LOW AMBIENT CONTROL		
LPB	LOW PRESSURE BYPASS		
LPC	LOW PRESSURE CONTROL		
LS	LIMIT SWITCH		
DFC	OUTDOOR FAN CAPACITOR		
DFM	OUTDOOR FAN MOTOR		
DMR	OUTDOOR MOTOR RELAY		
P1	ERV (HV) ACCESSORY PLUG		
P2	CLIMATE CONTROL PLUG		
P3	VENT (LV) ACCESSORY PLUG		
PLI	PRESSURE LOCKOUT INDICATOR		
PM	PHASE MONITOR		
RD	ROTARY DISCONNECT		
RV	REV. VALVE SOLINOID		
T1	TRANSFORMER #1		
T2	TRANSFORMER #2		
TB1	TERMINAL BLOCK #1		
TB2	TERMINAL BLOCK #2		
TB3	TERMINAL BLOCK #3		
TB4	TERMINAL BLOCK #4		
TB5	TERMINAL BLOCK #5		
TB6	TERMINAL BLOCK #6		
TB7	TERMINAL BLOCK #7		
TVV	THREE WAY VALVE		
 LABELED WIRES CONNECT IF NO OPTIONS USED.			
 MOVE RED WIRE TO 208V TAP FOR 208V OPERATION			
 INSTALL JUMPER FOR HIGH SPEED BLOWER OPER. ON MODELS 36, 42, 48, AND 60			
(R VENT (PT) DUAL)	FUSES		
	1 KVA	3.2 A	
	1.5 KVA	5.0 A	
	2 KVA	7.0 A	
	3 KVA	10.0 A	
 REMOVE JUMPER WHEN LAC IS INSTALLED			
WIRING CODE			
	FACTORY STD.	FIELD	OPTIONAL
HIGH VOLTAGE		☒	☒
LOW VOLTAGE		☐	☐
ACCESSORY		☐	☒
COLOR CODE			
BK	BLACK	PK	PINK
BL	BLUE	PR	PURPLE
BR	BROWN	R	RED
G	GREEN	T	TAN
O	ORANGE	Y	YELLOW