

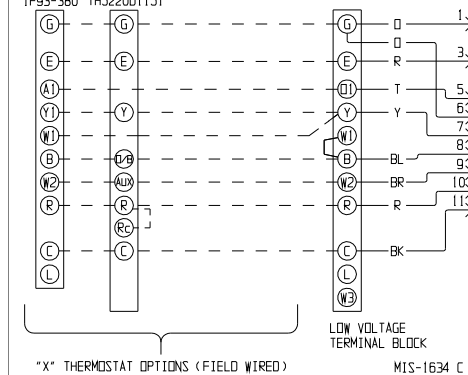




QH-C
4100C307 F

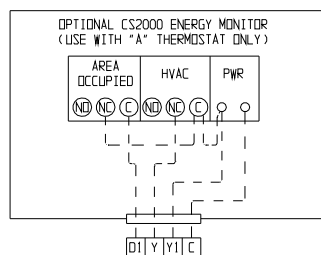

"X" THERMOSTAT OPTIONS (FIELD WIRED)




"D" THERMOSTAT OPTION



"A" THERMOSTAT PRISON

4102-022 C

FACTORY WIRED THERMOSTAT OPTIONS

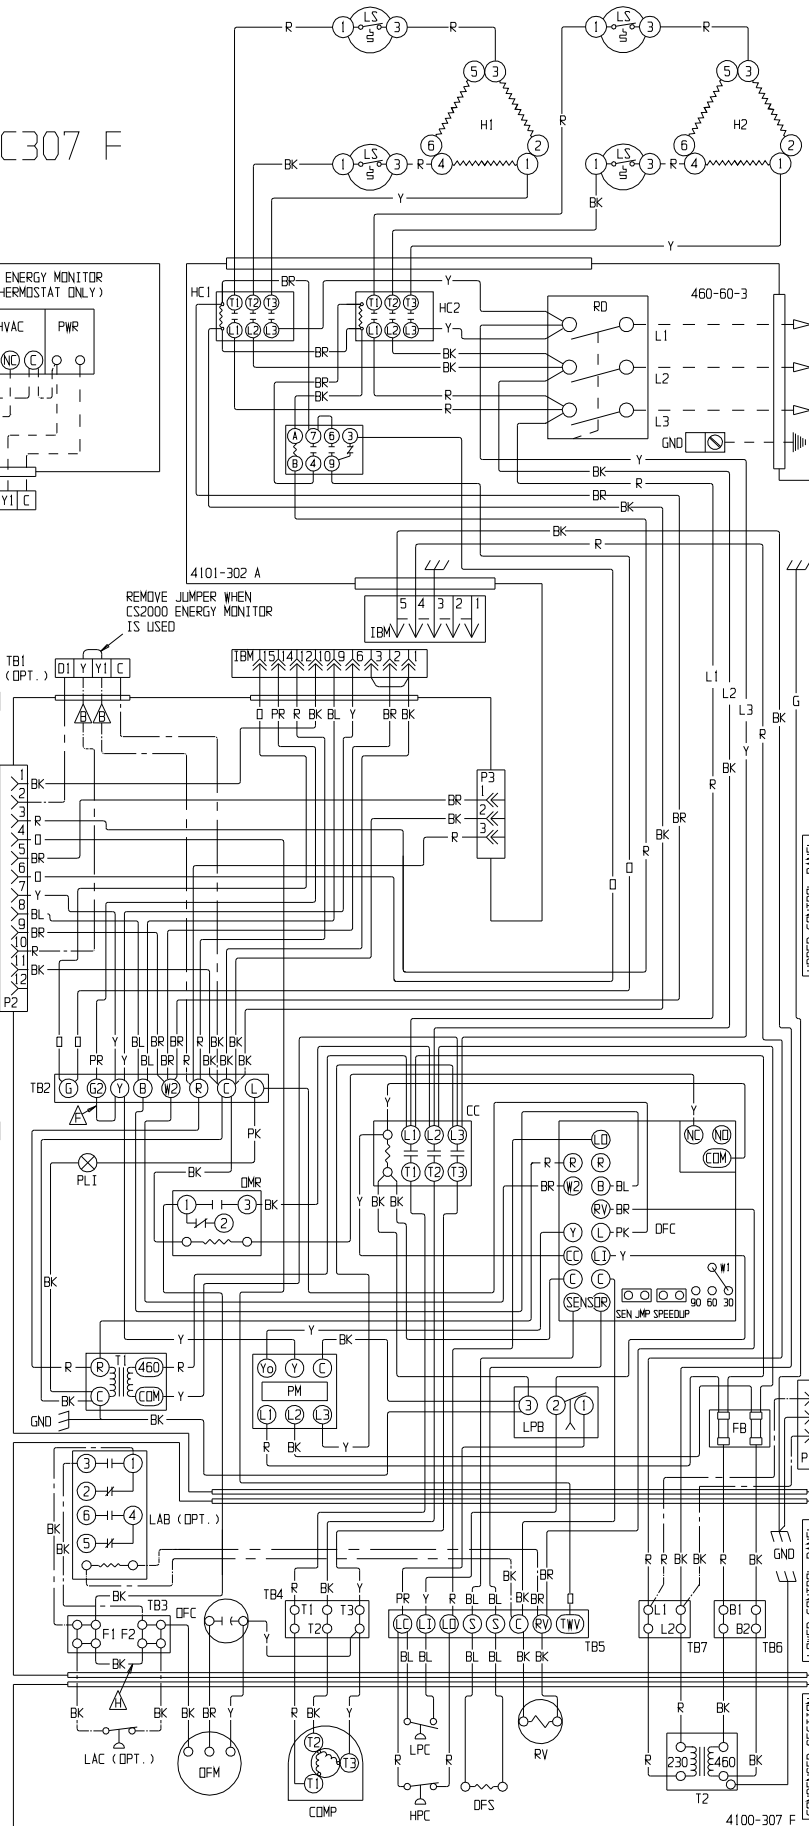

	COMPONENT CODE
C81	CIRCUIT BREAKER #1
C82	CIRCUIT BREAKER #2
CC	COMPRESSOR CONTACTOR
COMP	COMPRESSOR
DCC	DUAL CAN CAPACITOR
DFC	DEFROST CONTROL
DFS	DEFROST SENSOR
FB	FUSE BLOCK
GND	GROUND
H1	HEATER CONTACTOR #1
H2	HEATER CONTACTOR #2
HPC	HIGH PRESSURE CONTROL
H51	HEAT STRIP #1
H52	HEAT STRIP #2
IBM	INDOOR BLOWER MOTOR
LAB	LOW AMBIENT BYPASS
LAC	LOW AMBIENT CONTROL
LPB	LOW PRESSURE BYPASS
LPC	LOW PRESSURE CONTROL
LS	LIMIT SWITCH
DFC	OUTDOOR FAN CAPACITOR
DFM	OUTDOOR FAN MOTOR
DMR	OUTDOOR MOTOR RELAY
P1	ELIMINATOR ACCESSORY PLUG
P2	CLIMATE CONTROL PLUG
P3	VENT (LV) ACCESSORY PLUG
PLI	PRESSURE LOCKOUT INDICATOR
PM	PHASE MONITOR
RD	ROTARY DISCONNECT
RV	REL. VALVE SOL.INO
T1	TRANSFORMER #1
T2	TRANSFORMER #2
T81	TERMINAL BLOCK #1
T82	TERMINAL BLOCK #2
T83	TERMINAL BLOCK #3
T84	TERMINAL BLOCK #4
T85	TERMINAL BLOCK #5
T86	TERMINAL BLOCK #6
T87	TERMINAL BLOCK #7
TWV	THREE WAY VALVE

⚠ ⚠ ⚠ ⚠ LABELED WIRES CONNECT IF NO OPTIONS USED.

 MOVE RED WIRE TO 208V TAP
FOR 208V OPERATION

F INSTALL JUMPER FOR HIGH SPEED BLOWER OPER. ON MODELS 36, 42, 48 AND 60.

FUSES	
1 KVA	3.2 A
1.5 KVA	5.0 A
2 KVA	7.0 A
3 KVA	10.0 A

 REMOVE JUMPER WHEN LAC IS INSTALLED

WIRING CODE				
	FACTORY STD.		FIELD	OPTIONAL
HIGH VOLTAGE				
LOW VOLTAGE				
ACCESSORY				

COLOR CODE			
BK	BLACK	PK	PINK
BL	BLUE	PR	PURPLE
BR	BROWN	R	RED
G	GREEN	T	TAN
O	ORANGE	Y	YELLOW