

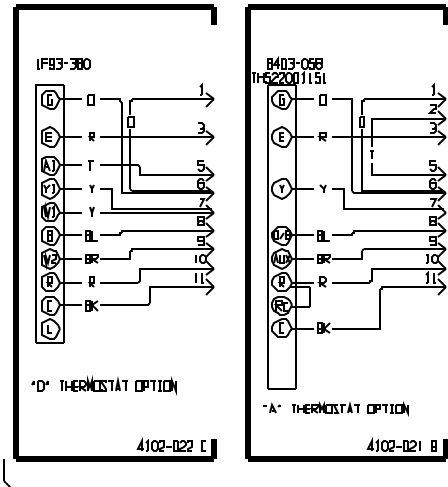
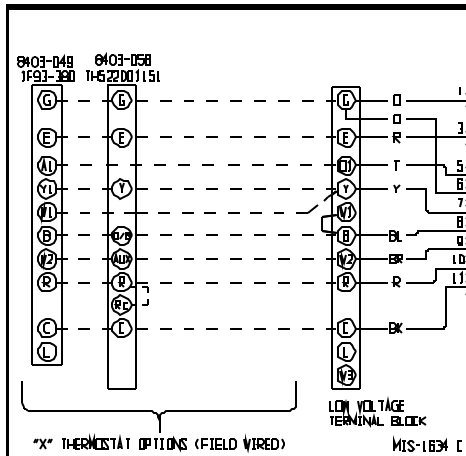


QHLC
4100C308 F

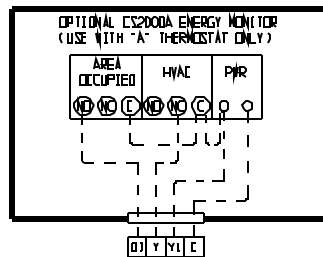

FACTORY WIRED THERMOSTAT OPTIONS

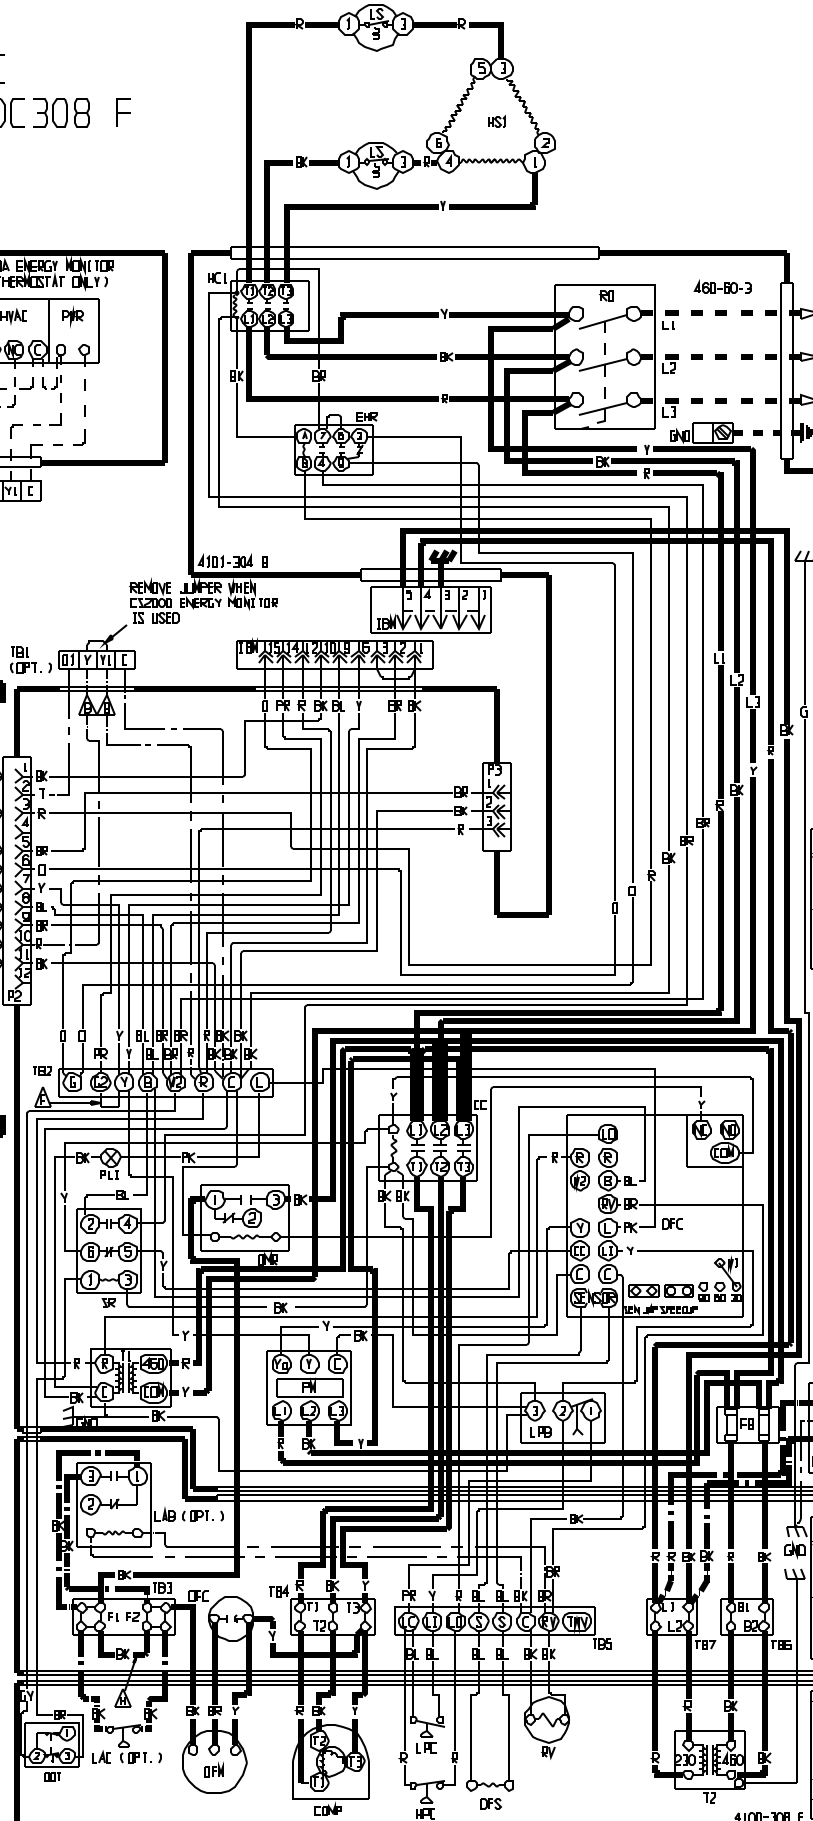

COMPONENT CODE	
CB1	CIRCUIT BREAKER #1
CB2	CIRCUIT BREAKER #2
CC	COMPRESSOR CONTACTOR
COMP	COMPRESSOR
CE	DUAL CAN CAPACITOR
CE1	DEFROST CONTROL
CE2	DEFROST SENSOR
FB	FUSE BLOCK
GND	GROUND
HC1	HEATER CONTACTOR #1
HC2	HEATER CONTACTOR #2
HPC	HIGH PRESSURE CONTROL
HS1	HEAT STRIP #1
HS2	HEAT STRIP #2
IBM	INDOOR BLOWER MOTOR
LAB	LOW AMBIENT BYPASS
LAC	LOW AMBIENT CONTROL
LPB	LOW PRESSURE BYPASS
LPC	LOW PRESSURE CONTROL
LS	LIMIT SWITCH
CEC	OUTDOOR CAN CAPACITOR
OFM	OUTDOOR FAN MOTOR
OMR	OUTDOOR MOTOR RELAY
P1	PHASE (HV) ACCESSORY PLUG
P2	CLIMATE CONTROL PLUG
P3	VENT (LV) ACCESSORY PLUG
PLI	PRESSURE LOCKOUT INDICATOR
PM	PHASE MONITOR
RD	ROTARY DISCONNECT
RY	REV. VALVE SOLINOID
SR	STAGING RELAY
T1	TRANSFORMER #1
T2	TRANSFORMER #2
TB1	TERMINAL BLOCK #1
TB2	TERMINAL BLOCK #2
TB3	TERMINAL BLOCK #3
TB4	TERMINAL BLOCK #4
TB5	TERMINAL BLOCK #5
TB6	TERMINAL BLOCK #6
TB7	TERMINAL BLOCK #7
TVV	THREE WAY VALVE

WIRE CONNECTIONS

WIRE CONNECTIONS
IF NO OPTIONS USED.

**⚠ MOVE RED WIRE TO 208V TAP
FOR 208V OPERATION**

⚠ INSTALL JUMPER FOR HIGH SPEED BLOWER OPER. ON MODELS 36, 42, 48, AND 60

1 2 3	(R VENT OPT. ONLY)	FUSES	
		1 KVA	3.2 A
		1.5 KVA	5.0 A
		2 KVA	7.0 A
		3 KVA	10.0 A

⚠ REMOVE JUMPER WHEN LAC IS INSTALLED

MIRING CODE			
	FACTORY STD.	FIELD	OPTIONAL
HIGH VOLTAGE	—	—	—
LOW VOLTAGE		—	—
ACCESSORY			—

COLOR CODE			
BK	BLACK	PK	PINK
BL	BLUE	PR	PURPLE
BR	BROWN	R	RED
G	GREEN	T	TAN
GY	GRAY	Y	YELLOW
O	ORANGE		