
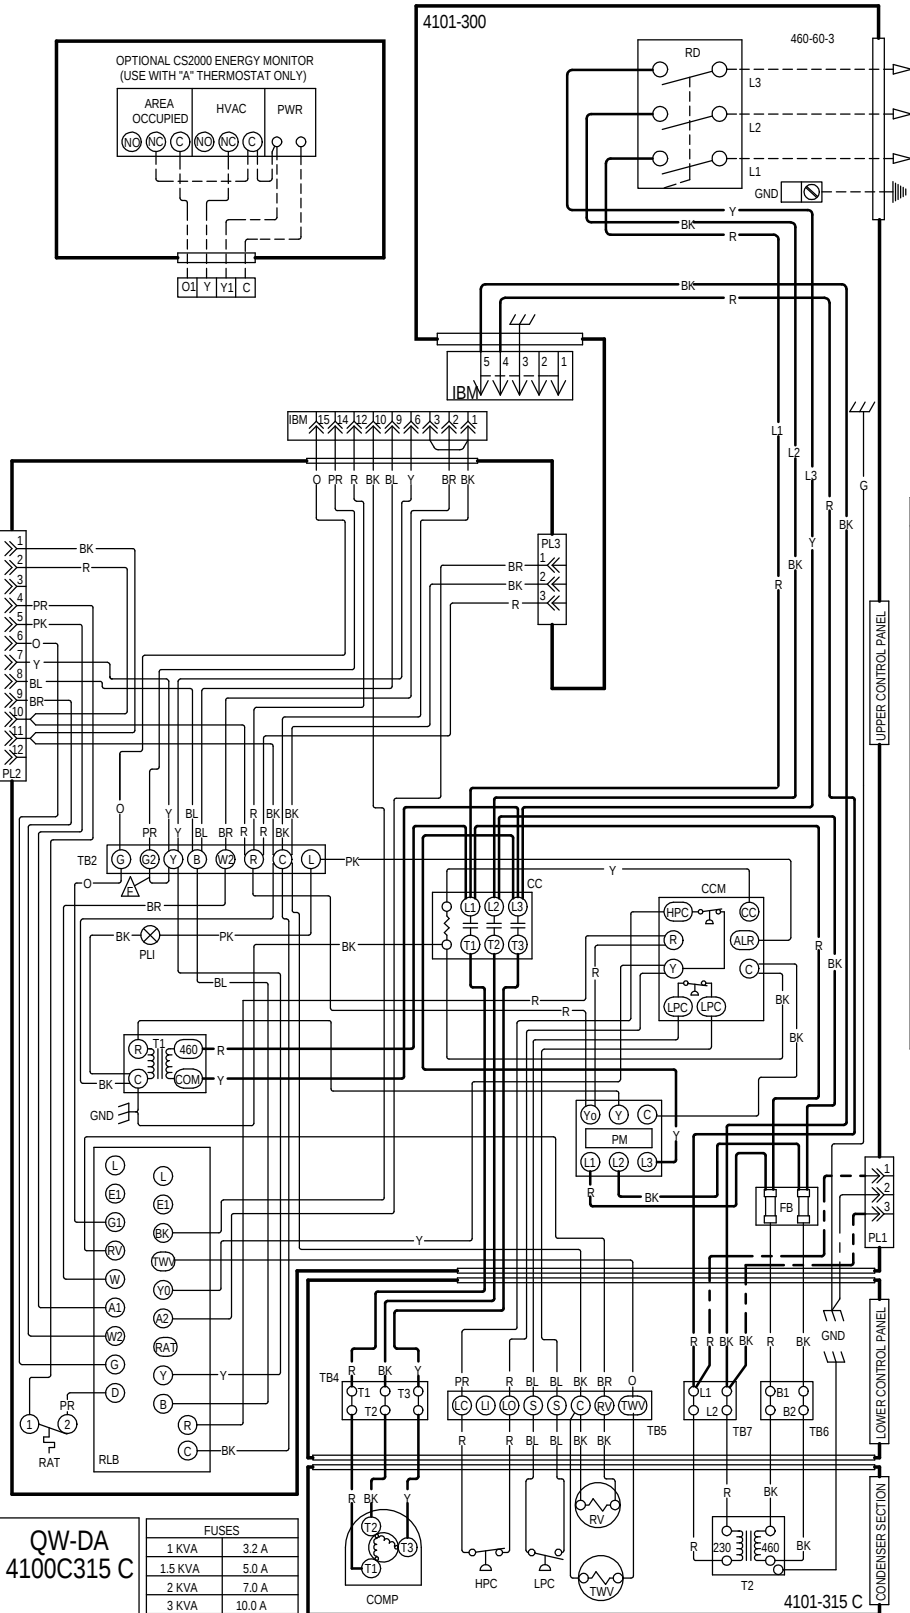
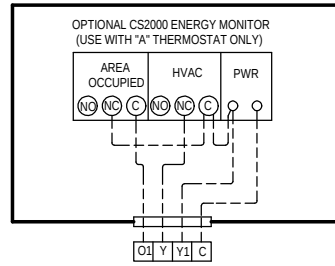
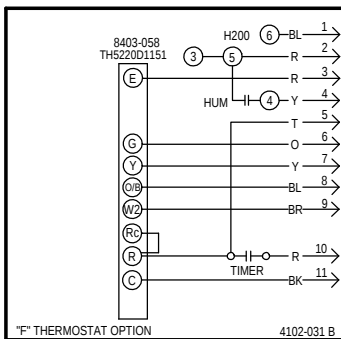
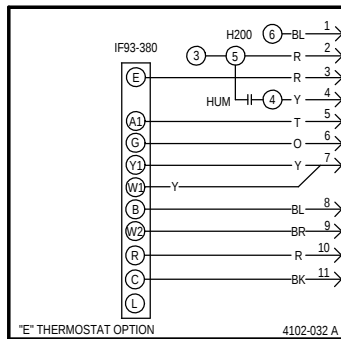
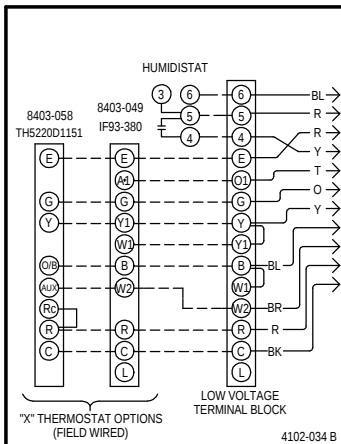


COMPOSITE WIRING DIAGRAM QW DEHUMIDIFICATION SERIES 2
460-60-3, REPRESENTS UNIT WITH CIRCUIT BREAKER KIT.

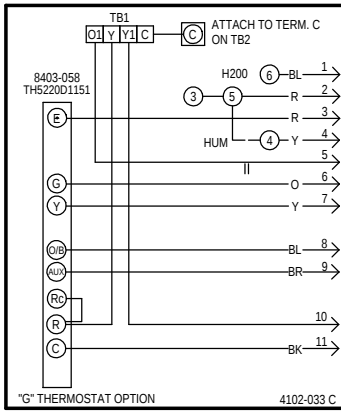

	COMPONENT CODE
CB1	CIRCUIT BREAKER #1
CB2	CIRCUIT BREAKER #2
CC	COMPRESSOR CONTACTOR
CCM	COMPRESSOR CONTROL MODULE
COMP	COMPRESSOR
FB	FUSE BLOCK
GND	GROUND
HPC	HIGH PRESSURE CONTROL
HS1	HEAT STRIP #1
HS2	HEAT STRIP #2
IBM	INDOOR BLOWER MOTOR
LPB	LOW PRESSURE BYPASS
LPC	LOW PRESSURE CONTROL
OFM	OUTDOOR FAN MOTOR
OMR	OUTDOOR MOTOR RELAY
P1	ACCESSORY PLUG #1
P2	ACCESSORY PLUG #2
P3	ACCESSORY PLUG #3
PLI	PRESSURE LOCKOUT INDICATOR
PM	PHASE MONITOR
RAT	RETURN AIR TSTAT
RD	ROTARY DISCONNECT
RLB	RELAY LOGIC BOARD
RV	REV. VALVE SOLINOID
T1	TRANSFORMER #1
T2	TRANSFORMER #2
TB1	TERMINAL BLOCK #1
TB2	TERMINAL BLOCK #2
TB3	TERMINAL BLOCK #3
TB4	TERMINAL BLOCK #4
TB5	TERMINAL BLOCK #5
TB6	TERMINAL BLOCK #6
TB7	TERMINAL BLOCK #7
TWV	THREE WAY VALVE

△△△△ LABELED WIRES CONNECT
IF NO OPTIONS USED.

 MOVE RED WIRE TO 208V TAP
FOR 208V OPERATION

⚠ INSTALL JUMPER FOR HIGH SPEED BLOWER OPER. ON MODELS 36,42, 48, AND 60

 REMOVE JUMPER WHEN LAC IS INSTALLED

WIRING CODE			
	FACTORY STD.	FIELD	OPTIONAL
HIGH VOLTAGE		—	
LOW VOLTAGE		- - -	
ACCESSORY			- - -

COLOR CODE			
BK	BLACK	PK	PINK
BL	BLUE	PR	PURPLE
BR	BROWN	R	RED
G	GREEN	T	TAN
GY	GRAY	Y	YELLOW

"E", "F", AND "G" ARE FACTORY WIRED THERMOSTAT OPTIONS