
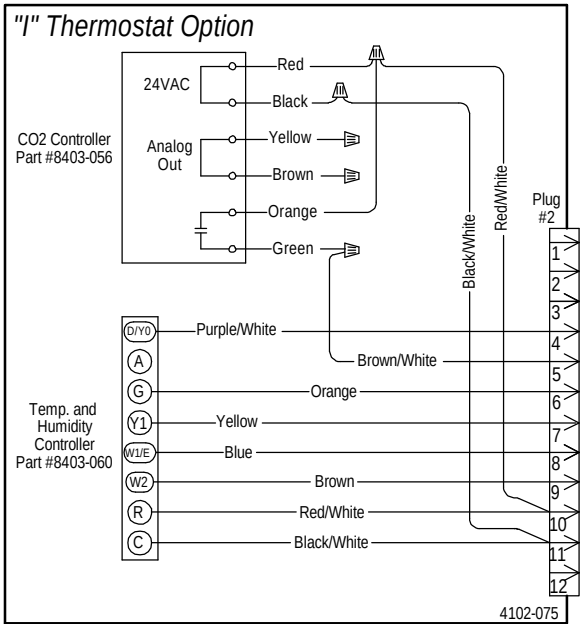
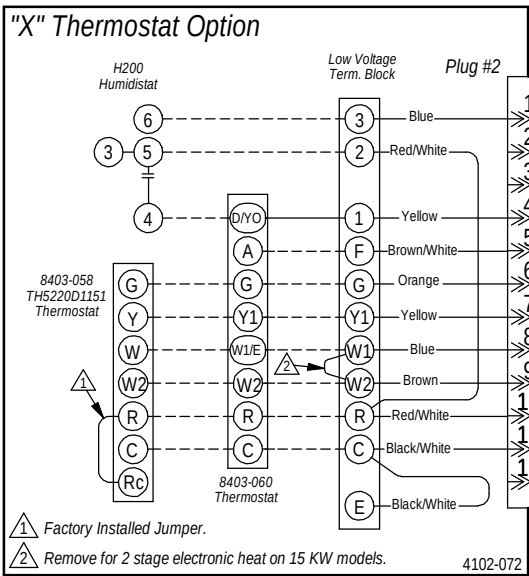
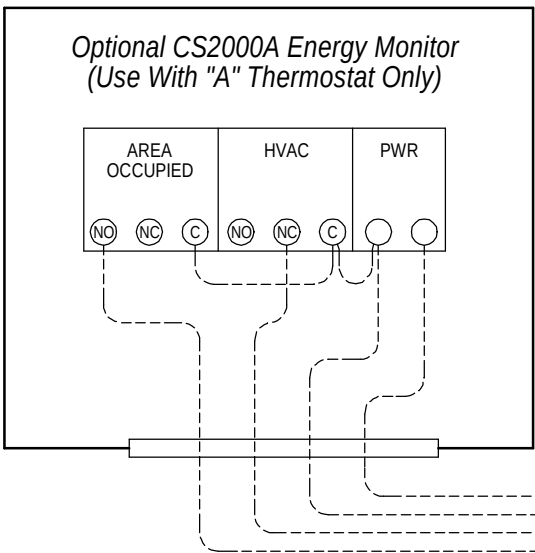
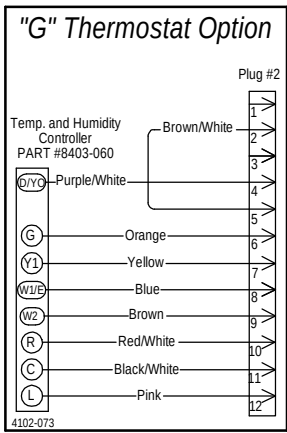


	Factory	Field	Optional
High Voltage		---	---
Low Voltage		---	---

Dehum. Series 3 KW Electric Heat

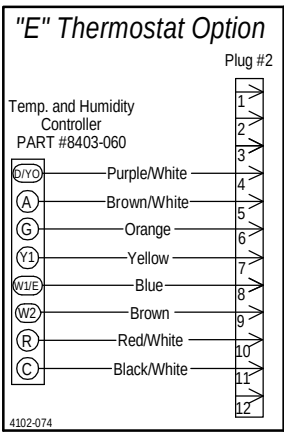

-     Labeled wires connect if no options used.
-  Move Red wire to 208V tap for 208V operation.
-  Install jumper for hi speed blower oper. on models 36, 42, 48, and 60.
-  Remove jumper when Low Amb. Bypass is installed.
-  Remove jumper when CS2000A Energy Monitor is installed.