


	Factory	Field	Optional
High Voltage		-----	-----
Low Voltage		-----	-----

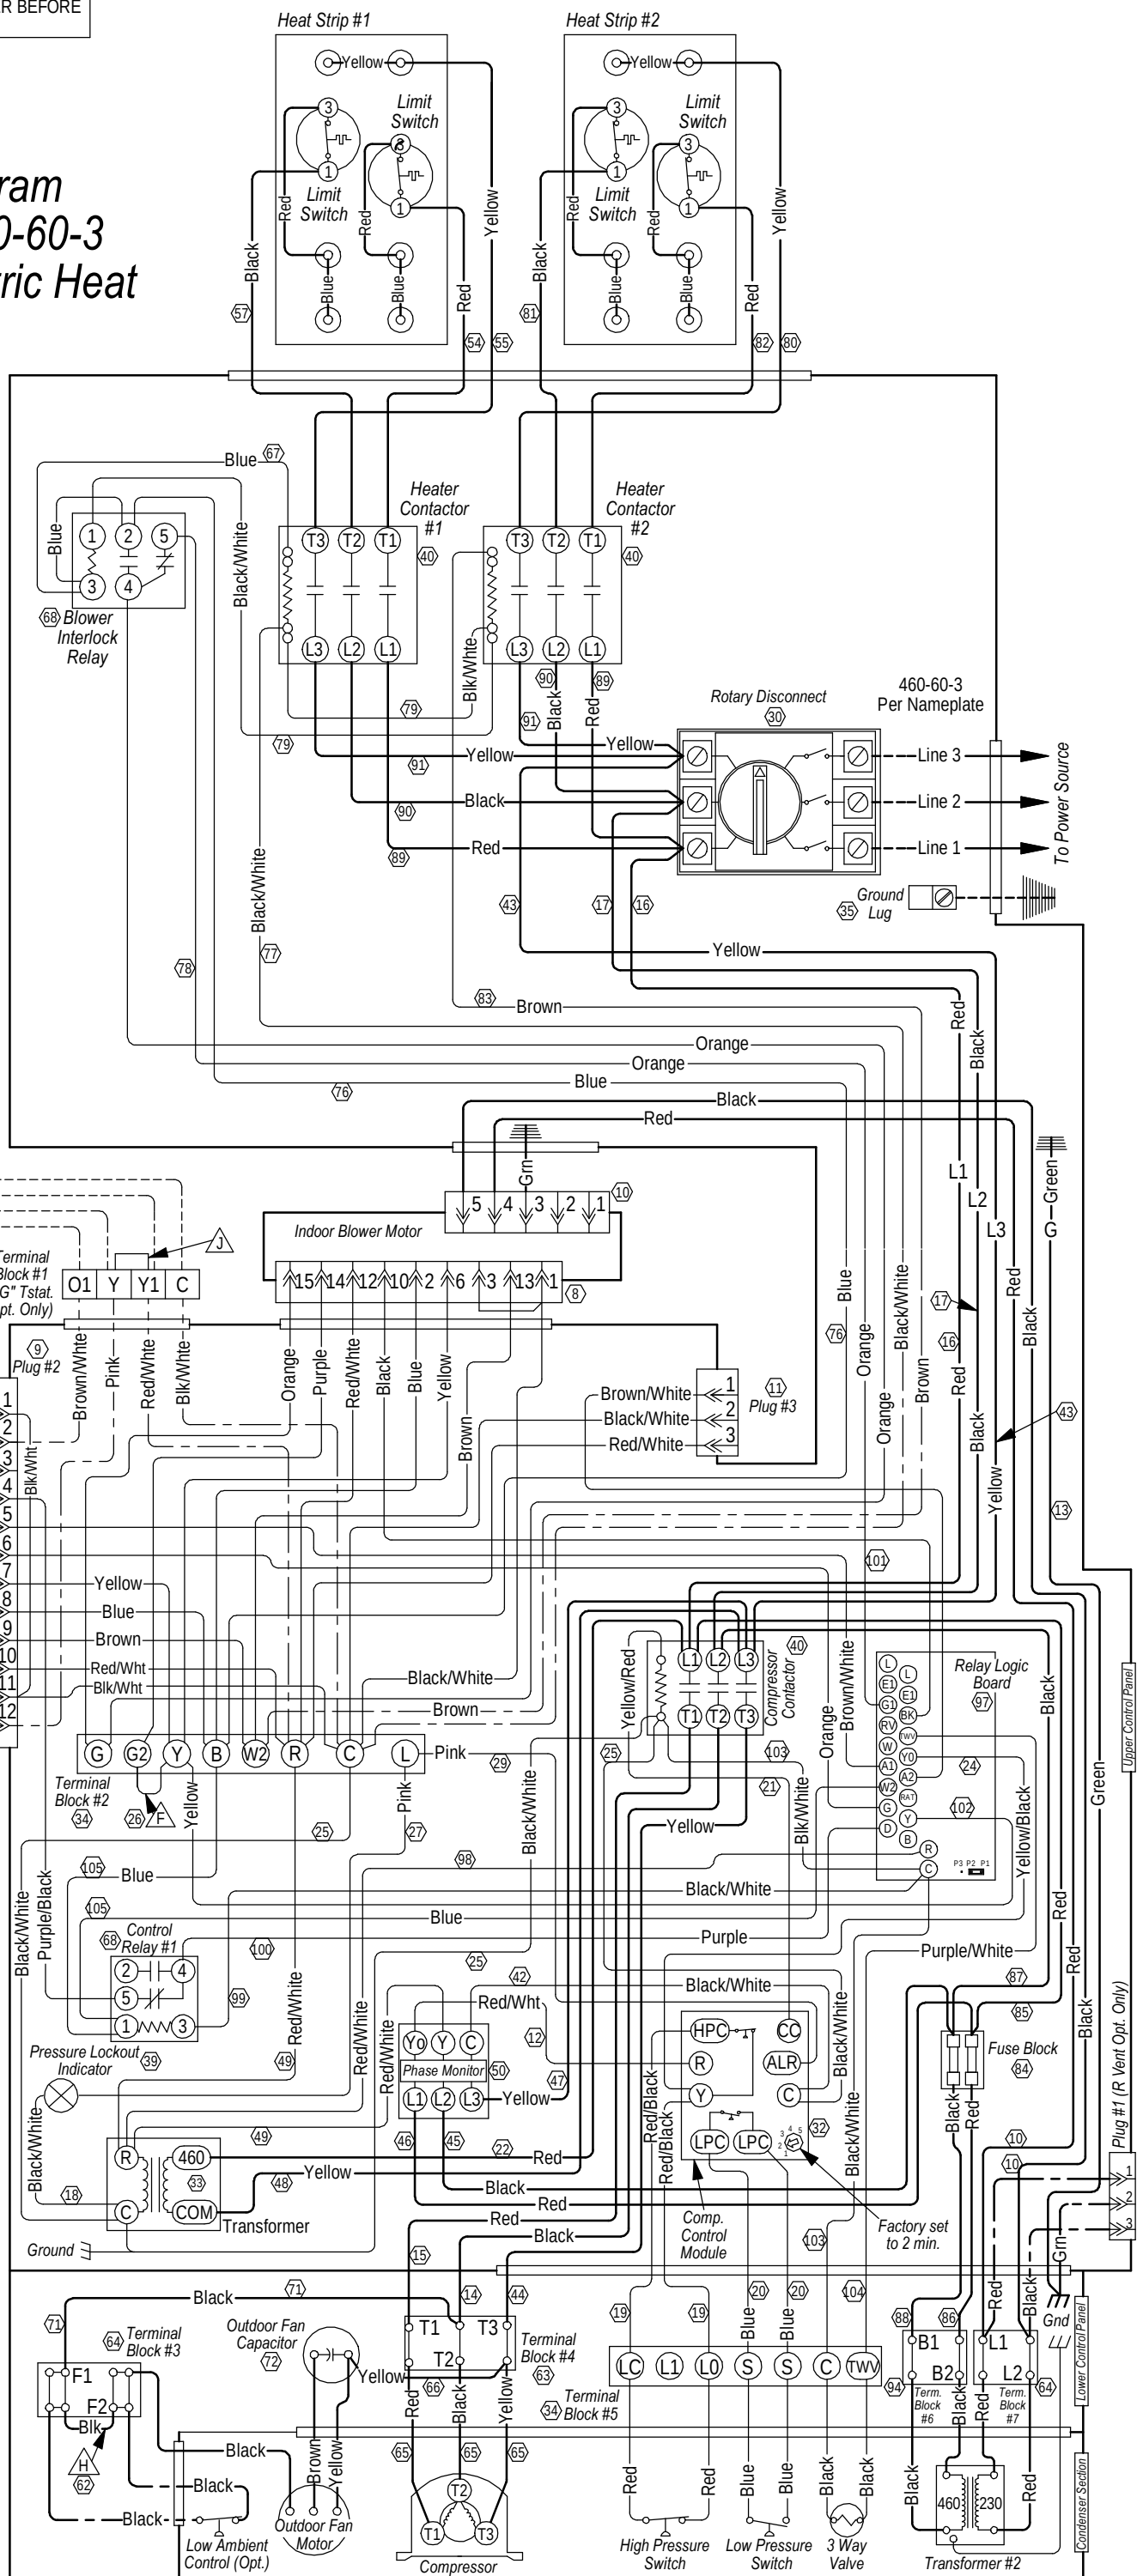

-  Labeled wires connect if no options used.
-  Install jumper for hi speed blower oper. on models 36, 42, 48, and 60.
-  Remove jumper when Low Amb. Bypass is installed.
-  Remove jumper when CS2000A Energy Monitor is installed.