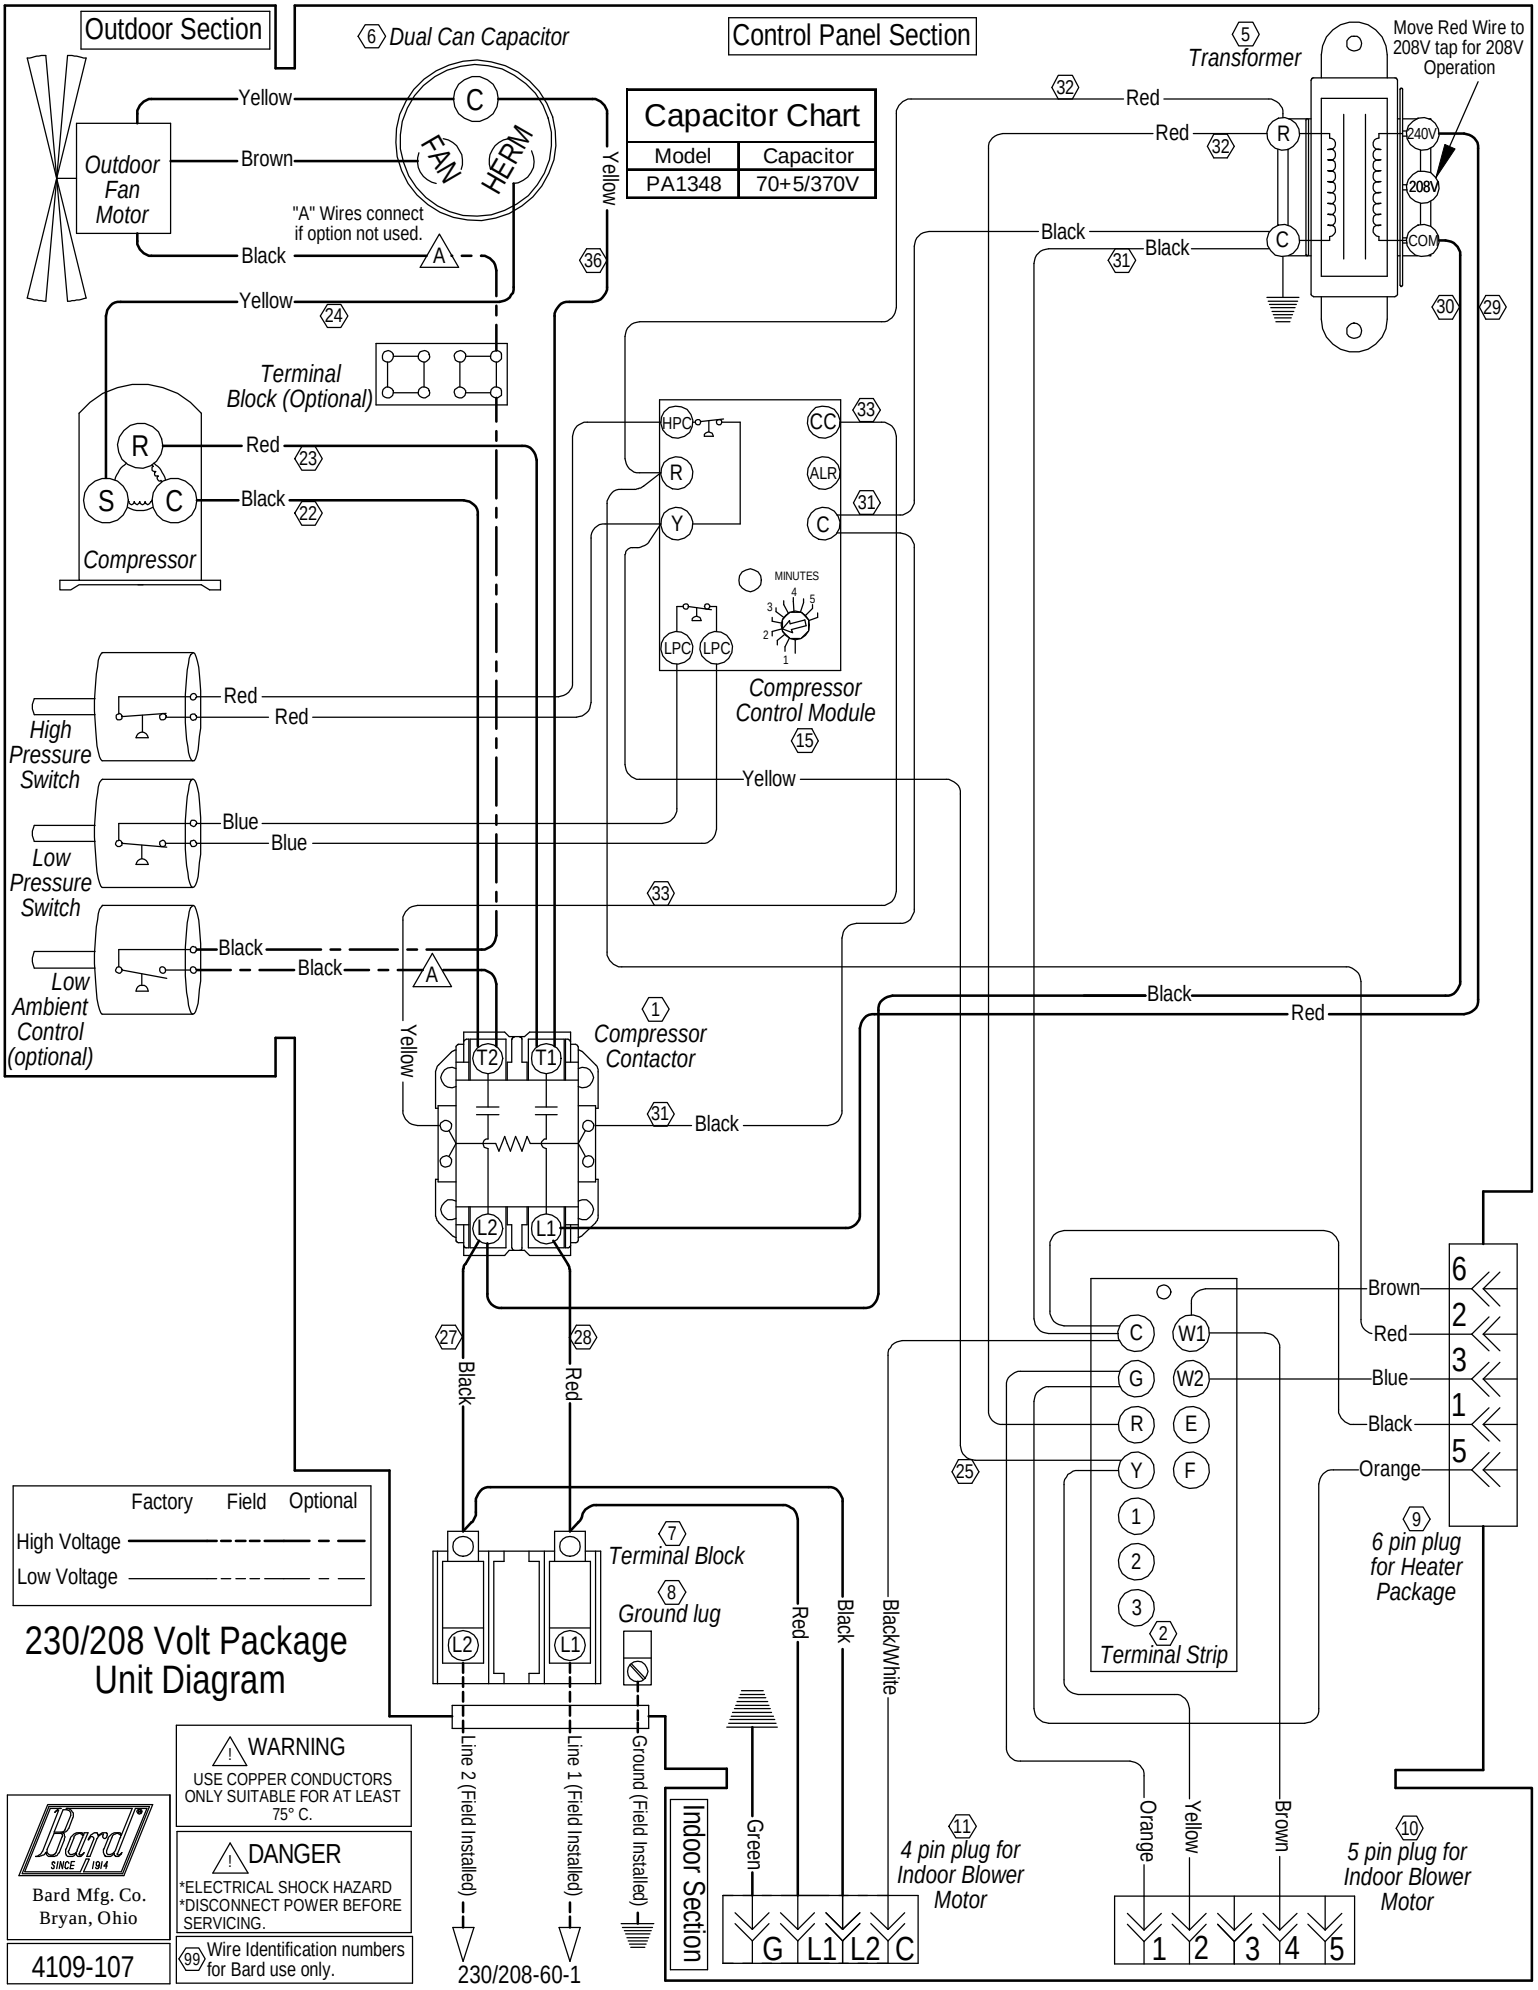
Outdoor Section
Control Panel Section
6 Dual Can Capacitor
5 Transformer
Move Red Wire to 208V tap for 208V Operation
Capacitor Chart
Model | Capacitor
PA1348 | 70+5/370V
Outdoor Fan Motor
Yellow
Brown
Black
"A" Wires connect if option not used.
Terminal Block (Optional)
Compressor
Red
Black
High Pressure Switch
Low Pressure Switch
Low Ambient Control (optional)
Blue
Compressor Control Module
15
HPC
LPC
MINUTES
1 Compressor Contactor
T2
T1
L2
L1
7 Terminal Block
8 Ground lug
2 Terminal Strip
9 6 pin plug for Heater Package
10 5 pin plug for Indoor Blower Motor
11 4 pin plug for Indoor Blower Motor
Indoor Section
Factory
Field
Optional
High Voltage
Low Voltage
230/208 Volt Package Unit Diagram
WARNING
USE COPPER CONDUCTORS ONLY SUITABLE FOR AT LEAST 75° C.
DANGER
*ELECTRICAL SHOCK HAZARD
*DISCONNECT POWER BEFORE SERVICING.
99 Wire Identification numbers for Bard use only.
Bard Mfg. Co.
Bryan, Ohio
4109-107
Line 2 (Field Installed)
Line 1 (Field Installed)
Ground (Field Installed)
230/208-60-1