


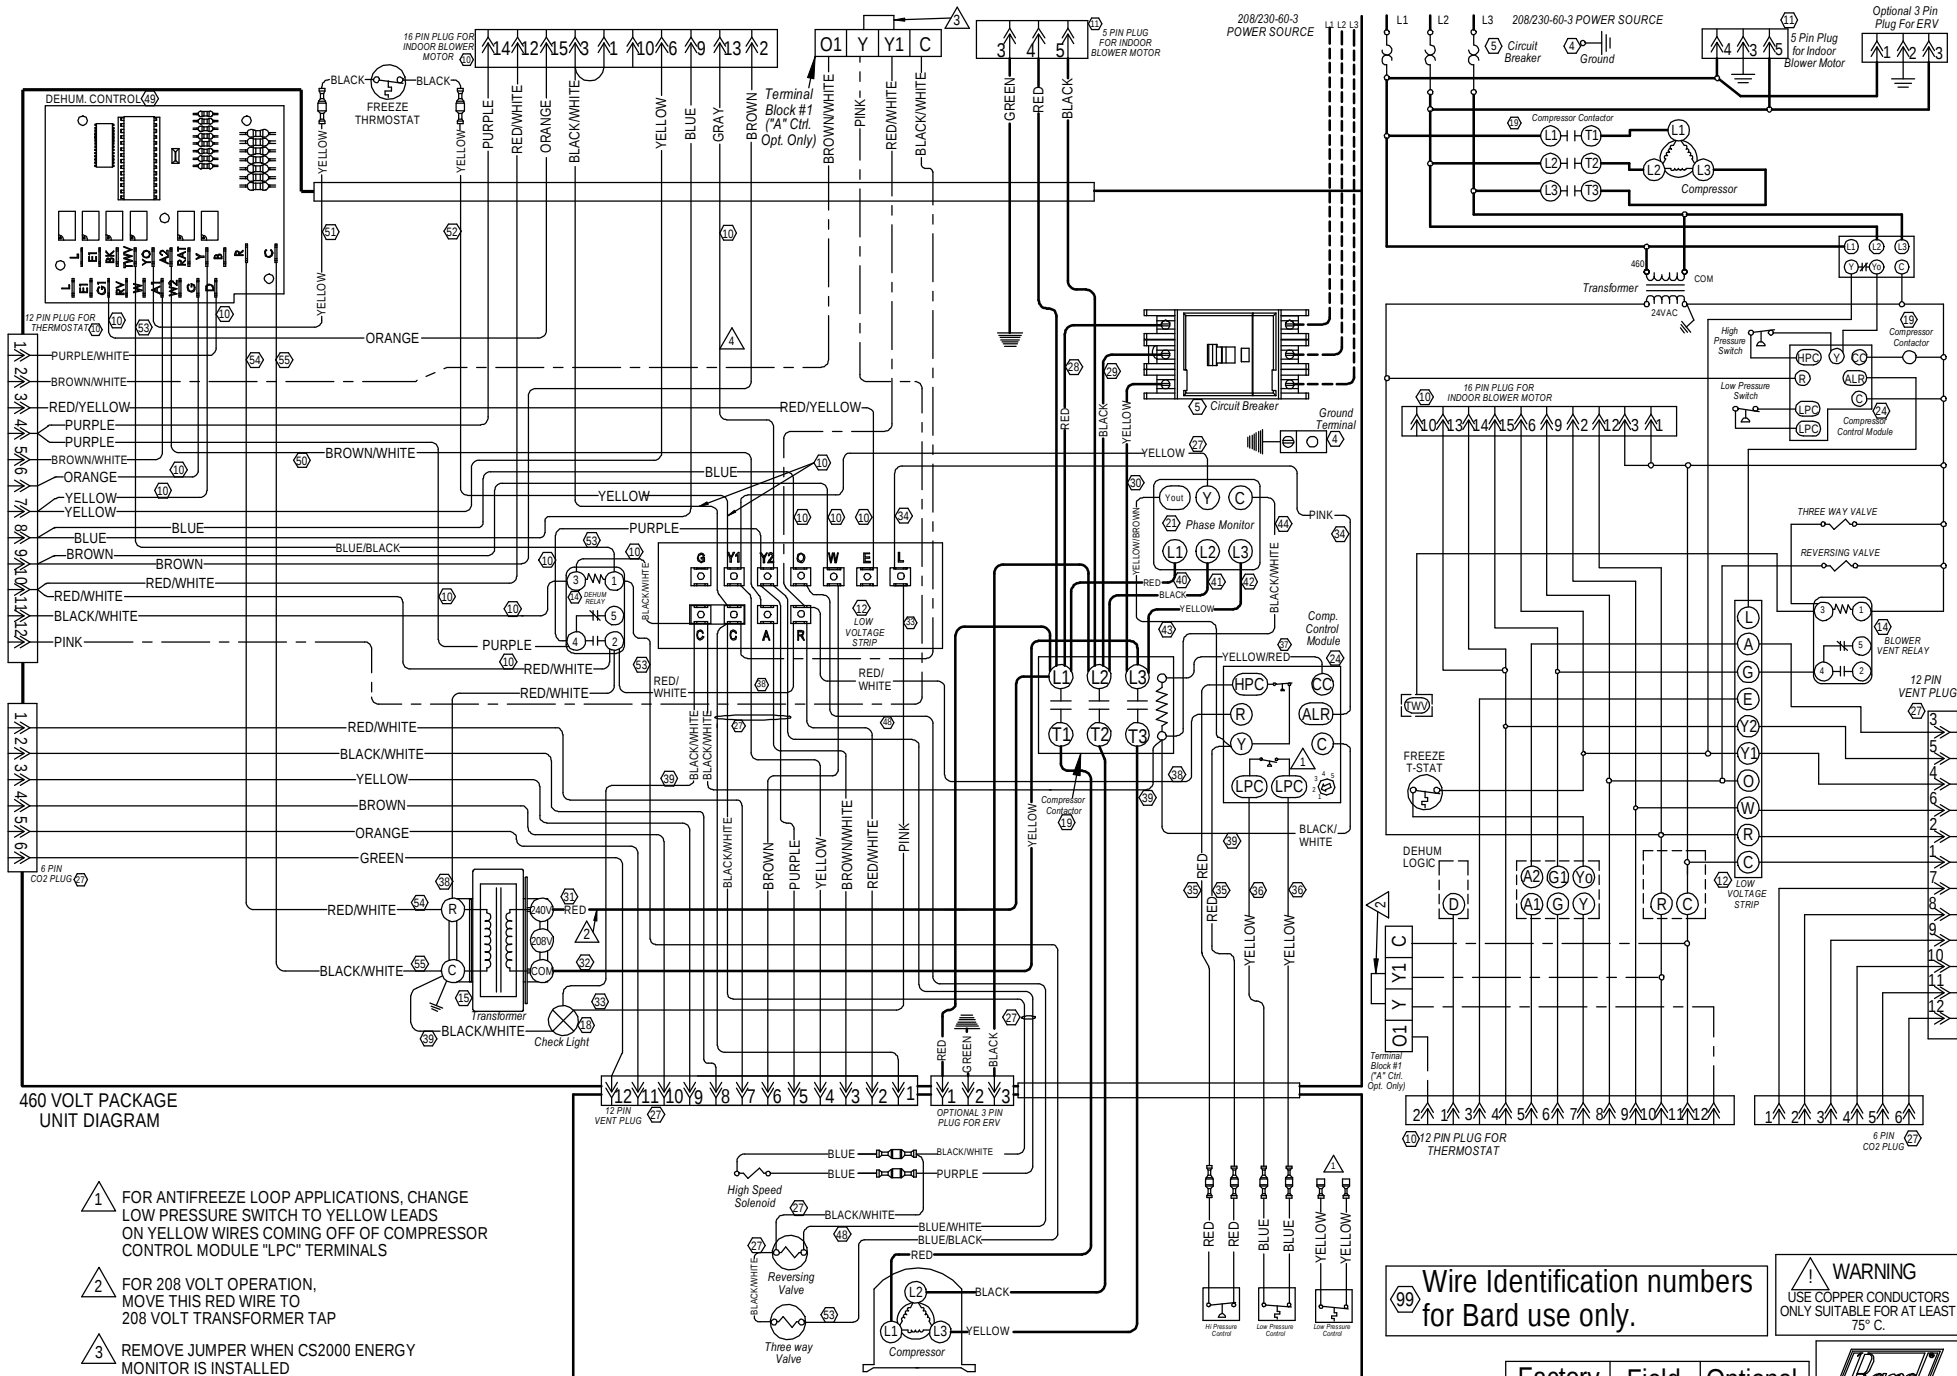

DANGER
*ELECTRICAL SHOCK HAZARD
*DISCONNECT POWER BEFORE SERVICING.

	Factory	Field	Optional
High Voltage			
Low Voltage			

Bard
SINCE 1964
Bard Mfg. Co.
Bryan, Ohio
4113-201 A