


460-60-3 Line Power Per Nameplate

WARNING
USE COPPER CONDUCTORS
ONLY SUITABLE FOR AT LEAST
75° C.

DANGER
*ELECTRICAL SHOCK HAZARD
*DISCONNECT POWER BEFORE
SERVICING.


GROUND
TERMINAL

②⑥ CIRCUIT BREAKER



YELLOW
YELLOW
BLACK
BLACK
RED
RED

BLACK/WHITE
BROWN
BLUE/BLACK
RED/WHITE
ORANGE

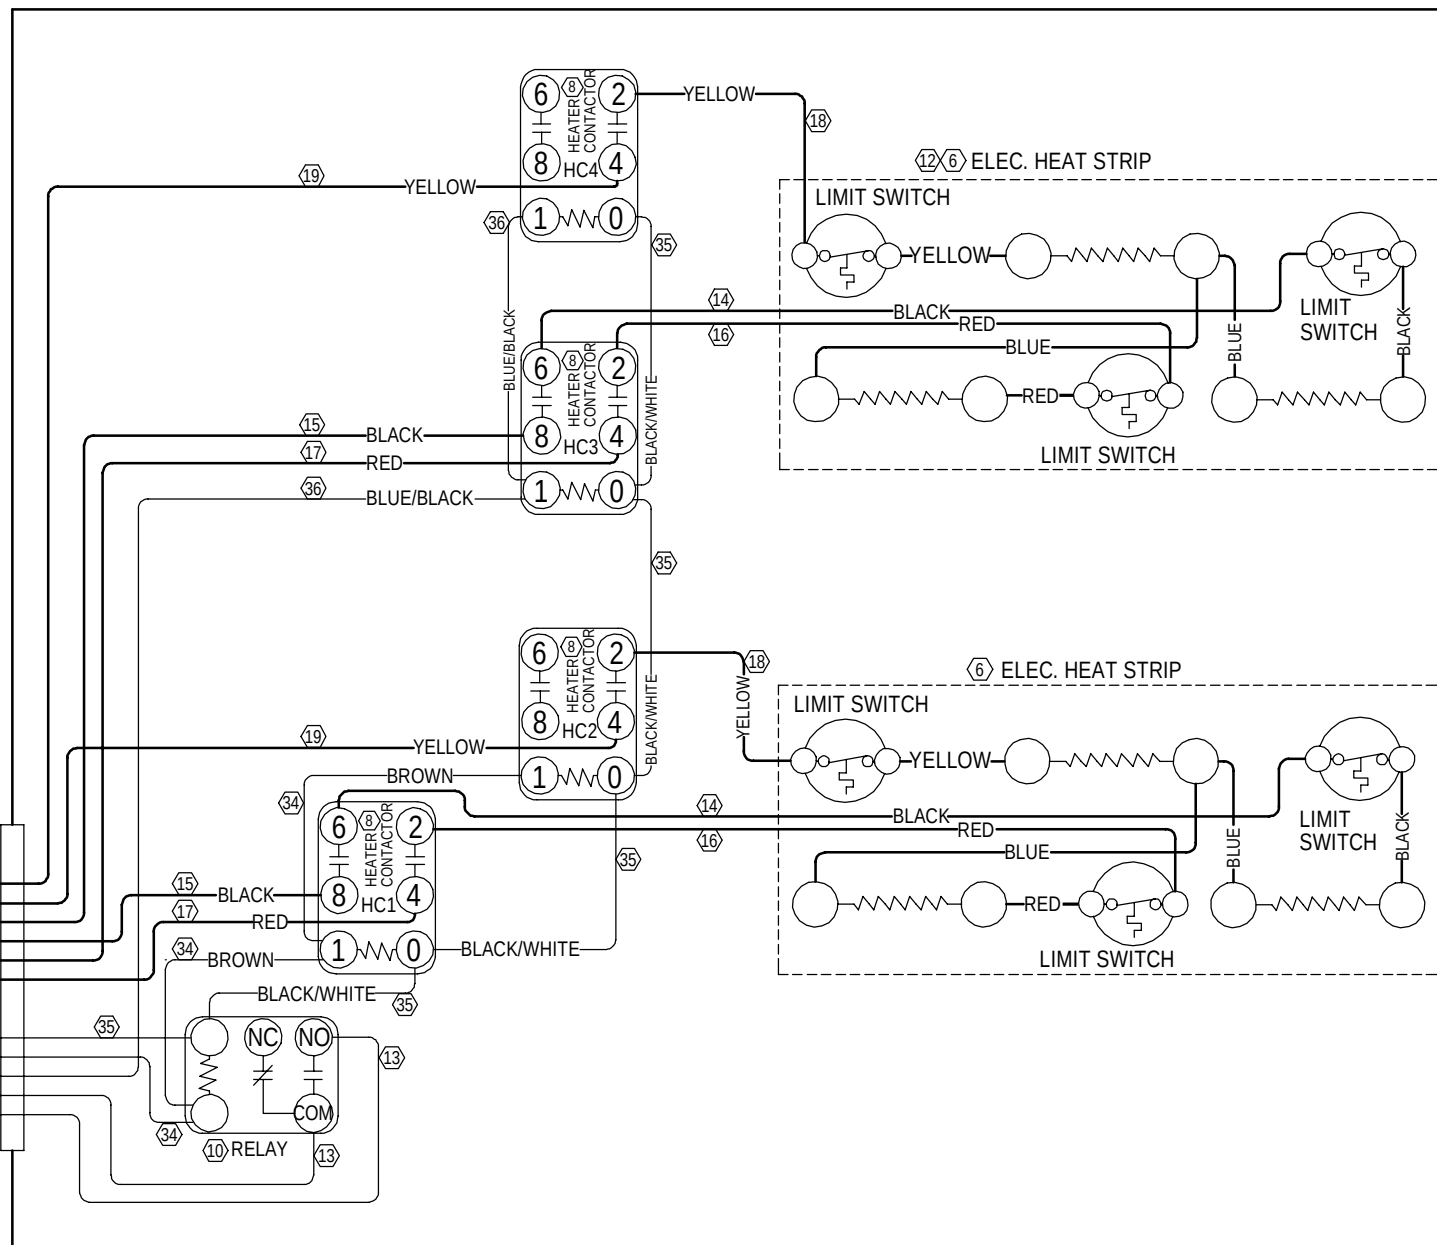

Unit Model Number	CLASS CC Stepdown Transformer Fuse-W/Vent ^②	CLASS CC Stepdown Transformer Fuse-No Vent ^②
I36Z1CC15	7A	5A
I48Z1CC15	7A	5A
I48Z1CC18	7A	5A
I60Z1CC15	10A	7A
I60Z1CC18	10A	7A

- ^② THIS WIRE IS TAPED-OFF IN LOW VOLTAGE TERMINAL BOX. SEE LOW VOLTAGE WIRING SECTION IN INSTALLATION MANUAL.
- ^① FOR 208 VOLT OPERATION, MOVE THIS RED WIRE TO 208 VOLT TRANSFORMER TAP

⑨⑨ Wire Identification numbers for Bard use only.			
	Factory	Field	Optional
High Voltage		---	---
Low Voltage		---	---