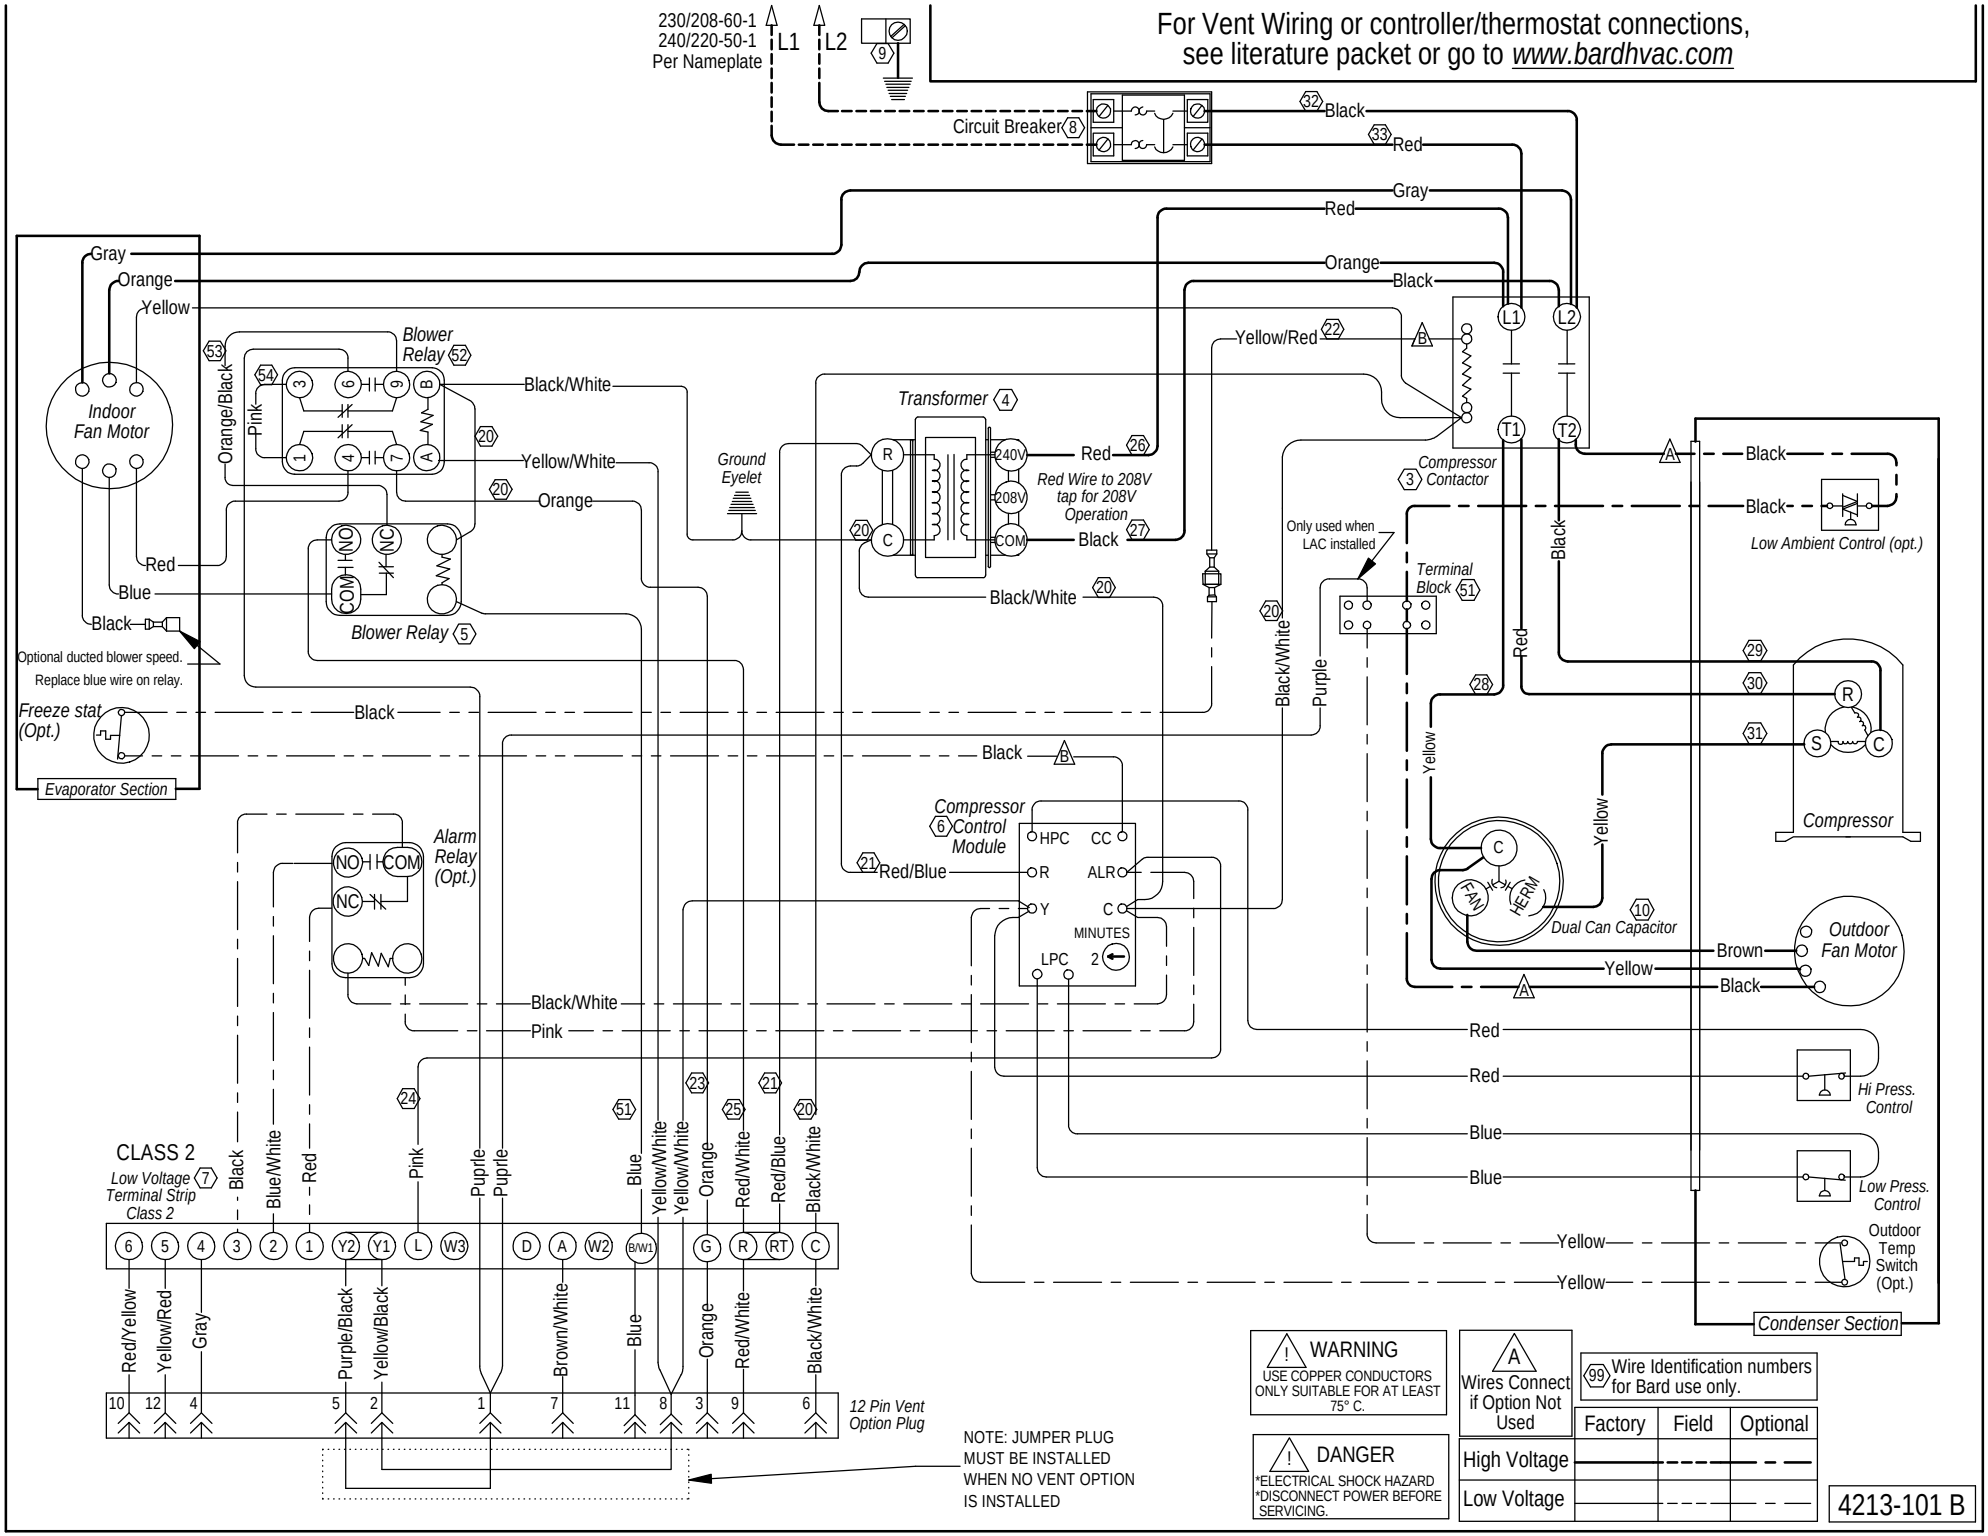
For Vent Wiring or controller/thermostat connections, see literature packet or go to www.bardhvac.com
230/208-60-1
240/220-50-1
Per Nameplate
L1
L2
Circuit Breaker
Black
Red
Gray
Orange
Yellow
Indoor Fan Motor
Blower Relay
Black/White
Yellow/White
Orange/Black
Pink
Blue
Optional ducted blower speed. Replace blue wire on relay.
Freeze stat (Opt.)
Evaporator Section
Ground Eyelet
Transformer
240V
208V
COM
Red Wire to 208V tap for 208V Operation
Yellow/Red
Compressor Contactor
Only used when LAC installed
Terminal Block
Low Ambient Control (opt.)
Compressor
Dual Can Capacitor
Outdoor Fan Motor
Brown
Purple
Alarm Relay (Opt.)
Compressor Control Module
HPC
CC
ALR
MINUTES
LPC
Red/Blue
Hi Press. Control
Low Press. Control
Outdoor Temp Switch (Opt.)
Condenser Section
CLASS 2
Low Voltage Terminal Strip Class 2
Blue/White
Puprle
Yellow/White
Red/White
Black/White
12 Pin Vent Option Plug
NOTE: JUMPER PLUG MUST BE INSTALLED WHEN NO VENT OPTION IS INSTALLED
WARNING
USE COPPER CONDUCTORS ONLY SUITABLE FOR AT LEAST 75° C.
DANGER
*ELECTRICAL SHOCK HAZARD
*DISCONNECT POWER BEFORE SERVICING.
Wires Connect if Option Not Used
Wire Identification numbers for Bard use only.
Factory
Field
Optional
High Voltage
Low Voltage
4213-101 B