



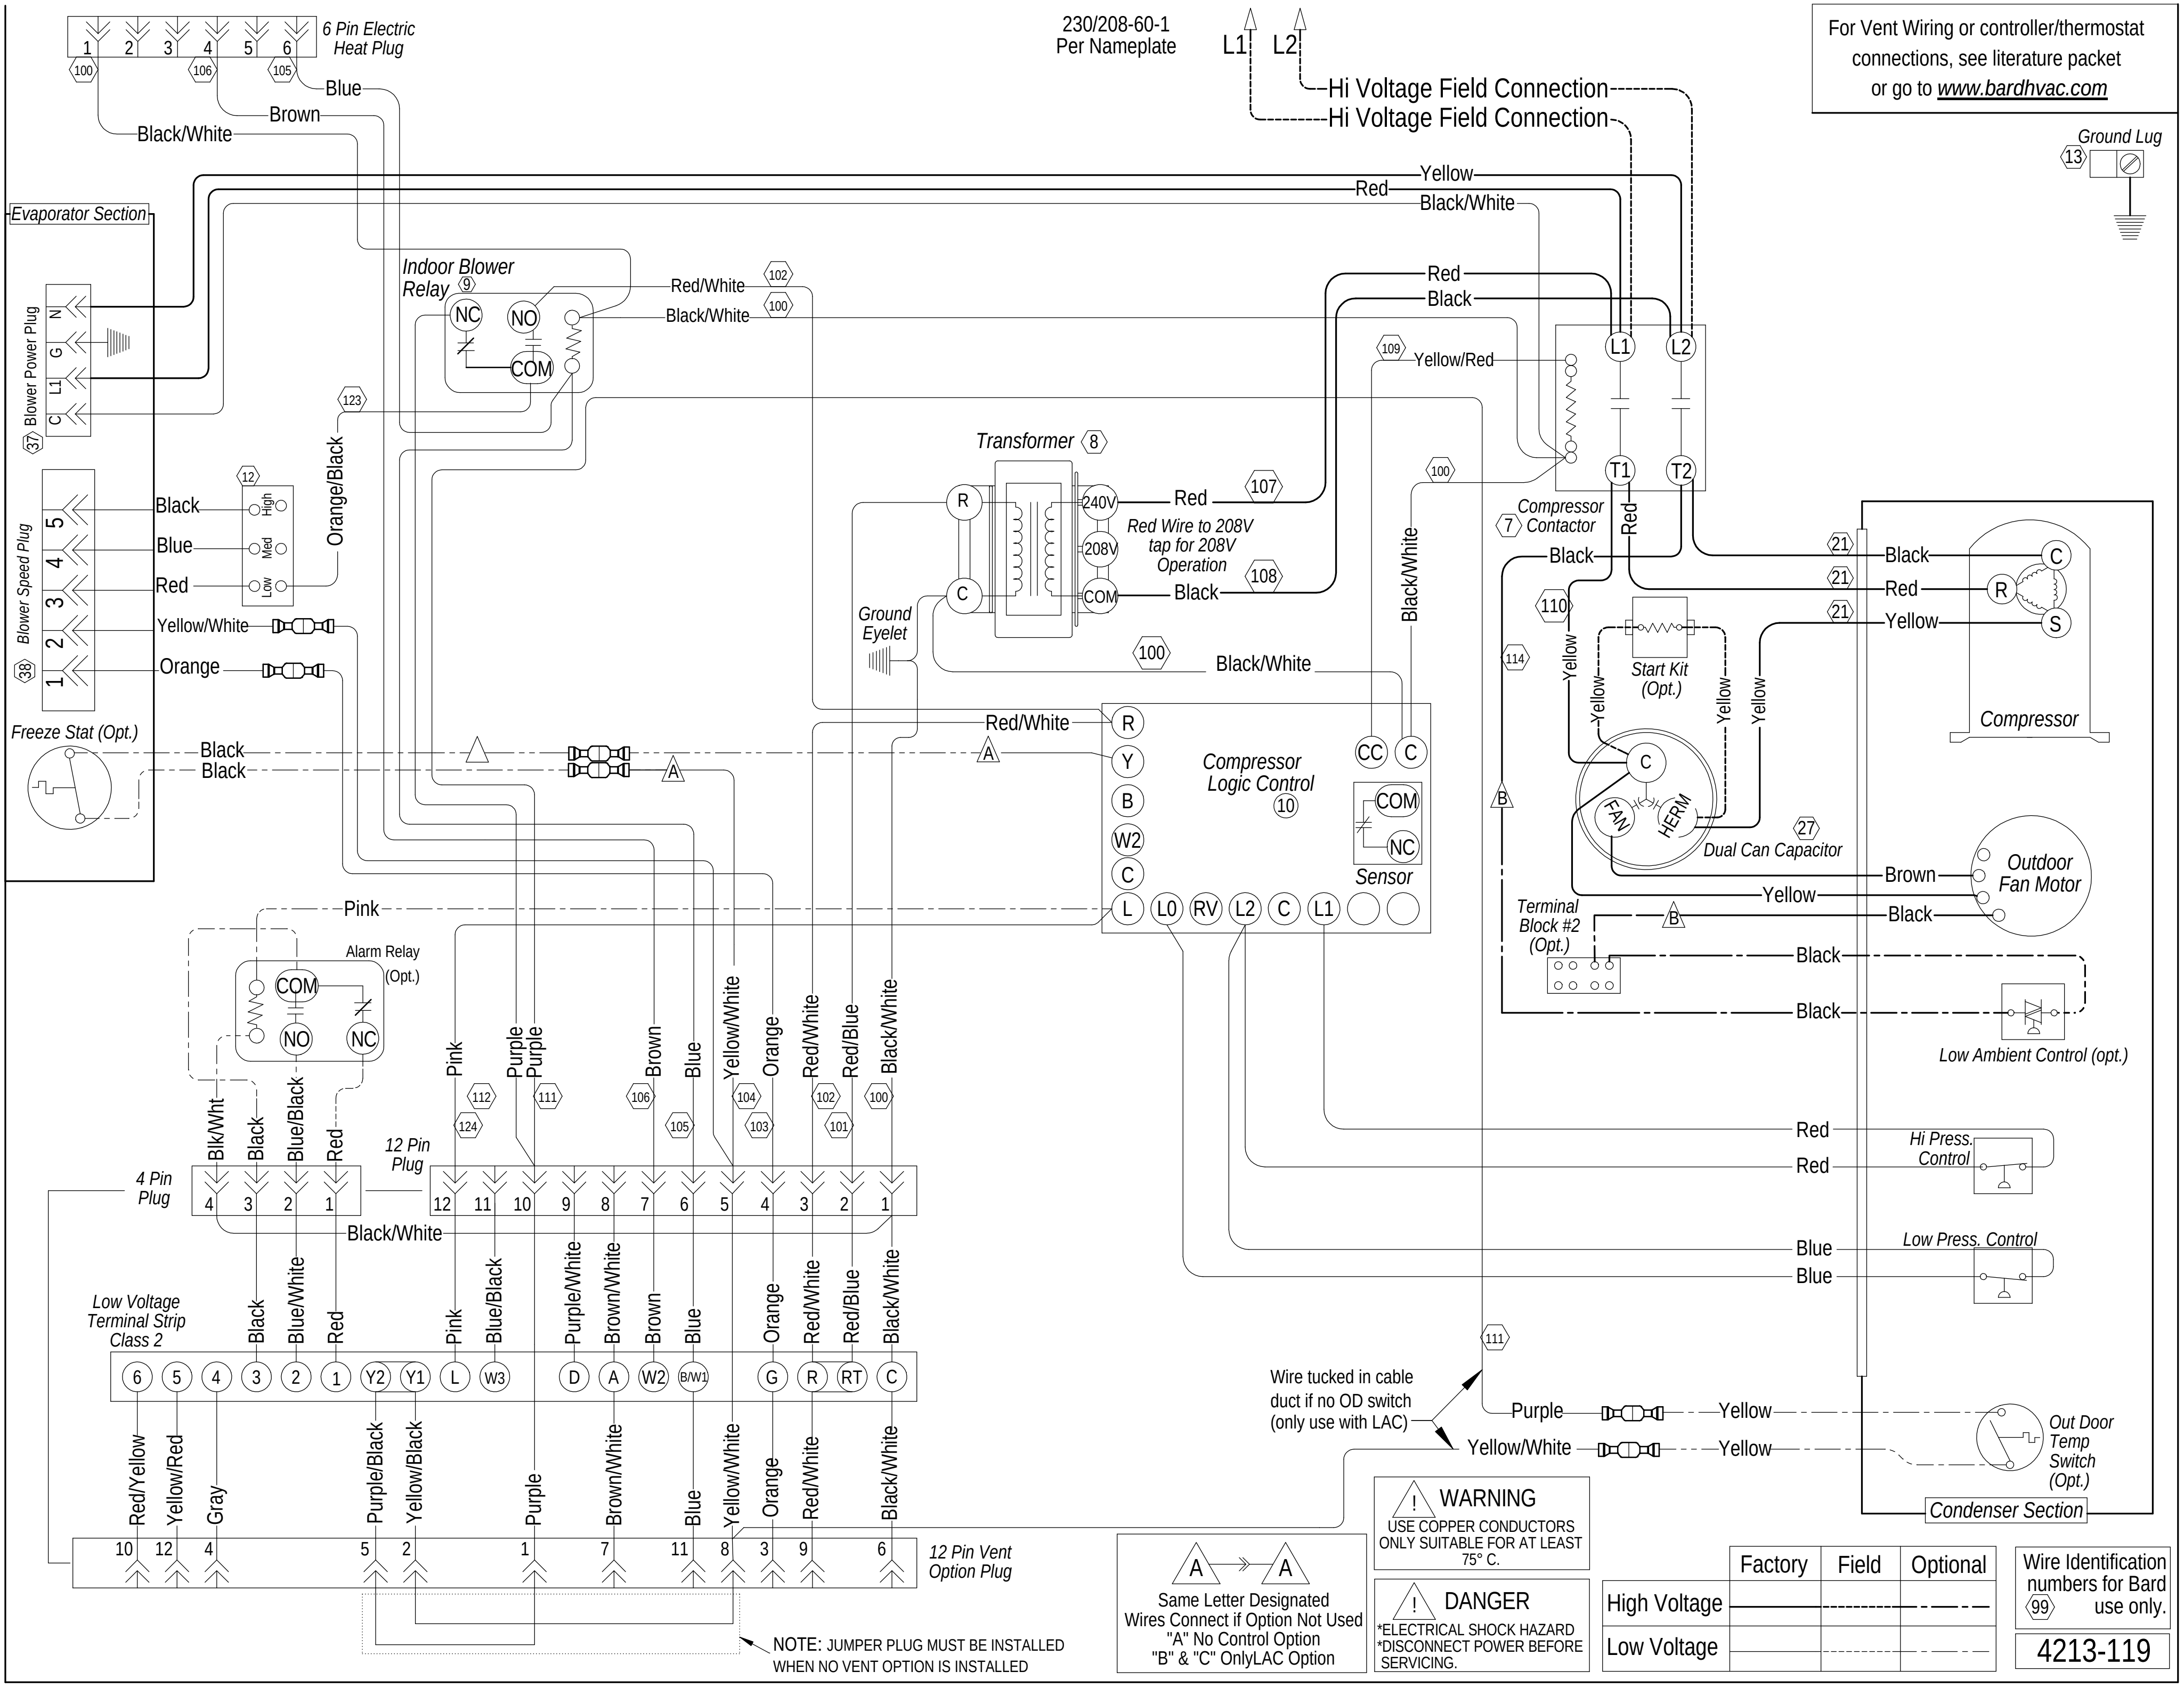

230/208-60-1
Per Nameplate




For Vent Wiring or controller/thermostat connections, see literature packet or go to www.bardhvac.com




L1
L2

Hi Voltage Field Connection
Hi Voltage Field Connection



Evaporator Section

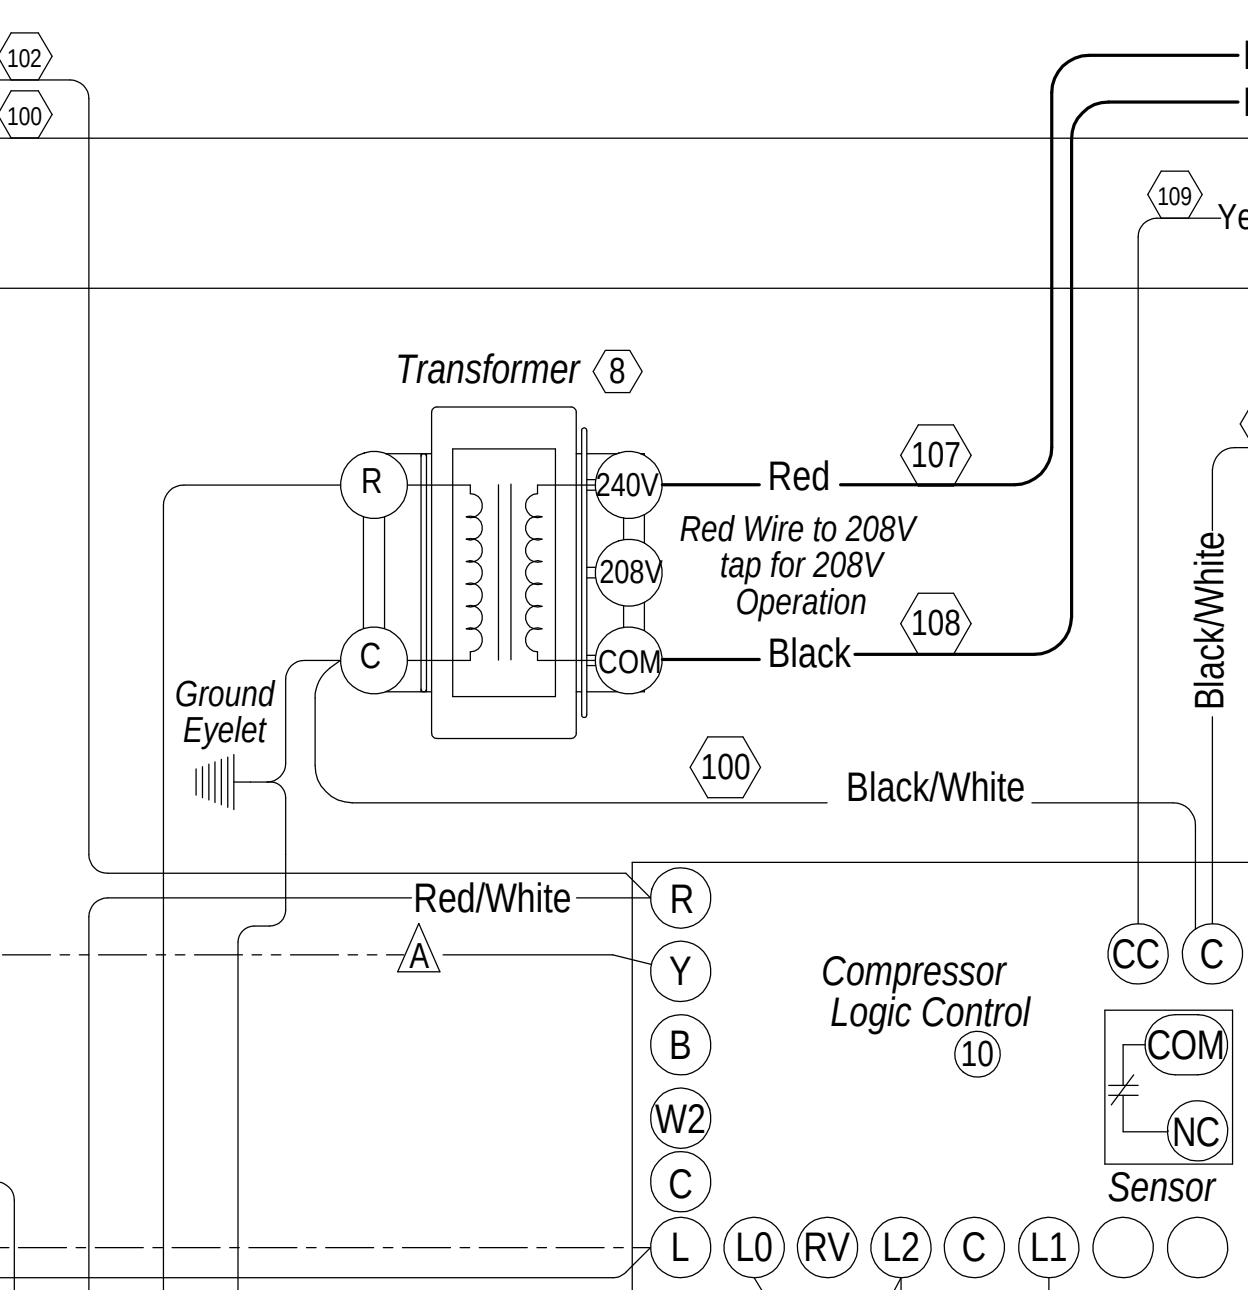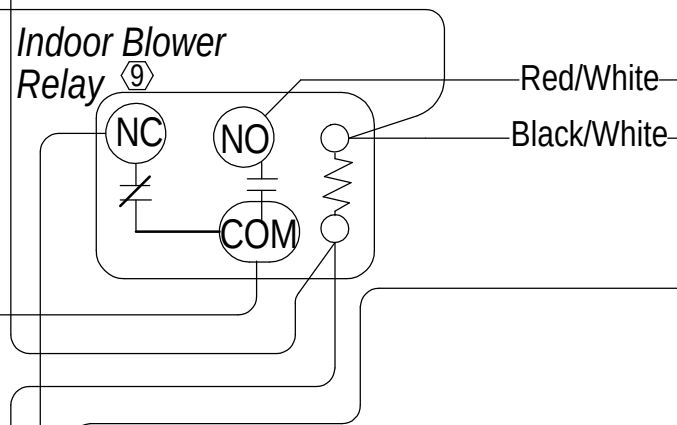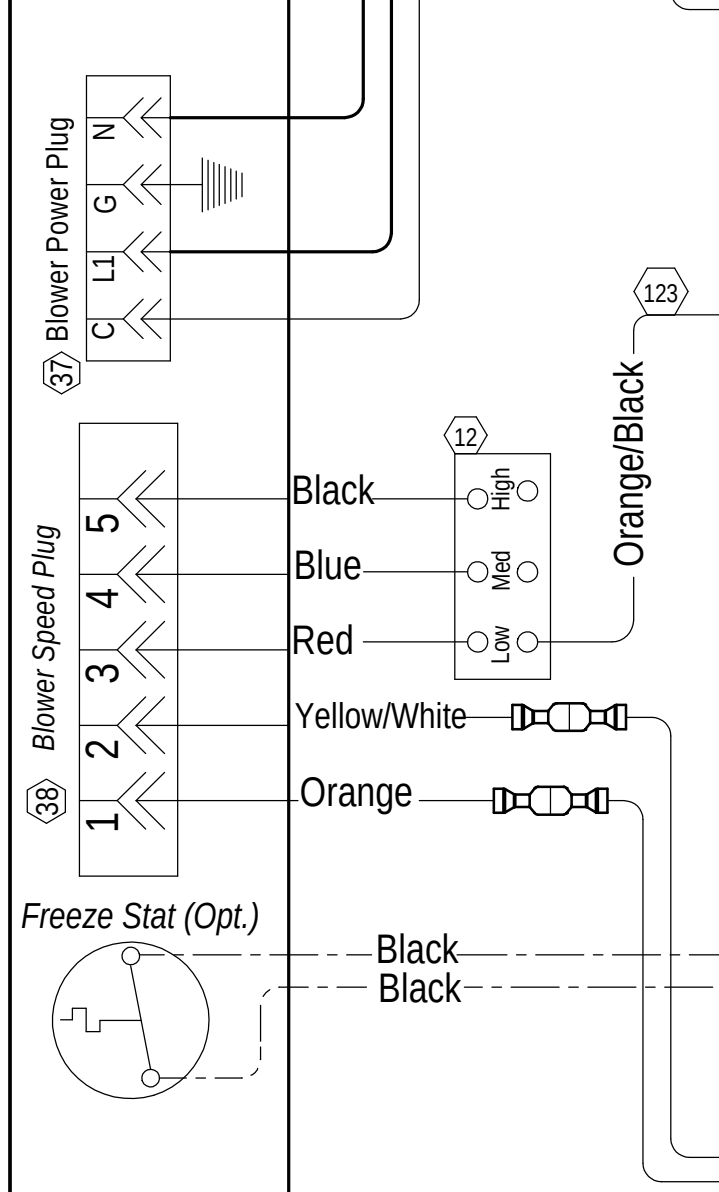




Transformer

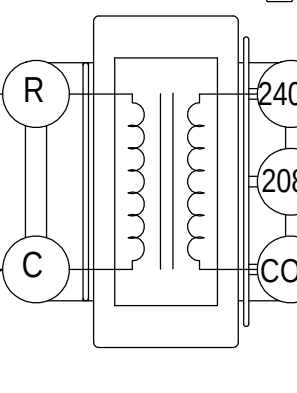

Compressor Contactor

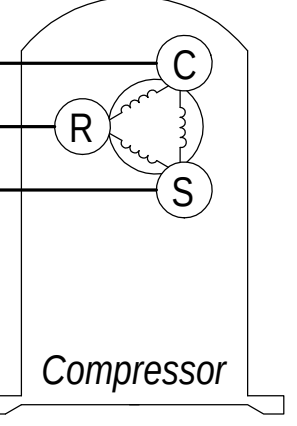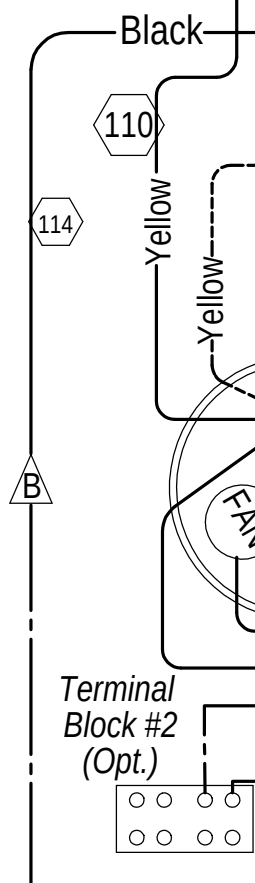

Low Ambient Control (opt.)

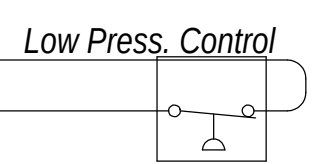

Condenser Section

Wire tucked in cable duct if no OD switch (only use with LAC)

WARNING
USE COPPER CONDUCTORS ONLY SUITABLE FOR AT LEAST 75° C.

DANGER
*ELECTRICAL SHOCK HAZARD
*DISCONNECT POWER BEFORE SERVICING.

A → **A**
Same Letter Designated Wires Connect if Option Not Used
"A" No Control Option
"B" & "C" Only LAC Option

NOTE: JUMPER PLUG MUST BE INSTALLED WHEN NO VENT OPTION IS INSTALLED

	Factory	Field	Optional
High Voltage			
Low Voltage			

Wire Identification numbers for Bard use only.
4213-119